### TÜV Rheinland Nederland B.V.





TÜV Rheinland Nederland B.V. The Netherlands

Postal address: P.O. Box 2220 6802 CE ARNHEM

Parking and delivery: Westervoortsedijk 73 6827 AV ARNHEM

www.tuv.com/nl

T +31 88 888 7888

Jaring.de.Wolff@nl.tuv.com

Report

**Project number:** 89209169 Report number: 89209169.01br

TÜV-reference: MT16-89079.01

Date 02/02/2016

Project number 89209169

Received: Report number A floor covering, marked as: "Luxury Vinyl Tile"; 89209169.01br

Phone number client

Sampling procedure:

The samples are selected by the applicant. The test house has had no influence on the Fax number client sampling procedure.

The samples have been received on the 11/01/2015.

Order:

Classification of burning behaviour according to EN 13501-1:2007+ A1:2009.

**Article** Luxury Vinyl Tile, OSB

Test methods: Ignitability of products subjected to direct impingement of flame (ISO 11925-2:2010/C1:2011) and determination of the burning behavior using a radiant heat source (ISO 9239-1:2010)

Appendix I: Flooring Radiant Panel Single

Specimen Report - 8 pages

Results:

See page three and four.

Appendix:

See page five up to and including twelve.

TRN applies General Terms & Conditions which are filed at the office of the Clerk for civil affairs at the Court in Zutphen (the Netherlands) under number 35/2010. dated November 17th 2010.





### PRODUCT IDENTIFICATION

Name : Luxury Vinyl Tile\*

Product type : OSB\* Type of colouring/patterning : Wood\*

Batch number

:20150930B\*

Dimensions (Length\*Width\*Height) : 1212 \* 221 \* 5.0 mm\*

Packaging : 2.142 m<sup>2</sup>\* Wear layer thickness : 0.7 mm\*

Total thickness : 5.0 mm\* Total mass per unit area  $: 7 \text{ kg/m}^2 *$ 

\* Applicant's declaration

Date 02/02/2016

Project number 89209169

Report number 89209169.01br

Article

Luxury Vinyl Tile, OSB

Page 2/12



Figure 1, Picture of the received sample





Date 02/02/2016

Project number 89209169

Report number 89209169.01br

Article

Luxury Vinyl Tile, OSB

Page 3/12

**TEST RESULTS** 

Ignitability of products subjected to direct impingement of flame

Method EN ISO 11925-2:2010/C1:2011

Date of testing : 01/02/2016

Conditioning time, climate  $: \ge 7 \text{ days}, 23 \pm 2 \text{ °C and } 50 \pm 5 \%$ 

Description of substrate : Fibre cement board,  $8\pm2$  mm,  $1800\pm200$  kg/m<sup>3</sup>

conforming to EN 13238.

: Surface.

Flame application Flame application time : 15 seconds.

Orientation:		Length			Width	
Total burning time <sup>1</sup>	15	15	15	15	15	15
Flame tip reaches 150 mm (s)	No	No	No	No	No	No
Extent of damaged area, length (mm)	52	58	57	54	58	54
Extent of damaged area, width (mm)	11	11	12	11	11	12
Material melts (yes/no)	Yes	Yes	Yes	Yes	Yes	Yes
Shrinks away <sup>2</sup> (yes/no)	No	No	No	No	No	No
Glowing <sup>3</sup> (sec)	No	No	No	No	No	No
Flaming debris (yes/no)	No	No	No	No	No	No
Ignition of filter paper (yes/no)	No	No	No	No	No	No

<sup>1</sup> Inclusive a flame application time of 15 or 30 seconds with surface or edge impingement

### Determination of the burning behavior using a radiant heat source

Method EN ISO 9239-1:2010

Date of testing : 01/02/2016

Conditioning time, climate  $: \ge 7$  days,  $23 \pm 2$  °C and  $50 \pm 5$  %

Description of substrate : Fibre cement board,  $8\pm2$  mm,  $1800\pm200$  kg/m<sup>3</sup>

conforming to EN 13238.

Sampling procedure : By contractor.

Description of cleaning used: None.

Fixing method : None, sample is tested loose laid on the substrate.

Test specimen, orientation	Flame spread (cm)	CRF (kW/m²)	Peak light attenuation (%)	Smoke production (%.min)
1, Length	10.0	≥ 10.9	16.6	92
2, Width	10.0	≥ 10.9	16.5	95
3, Width	9.0	≥ 10.9	17.4	92
4, Width	9.0	≥ 10.9	20.3	100
Mean, Width	9.3	≥ 10.9	18.1	96

Specimen 1, 2, 3 and 4: There is flashing and transitory observed, no sustained flaming are observed.

Specimen 1, 2, 3 and 4: Extinguished naturally before the end of the test duration

<sup>2</sup> Shrinks away from flame without being ignited

<sup>3</sup> The time at which it occurs and its duration





### CONCLUSION

According to EN 13501-1:2007+ A1:2009 the tested sample of the aforementioned quality "Luxury Vinyl Tile", in relation to its reaction to fire behaviour is classified:  $B_{\rm fl}$ .

The aforementioned quality meets the requirement of reaction to fire classification:

The additional classification in relation to smoke production is: \$1.

Date 02/02/2016

Project number 89209169

Report number 89209169.01br

Article

Luxury Vinyl Tile, OSB

**Page** 4/12

The classification is valid for the following end use applications:

- End use substrates of classes A1 and A2-s1,d0, for example fibre cement board.
- Any way of fixation, glued down or loose laid.

### Statements:

The test results only relate to the behaviour of the test specimens of the examined product under the particular conditions of the test in laboratory conditions; they are not intended to be the sole criterion for assessing the potential fire hazard of the product in use. The method might not be suitable if the product is exposed to much larger flames or heat radiant sources.

The validity of this report will expire directly after alterations or modifications of the examined product (combination)(s) and/or the criteria. This report shall not be reproduced, except in full, without the written approval of the testing laboratory.

This document does not represent type approval or certification of the product.

Author:

Mr. J. de Wolff

Review:

Mr. R. Boerboom

All rights reserved.

No part of this report may be reproduced, provided to and/or examined by third parties, and/or published by print, photoprint, microfilm, in electronic form or any other means without the explicit previous written consent of TÜV Rheinland Nederland B.V. The results are based upon the samples received and have not to be representative for the total production. TÜV Rheinland Nederland B.V. had no influence on the sampling.

In case this report was drafted within the context of an assignment to TÜV Rheinland Nederland B.V., the rights and obligations of contracting parties are subject to the General Terms & Conditions for Advisory, Research and Certification assignments to TÜV Rheinland Nederland B.V. and/or the relevant agreement concluded between the contracting parties.

© 2010 TÜV Rheinland Nederland B.V.

(End of report)





Report produced with the fire Testing Technology I RPSoft software

page 1

### Flooring Radiant Panel Single Specimen Report

Standard

: EN ISO 9239-1:2010

Laboratory

: TÜV Rheinland Nederland B.V.

Sponsor

: TUV Rheinland Shanghai Co 89209169

Date of test

: Feb. 01 2016

Specimen description

: OSB MT16-89079.01

Test name

: Prod # 1 DAFRPFILES/16020001.CSV

File name Test number in series

Flux calibration file name

: C:: FRPSOFT2.9A\CALIB\FLX16001.CSV

Thickness (mm)

Density (kg/m³)

Test duration

2 12 minutes 12 seconds (732 s)

Substrate used?

Yes

Substrate

: Calcium silicate

Fixing method Conditioned? Conditioning temp. (°C)

Conditioning RH (%)

none : Yes : 23 : 50

### Test Results

Time to ignition Time to flameout : 2 minutes 05 seconds (125 s)

; 12 minutes (99 seconds (729 s)

Extent of burning (mm)

: 100 ; >= [0.9

Critical flux at extinguishment (kW/m²) HF-10 (kW/m²)

10.70

HF-20 (kW/m²)

: Not calculated (test duration < 20 minutes)

: Not calculated (test duration < 30 minutes)

HF-30 (kW/m3)

: 100

Flame spread at 10 minutes (mm)

Flame spread at 20 minutes (mm)

: Not measured

Flame spread at 30 minutes (mm)

: Not measured

Peak light attenuation (%)

: 16.56

Time to peak light attenuation

; 5 minutes 06 seconds (306 s)

Total integrated smoke (%.min)

: 92.45

; 51

Potential classification Smoke production classification : A2(ff)/B(ff)

These results relate only to the behaviors of the specimens of the product under the particular canditions of the sext, they are not intended to be the sole criterion for assessing the patential the learned of the product in tise.

Date 02/02/2016

Project number 89209169

Report number 89209169.01br

**Article** 


Luxury Vinyl Tile, OSB

Page 5/12





Report produced with the Fire Testing Technology Fit Pisch software

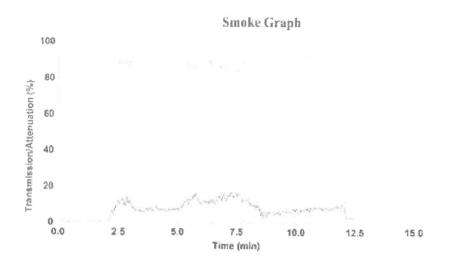

Test name: Cross #3

File name : D:\AFRPFILES\16020005.CSV

### Rake Results

Position (num) Time (s) Flux (kW/m²) Qsb (MJ/m²) Position (mm) Time (s) Flux (kW/m²) Qsb (MJ/m²) 374 11.3 4,233 3.6 1.10 10.3 3.0 160 9.9 2.5 610 660 260 710 1.8 310 1.5 360 6.2 810 1.4 410 860 910 460

### Comments

Specimen extinguished naturally,

These results relate only to the behaviour of the specimens of the produce under the particular conditions of the test; they are not intended to be the sole criterion for assessing the potential fire hazard of the product in use

Date 02/02/2016

page 2

Project number 89209169

> Report number 89209169.01br

Article Luxury Vinyl Tile, OSB

Page 10/12





Report produced with the Pire Testing Technology FRPSoft software

Smoke Graph

100

80

60

40

20

0 0 2.5 5.0 7.5 10.0 12.5 15.0 Time (min)

Test name: Prod#1

File name : D:/FRPFILES/16020001.CSV

### Rake Results

Position (mm)	Time (s)	Flux (kW/m²)	$Qsb \; (MJ/m^{2})$	Position (mm)	Time (s)	Flux (kW/m²)	Qsb (MJ/m²)
60	256	11.3	2.898	510	-	3.6	Ana
140		10.5	9	560		3.0	
160	8	9.9		610		2.5	120
210	-	9.1	81	660	-	2.2	~
260	-	B.1	-	710	+	1.8	_
310	1	7.2	-	760	200	1.6	727
36D	-	6.2		810	23	1.4	
410	1.0	5.3		860		1.2	
460		4.4	-	910		1.3	

### Comments

Specimen extinguished naturally,

These results relate only to the behaviour of the specimens of the product under the particular conditions of the test, they are not intended to be the sofe concrine for assessing the potential for begand of the product in use.

Date 02/02/2016

Project number 89209169

раде 3

Report number 89209169.01br

Article Luxury Vinyl Tile, OSB

Page 6/12





Report produced with the Line Testing Technology FRPSoft software

Date 02/02/2016

Project number 89209169

> Report number 89209169.01br

Article

Luxury Vinyl Tile, OSB

Page 7/12

### Flooring Radiant Panel Single Specimen Report

Standard :: EN ISO 9239-1:2010

Laboratory TÜV Rheinland Nederland B.V.

Sponsor : TUV Rheinland Shanghai Co 89209169

Date of test : Feb. 01 2016

Specimen description : OSB MT16-89079.01

Test name : Cross #2

File name DAFRPFILES\16020002.CSV

Test number in series ; 4

Flux calibration file name : CAFRPSOFT2.9A\CALIB\FLX1600LCSV

Thickness (mm) : Density (kg/m²) :

Test duration 12 minutes 10 seconds (730 s)

Substrate used? : Yes

Substrate : Calcium silicate

Fixing method ; none
Conditioned? ; Yes
Conditioning temp. (°C) ; 23
Conditioning RH (%) ; 50

### Test Results

Time to ignition 2 minutes 03 seconds (123 s) Time to flameout 12 minutes 08 seconds (728 s)

Extent of burning (mm) : 100 Critical flux at extinguishment (kW/m<sup>2</sup>) : >= 10.9 HF-10 (kW/m<sup>2</sup>) : 10.70

HF-20 (kW/m²) : Not calculated (test duration ≤ 20 minutes) HF-30 (kW/m²) : Not calculated (test duration ≤ 30 minutes)

Flame spread at 10 minutes (mm) : 100

Flame spread at 20 minutes (mm) : Not measured Flame spread at 30 minutes (mm) : Not measured Peak light attenuation (%) : 16.53

Time to peak light attenuation 7 minutes 13 seconds (433 s)

Total integrated smoke (%.min) 94.98

Potential classification : A2(fl)/B(fl)


Smoke production classification : s1

These results relate only to the behaviour of the specimens of the purchast taider the particular conditions of the test, they are not intended to be the safe criterion for assessing the potential fire hazard of the product in use.





Report produced with the Fire Teering Technology I'RPSoft software

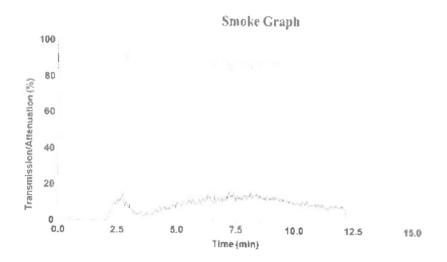

Test name : Cross #2

File name : D/VFRPFILES/16020002.CSV

### Rake Results

Position (mm) Time (s) Flux (kW/m²) Qsb (MEm²) Position (mm) Time (s) Flux (kW/m²) Qsb (MEm²) 60 440 LLJ 4.980510 3.6 110 10.5 3.0 160 9.9 2.5 610 210 9.1 660 260 710 1.8 310 760 1.6 1.4 1.2 6.2 360 410 860 910 5.3 460

### Comments

Specimen extinguished naturally,

These assults relate only to the behaviour of the specimens of the product under the posticular conditions of the test, they are not intended to be also sale criterion for massissing the potential fire hazard of the product in use.

Date 02/02/2016

Project number 89209169

Report number 89209169.01br

Article Luxury Vinyl Tile, OSB

**Page** 8/12





Report produced with the Fire Testing Technology FRPSoft software

Date 02/02/2016

Dige 1

Project number 89209169

Report number 89209169.01br

**Article** 

Luxury Vinyl Tile, OSB

Page 9/12

### Flooring Radiant Panel Single Specimen Report

Standard

: EN ISO 9239-1:2010

Laboratory

; TÜV Rheinland Nederland B.V.

Sponsor

: TUV Rheinland Shanghai Co 89209169

Date of test

: Feb. 01 2016

Specimen description

: OSB MT16-89079.01

Test name

: Cross #3

File name

Test number in series

: DAFRPFILES/16020005,CSV

Flux calibration file name

: CAFRPSOFT2.9AACALIBAFLX16001.CSV

Thickness (mm)

Density (kg/m<sup>3</sup>)

Test duration

12 minutes 26 seconds (746 s)

Substrate used?

· Yes

Substrate

: Calcium silicate

Fixing method

: none

Conditioned?

: Yes

Conditioning temp. (°C)

: 23

Conditioning RH (%)

: 50

### Test Results

Time to ignition Time to flameout

2 minutes 04 seconds (124 s)

: 12 minutes 22 seconds (742 s)

Extent of burning (mm)

: 90

Critical flux at extinguishment (kW/m²)  $HF-10 (kW/m^2)$ 

: >= 10.910.86

HF-20 (kW/m²)

Not calculated (test duration < 20 minutes)

HF-30 (kW/m²)

Not calculated (test duration < 30 minutes)

Flame spread at 10 minutes (mm)

901

Flame spread at 20 minutes (nun)

: Not measured

Flame spread at 30 minutes (mm)

: Not measured

Peak light attenuation (%)

: 17.44

: 7 minutes (420 s)

Time to peak light attenuation

: 91.57

Total integrated smoke (% min)

: A2(f)/B(f)

Potential classification Smoke production classification

: 51

These results relate only to the behaviour of the specimens of the product under the particular conditions of the test, they are not intended to be the sale criterion for assessing the potential fire lorgard of the product in use.





Report produced with the Fire Testing Technology J-RPSed software

**Date** 02/02/2016

brins I

Project number 89209169

Report number 89209169.01br

Article

Luxury Vinyl Tile, OSB

Page 11/12

### Flooring Radiant Panel Single Specimen Report

Standard EN ISO 9239-1:2010

Laboratory TÜV Rheinland Nederland B.V.

Sponsor TUV Rheinland Shanghai Co 89209169

Date of test Ecb. 01 2016

Specimen description : OSB MT16-89079.01

 Test name
 : Cross # 4

 File name
 : D∴FRPFILES\16020006.CSV

Test number in series : 4

Flux calibration file name : CAFRPSOFT2.9AACALHBELX16001,CSV

Thickness (mm) Density (kg/m³)

Test duration 12 minutes 21 seconds (741 s)

Substrate used? Yes

Substrate : Calcium silicate Fixing method : None (loose laid)

Conditioned? : No Conditioning temp. (°C) : N/A Conditioning RH (%) : N/A

### **Test Results**

Time to ignition (2 minutes 03 seconds (123 s) Time to flameout (12 minutes 19 seconds (739 s)

Extent of burning (mm)

Critical flux at extinguishment (kW/m²) : >= 10.9HF-10 (kW/m²) : 10.86

HF-20 (kW/m²) : Not calculated (test duration < 20 minutes) HF-30 (kW/m²) : Not calculated (test duration < 30 minutes)

:90

Flame spread at 10 minutes (mm) : 90

Flame spread at 20 minutes (mm) : Not measured Flame spread at 30 minutes (mm) : Not measured Peak light attenuation (%) : 20.34

Time to peak light attenuation : 6 minutes 15 seconds (375 s)

Total integrated smoke (%.min) : 99.91

Potential classification : A2(fl)/B(fl)


Smoke production classification : s1

These results relate only to the behaviour of the specimens of the product under the particular conditions of the test; they are not intended to be the soft criterion for assessing the potential fire hazard of the product in use.





Report produced with the Fire Testing Technology FRPSedt software

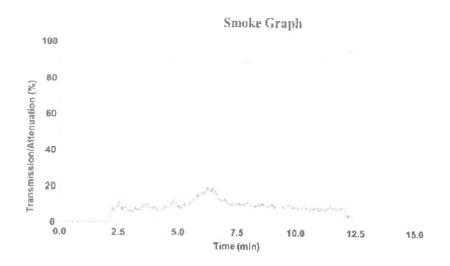

Test name : Cross # 4

File name : D:\FRPFILES\16020006.CSV

### Rake Results

Passition (mm)	Time (s)	Flux (kW/m²)	$Qsb \; (MJ/m^2)$	Pesition (mm)	Time (s)	Flux (kW/m²)	Qsh (MJ/rn²)
60	372	13,3	4.211	310		3.6	1200
010		10.5		560		3.0	-
1.60		99		610		2.5	
210	-	9.1	-	660		2.2	
260	-	8.1	4	710	-	1.8	
310	0.80	7.2	14	760		1.6	
360		6.2		810		1.4	-
410		5.3		860	7.0	1.2	
460		4,4		910		1.1	

### Comments

Specimen extinguished naturally,

These results relate only to the behaviour of the specimens of the product under the particular conditions of the ics; they are not intended to be the sale criterion for assessing the patential for hazard of the product in use

Date 02/02/2016

Project number 89209169

> Report number 89209169.01br

Article Luxury Vinyl Tile, OSB

Page 12/12



### Test Report Number:150831008SHF-BP-1

Original Report Date: October 12, 2015

### Applicant Name:



### Sample Description:

Product: PVC Floor Tile

Model: 18"\*36"\*3.0mm\*0.5mm Samples Quantity: 15 pieces

Sample ID: S150831008SHF-001~058, 105

Date Received: 2015-08-31

Date Test Conducted: 2015-09-01~2015-10-12

### **Tests Conducted:**

Test Methods: See next pages.

### **Conclusion:**

For details refer to attached page(s).

The conclusions of this test report may not be used as part of the requirements for Intertek product certification. Authority to Mark must be issued for a product to become certified.

Should you have any queries about the test report, please contact:

Approved by: Checked by: Prepared by:

Sally Xie Jodie Zhou

Assistant manager Technical Supervisor Senior Technical Supervisor

Tel: 021-61136116 Fax: 021-61189921 Website: www.intertek.com

Report Template Revision Date: 1st January 2015





Report Number:150831008SHF-BP-1

### Test Items, Method and Results:

Table 1 ASTM F1700-13a

Test Item	Test Method	Test Result	Test Requirement	Verdict
Size	ASTM F2055-10	Claimed Length: 914.4mm Width: 457.2mm Tested Length: 915.1mm Width: 457.3mm	A tolerance of ±0.4mm/305mm	Pass
Thickness	ASTM F386-11	Claimed value: 3.0mm Average: 3.01mm Min.: 3.00mm Max.: 3.02mm	A tolerance of ±0.13mm	Pass
Thickness of wear layer	ASTM F410- 08(2013)	0.51mm	Commercial, 0.5mm min	Pass
Squareness	ASTM F2055-10	Short edge Max.: 0.02mm/457mm Long edge Max.: 0.02mm/600mm	≤0.25mm/305mm	Pass
Residual indentation	ASTM F1914- 07(2011)	Average: 1.4% Max. : 1.7%	Average ≤ 8%  Max ≤ 10%	Pass
Flexibility	ASTM F137- 08(2013)	No crack when using Φ25.4mm mandrel	No crack or break when using Φ25.4mm mandrel	Pass
Dimension Stability	ASTM F2199- 09(2014)	MD Max.: -0.21mm/305mm CMD Max.: -0.31mm/305mm	≤0.51mm/305mm	Pass
Resistance to Chemicals	ASTM F925-13	See Appendix B for details	No more than a slight change in surface dulling, surface attack or staining	Pass
Resistance to Heat	ASTM F1514- 03(2013)	ΔE*= 0.47	ΔE* shall not greater than 8.0 after 7 days exposure to 70 °C	Pass
Resistance to Light	ASTM F1515- 03(2008)	ΔE*= 1.42	ΔE* shall not greater than 8.0 after a 300h exposure	Pass

Intertek Testing Services Ltd., Shanghai No.7 Building, No. 6958 Daye Road, Fengxian District, Shanghai Tel: 021-61136116 Fax: 021-61189921 Webs

Website: www.intertek.com

Report Template Revision Date: 1st January 2015





### Report Number:150831008SHF-BP-1

### Table 2 Other Tests

Test Item	Test Method	Test Condition	Test Re	esult		
Coefficient of friction	ASTM D2394- 05(2011)	Static Dry Static Wet Dynamic Dry Dynamic Wet	MD	0.59 0.68 0.47 0.57	CMD	0.57 0.69 0.49 0.58
Coefficient of friction	ASTM C1028-07 e1	Dry Wet	0.75 0.70			
Castor Chair	NALFA/ANSI LF-11	25000 revolutions 35000 revolutions		ious dam		
Wear Resistance	ASTM D4060-14	CS-17 wheel 1kg load, 1000 revolutions	37.8 m	g		
Static Load Resistance	ASTM F970-07(2011)	Load: 250 lb	Residua	al indenta	ntion: 0.0	2 mm
Fungi Resistance <sup>1</sup>	ASTM G21-09	28 days, >85%RH, 28°C  Test organisms: Aspergillus niger ATCC 9642, Penicillium pinophilum ATCC 11797, Chaetomium globosum ATCC 6205, Aureobasidium pullulans ATCC 15233 and Gliocladium virens ATCC 9645.	Rating	0, no gro	wth	
Formaldehyde Content <sup>2</sup>	ASTM D6007-14	Chamber type: 0.225 m³ stainless steel chamber Climatic conditions: 25° C, 50% R.H. Air exchange rate: 0.5 h⁻¹ Loading factor: 0.95 m²/m³	Not det		0.02 ppm	1

### Note:

- 1. The test was conducted at the external qualified facility, located at Guangzhou. Rating evaluation: Observed Growth on Specimens
  - 0 None
  - 1 Traces of growth (less than 10 %)
  - 2 Light growth (10 to 30 %)
  - 3 Medium growth (30 to 60 %)
  - 4 Heavy growth (60 % to complete coverage)
- 2. The test sample was 5.0mm type. The material was the same as 3.0mm type claimed by the applicant.

Intertek Testing Services Ltd., Shanghai No.7 Building, No. 6958 Daye Road, Fengxian District, Shanghai

Tel: 021-61136116 Fax: 021-61189921 Website: <u>www.intertek.com</u>

Report Template Revision Date: 1st January 2015


Page 3 of 6





Report Number:150831008SHF-BP-1

### Appendix A: Sample photos

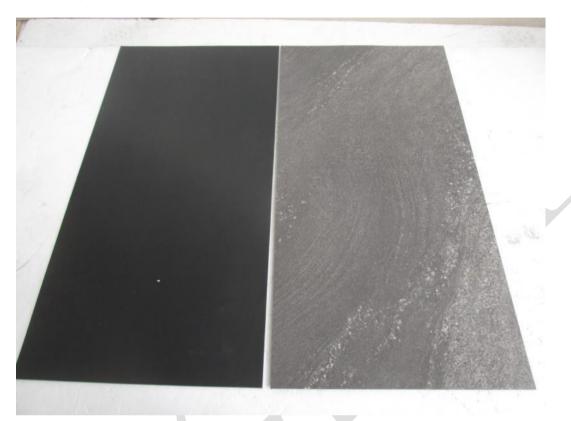

Sample received







### Report Number:150831008SHF-BP-1



Resistance to light

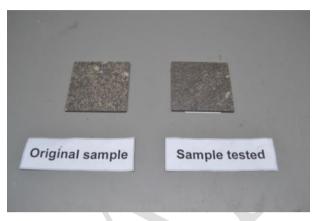

Resistance to heat

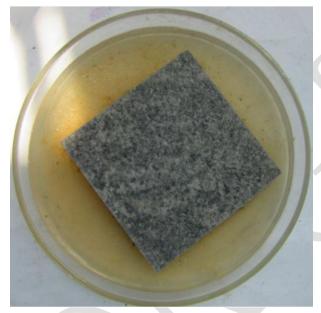

Fungi Resistance (after 28 days)

Website: www.intertek.com

Page 5 of 6

Report Template Revision Date: 1st January 2015





Report Number: 150831008SHF-BP-1

### **Appendix B Test result of Resistance to Chemicals**

Regent		Rating	
Regent	Surface attack	Color change	Surface dulling
White vinegar (5% acetic acid)	0	0	0
Rubbing alcohol (70% isopropyl alcohol)	0	0	0
White mineral oil (medicinal grade)	0	0	0
Sodium hydroxide solution (5% NaOH)	0	0	0
Hydrochloric acid solution (5% HCl)	0	0	0
Sulfuric acid solution (5% H <sub>2</sub> SO <sub>4</sub> )	0	0	0
Household ammonia solution (5% NH <sub>4</sub> OH)	0	0	0
Household bleach (5.25% NaOCI)	0	0	0
Olive oil (light)	0	0	0
Kerozene (K1)	0	0	0
Unleaded gasoline (regular grade)	0	0	0
Phenol (5% active phenol)	0	0	0

According to ASTM F925-13, rating 0-3 represents:

0 = no change; 1 = slight change; 2 = moderate change; 3 = severe change.

Surface Dulling - Indicating that the specimen suffered from a loss of gloss,

Color Change - Indicating that the specimen suffered discoloration or bleaching, or both, and

Surface Attack - Indicating that the specimen suffered surface damage such as softening, warping, swelling, blistering, peeling, raised or rough area.

The End of Report

Page 6 of 6

This report is for the exclusive use of Intertek's Client and is provided pursuant to the agreement between Intertek and its Client. Intertek's responsibility and liability are limited to the terms and conditions of the agreement. Intertek assumes no liability to any party, other than to the Client in accordance with the agreement, for any loss, expense or damage occasioned by the use of this report. Only the Client is authorized to permit copying or distribution of this report and then only in its entirety. Any use of the Intertek name or one of its marks for the sale or advertisement of the tested material, product or service must first be approved in writing by Intertek. The observations and test results in this report are relevant only to the sample tested. This report by itself does not imply that the material, product, or service is or has ever been under an Intertek certification program.

Intertek Testing Services Ltd., Shanghai No.7 Building, No. 6958 Daye Road, Fengxian District, Shanghai Tel: 021-61136116 Fax: 021-61189921 Webs

Website: www.intertek.com

Report Template Revision Date: 1st January 2015



Prüfbericht-Nr.: Auftrags-Nr.: 15076111 001 154063673

Test Report No.: Order No.: Seite 1 von 14 Page 1 of 14

Kunden-Referenz-Nr.: N/A Auftragsdatum: 21.08.2014 Client Reference No : Order date:

Auftraggeber:

Client:

**<b>⊗**L∧LU?

Prüfgegenstand:

PVC flooring

Test item:

Luxury vinyl tile(LVT)

Bezeichnung / Typ-Nr.: Form: Tile

Identification / Type No.:

Total thickness: 2.0 mm - 5.0 mm; Mass per unit area: 3.853 kg/m<sup>2</sup> - 10.03 kg/m<sup>2</sup>

Auftrags-Inhalt: Order content:

Initial type testing report

Prüfgrundlage:

EN 14041:2004+AC:2005+AC:2006

Test specification:

Bodenbelag - Anforderung und Prüfung

Flooring - Requirements and Test

Wareneingangsdatum: 11.09.2014

Date of receipt:

Prüfmuster-Nr.: Test sample No .: A0000154063673-30

Prüfzeitraum:

11.09.2014 - 21.10.2014

Testing period:

Ort der Prüfung: Place of testing:

TUV Rheinland: Shanghai, Nuremberg and Enschede

Prüflaboratorium: Testing laboratory:

TÜV Rheinland (Shanghai) Co., Ltd.

Prüfergebnis\*: Test result\*:

Pass

geprüft von I tested by:

kontrolliert von I reviewed by:

Daniel Chen/PE 2014,11.10 Name / Stellung

Datum Date

Name / Position

Signature

2016.11.10 Datum

Date

Xin Zhang / Reviewer

Name / Stellung Name / Position

Unterschrift Signature

Sonstiges I Other.

Reaction to fire is tested on TÜV Rheinland Nederland B.V. with Notified Body number 0336\*.

Formaldehyd Emission is tested on TÜV Rheinland LGA Products GmbH with Notified Body number 0197\*.

Attachment 1: Report for Reaction to fire: C-89206631-1.

Attachment 2: Report for Formaldehyd Emission: 21223510(3124761).

Attachment 3: Report for PCP: 0154063673a 001.

\*To be used for CE marking only.

Zustand des Prüfgegenstandes bei Anlieferung: Condition of the test item at delivery:

Prüfmuster vollständig und unbeschädigt Test item complete and undamaged

\* Legende: 1 = sehr gut 2 = gut

P(ass) = entspricht o.g. Prüfgrundlage(n)

3 = befriedigend F(ail) = entspricht nicht o.g. Prüfgrundlage(n)

4 = ausreichend N/A = nicht anwendbar

5 = mangelhaft N/T = nicht getestet

Legend:

1 = very good P(ass) = passed a.m. test specification(s)

2 = good

3 = satisfactory F(ail) = failed a.m. test specification(s) 4 = sufficient N/A = not applicable

5 = poorN/T = not tested

Dieser Prüfbericht bezieht sich nur auf das o.g. Prüfmuster und darf ohne Genehmigung der Prüfstelle nicht auszugsweise vervielfältigt werden. Dieser Bericht berechtigt nicht zur Verwendung eines Prüfzeichens.

This test report only relates to the a. m. test sample. Without permission of the test center this test report is not permitted to be duplicated in extracts. This test report does not entitle to carry any test mark.





Prüfbericht-Nr.: 15076111 001

Test Report No.:

Seite 2 von 14 Page 2 of 14

### Liste der verwendeten Prüfmittel List of used test equipment

Prüfmittel Test equipment	Prüfmittel-Nr. / ID-Nr. Equipment No. / ID-No.	Nächste Kalibrierung Next calibration
Micrometer	L068	01.07.2015
Digital Caliper	B0543	09.06.2015
Caliper	L900	01.11.2017
Linear-axis Test Stand	FN-56	01.10.2015
GC-MS	CHEM06	11.06.2016
ELECTRONIC BALANCE	CHEM175	10.07.2015
Flooring Radiant Panel Test Apparatus	Tui 107000060(Enschede)	14.10.2015
Sampling pump Desaga no. 12	06878(Nuremberg)	04.2015
Thermo-Hygrometer Lufft-1	07887(Nuremberg)	08.2015
Spektral-Photometer(UV-VIS) Perkin-Elmer, Lambda2	06911(Nuremberg)	02.2015
Test chamber no. 22	06949(Nuremberg)	Acc. Internal validation program





Prüfbericht-Nr.: 15076111 001

Test Report No .:

Seite 3 von 14 Page 3 of 14

### Produktbeschreibung Product description

1	Produktdetails Product details	PVC flooring Luxury vinyl tile(LVT)
2	Maße / Gewicht Dimensions / Weight	Total Thickness: 2.0 mm - 5.0 mm Mass per unit area : 3.853 kg/m² - 10.03 kg/m²
3	Bedienelemente Operating elements	N/A
4	Ausstattung / Zubehör Equipment / Accessories	N/A
5	Verwendete Materialien Used materials	PVC
6	Sonstiges Other	N/A
	Face	Back
	Blank	Blank





	ericht-Nr.: 15076111 001 leport No.:		eite 4 von Page 4 of	
Absatz	EN 14041:2004+AC:2005+AC:2006	Messergebnisse - Bemerkungen	Bewertu	ng
Clause	Anforderungen - Prüfungen / Requirements - Tests	Measuring results - Remarks	Evaluati	on
1	Scope This document specifies the health, safety and energy saving requirements for:  resilient floor coverings manufactured from plastics, linoleum, cork or rubber, excluding loose-laid mats; textile floor coverings, excluding loose-laid mats and rugs; laminate floor coverings; floor panels for loose-laying. It also specifies procedures for testing for the evaluation of conformity of the products and the requirements for marking and labeling. The products are intended for use as floor coverings within a building or externally, according to the manufacturer's specifications. This document does not apply to floor coverings containing asbestos. This document does not specify requirements unrelated to health, safety and energy saving, which are covered in the separate European Standards for these products, listed in Annex A. To perform correctly, products covered by this standard require correct installation and maintenance. This document does not, however, cover installation or maintenance, but does give advice on minimizing slip hazards.	The specimen is PVC floor coverings which are in the scope of the standard.	F N/A	
2	Normative references  → See details in EN 14041:2004			
3	Terms and definitions  → See details in EN 14041:2004			
4	Requirements			
4.1	Requirements to fire	See detailed clauses as below	F C	XI III
4.1.1	Specimen preparation and conditioning  Preparation of test specimens shall be as defined in the appropriate fire test standard, except in the case of textile floor coverings where a washing and cleaning procedure similar to that used in practice may be	The specimen preparation and conditioning was done according to the standard EN 13328.	F [	$\mathbf{X}$





	ericht-Nr.: 15076111 001 eport No.:		eite 5 von 14 Page 5 of 14
Absatz	EN 14041:2004+AC:2005+AC:2006	Messergebnisse - Bemerkungen	Bewertung
Clause	Anforderungen - Prüfungen / Requirements - Tests	Measuring results - Remarks	Evaluation
	required to verify the durability of surface fire retardant treatments (see 4.1.3).  The specimens shall be tested on one of the two standard substrates specified for floorings in EN 13238:2001 according to the intended end use.  The composition of the product, including the presence of any fire retardant additive (if applicable), shall be declared by the manufacturer prior to type testing.		
4.1.2	Application rules  If the specimens are tested using an adhesive, the test result is valid for the tested floor covering with that adhesive, or the generic adhesive type, in end use conditions.  If the specimens are tested without using an adhesive, the test result is valid for the tested floor covering with and without using adhesives in end use conditions		P ⊠ F □ N/A □ N/T □
4.1.3	<ul> <li>Durability aspects</li> <li>Where required, textile floor coverings specimens to be tested shall be subjected to the laboratory spray extraction cleaning procedure according to ISO 11379 with the following modifications.</li> <li>Clean the test specimens three times, with an interval of 2 h 15 min between cycles, each cleaning cycle consisting of two strokes: <ul> <li>for the first stroke use the spray extraction machine with simultaneous spray and extraction;</li> <li>for the second stroke operate the machine only as an extraction machine.</li> </ul> </li> <li>Carry out the first cleaning cycle using the reference cleaning solution at ambient temperature (25 °C 10 °C) and the second and third cleaning cycle with water at ambient temperature without any addition of chemicals.</li> </ul>	PVC flooring is not applicable, and this test is required for textile floor covering only.	P ⊠ F □ N/A □ N/T □
4.1.4	Classification  If a claim for reaction to fire performance is made, the floor covering (except as provided for below) shall be tested and classified according to the requirements of EN 13501-1:2002 and the resulting class and subclass (as appropriate to the class itself) shall be declared.  If it is decided to make no claim for reaction to fire performance, i.e. it is decided to place a product or family of products on the market as Class Ffl, no testing	Classification: B <sub>fl</sub> -s1*  *Details see the following reports: Test report of 2 mm products: TRN Report: 89206631.02br** Test report of 5 mm products: TRN Report: 89206631.01br**	P 🗵 F 🗆 N/A 🗆 N/T 🗆





Absatz	EN 14041	:2004+AC:2005+AC:200	6	Messergebniss	e - Bemerkungen	Bewertu
Clause	Anforderungen -	Prüfungen / Requirement	s - Tests		sults - Remarks	Evaluati
89-800 e h	is required for this pr	oduct of family of produc	ets.	Classification		
	identified in the table testing (CWFT) in the	n Tables 1, 2 and 3, in thes, are classified without to classes shown and do these end uses and class	further not require	**Remark: The performed in 7		
	final approval by the Construction. Users of this standar published EC Decision verify the details. An	s of Tables 1, 2 and 3 and Standing Committee for Standing Committee for Standing Committee for Standing Standi	r to the available, to these	Nederland B.V Body number	. with Notified	
	Table 1 – Classes	of reaction to fire for laminate	floor coverings, o	classified without fo	urther testing	3573 - 357
	Floor covering type <sup>1</sup>	Product detail	Minimum density (kg/m³)	Minimum overal thickness (mm)		
	Laminate floor coverings	Laminate floor coverings manufactured in accordance with EN 13329:2000	800	6,5	E	
		ver any wood based substrate of at I		or any substrate of at le	east Class A2-s1,d0.	
	Floor covering type		E	, classified witho EN product standard	ut further testing Class <sup>3</sup> Floorings	
	Floor covering type		E	EN product		
	Floor covering type  Non-FR machine-macarpet tiles <sup>2</sup>	1	d pile	EN product standard	Class <sup>3</sup> Floorings	
	Non-FR machine-ma carpet tiles <sup>2</sup> Non-FR needled text	de wall-to-wall pile carpets and	d pile	EN product standard	Class <sup>3</sup> Floorings	





Prüfbericht-Nr.: 15076111 001 Test Report No.: Seite 7 vo Page 7 c			
Absatz	EN 14041:2004+AC:2005+AC:2006	Messergebnisse - Bemerkungen	Bewertung
Clause	Anforderungen - Prüfungen / Requirements - Tests	Measuring results - Remarks	Evaluation

7103412	LN 14041.20041AO.				IVICSS	ergebriisse - Ber	nerkungen	Dewe	ertung
Clause	Anforderungen - Prüfungen /	Requireme	nts - Tests		Mea	suring results -	Remarks	Evalu	uation
	Table 3 – Classes of reaction to	o fire for resilie	ent floor cove	erings	s, classif	ied without further	testing		
	Floor covering type <sup>1</sup>	EN product standard	Minimum mass (kg/m²)	n	ximum nass g/m²)	Minimum overall thickness (mm)	Class <sup>2</sup> Floorings		
	Plain & decorative Linoleum	EN 548	2,3		4,9	2	E <sub>fL</sub>		
	Homogeneous and heterogeneous polyvinyl chloride floor coverings	EN 649	2,3		3,9	1,5	En		
	Polyvinyl chloride floor coverings with foam layer	EN 651	1,7		5,4	2	E <sub>fL</sub>		
	Polyvinyl chloride floor covering with cork-based backing	EN 652	3,4		3,7	3,2	E <sub>fL</sub>		
	Expanded (cushioned) polyvinyl chloride floor coverings	EN 653	1,0		2,8	1,1	E <sub>fL</sub>	i i	
	Semi-flexible polyvinyl chloride tiles	EN 654	4,2		5,0	2	E <sub>fL</sub>		
	Linoleum on corkment backing	EN 687	2,9		5,3	2,5	Eft		
	Homogeneous and heterogeneous smooth rubber floor coverings with foam backing	EN 1816	3,4		4,3	4	E <sub>fL</sub>		
	Homogeneous and heterogeneous smooth rubber floor coverings	EN 1817	3,0		6,0	1,8	E <sub>fL</sub>		
	Homogeneous and heterogeneous relief rubber floor coverings	EN 12199	4,6		6,7	2,5	E <sub>fL</sub>		
	<sup>1</sup> Floor covering loose laid over any wood b <sup>2</sup> Class as provided for in Table 2 in the An			D-s2,d	0 or any s	substrate of at least Cla	ess A2-s1,d0.		
4.2	Content of pentachloropheno	I (PCP)			Resul	t: <0.5 ppm*		Р	×
	Resilient, textile and laminate flocontain PCP or a derivative ther the production process of the primaterials. In cases where verification to less than 5 ppm in the affected by treatment, this required considered to be met. For lamin method CEN/TR 148232, for texting the method CEN/TS 144943 shall be coverings verification is not required.	reof as a concoduct or of incoduct or of incoduct or of incoduction is required parts of the rement shall ate floor covortile floor covortile floor covortile state.	nponent in ts raw uired, if the e product be rerings the verings the		report	ls see the follow : 63673a 001	ving	F N/A N/T	
	Formaldehyde emission  When formaldehyde-containing added to the product as a part of the product shall be tested and collasses: E1 or E2, as specified in	f the produc classified into	tion proces o one of tw	10	*Detai	:: Class E1* ls see the follow 510(3124761) *		P F N/A N/T	





	ericht-Nr.: 15076111 00 eport No.:	1			eite 8 vo Page 8 d	
Absatz	EN 14041:2004+A	C:2005+AC:2006		Messergebnisse - Bemerkungen	Bewer	tung
Clause	Anforderungen - Prüfunge	n / Requirements -	Tests	Measuring results - Remarks	Evalua	ation
	The test requirement does not which no formaldehyde-contain during production or post-proneed not be classified, but madeclared as E1.  NOTE:  Products of class E1 can be a indoor air concentration great of formaldehyde.	nining materials were duction processing ay, without any test as were without causing used without causing the cau	re added . These ing, be	**Remark: The test was performed in TÜV Rheinland LGA Products GmbH with Notified Body number 0197.		
		Table 4 – Formaldel	yde class	E1		
		Test method	Requirer	nent		
	Initial type testing *	ENV 717-1	Release:	≤ 0,124 mg/m³		
	Factory production control	ENV 717-1	Release:	≤ 0,124 mg/m³	f	
	v astery productions contact	EN 717-2	Release :	≤ 3,5 mg/m²h		
	<sup>a</sup> For established products, initial typeither from factory production control	or from external inspectio	n.	sis of existing data with EN 717-2 testing,		
	Table 5 – Formaldehyde class E2					
		Test method	est method Requirement			
	Initial type testing	ENV 717-1		0,124 mg/m <sup>3</sup>		
		EN 717-2	-	$3.5 \text{ mg/m}^2\text{h to} ≤ 8 \text{ mg/m}^2\text{h}$		
	Factory production control	ENV 717-1	Release	0,124 mg/m <sup>3</sup>		
		EN 717-2	Release >	$3,5 \text{ mg/m}^2\text{h to} \le 8 \text{ mg/m}^2\text{h}$		
4.4	Water-tightness Where required, resilient floor requirements of EN 13553.	coverings shall me	eet the	The specimen is under water- tightness condition for 3 hours according to EN 13553.  Remark:  1. The test according to EN 13553 is not applicable for product in tiles form. The test results are only for	P F N/A N/T	
				reference.  2. The test was performed for 3 hour with water to a level of 200mm above the surface of the specimen.  3. The test was performed with the water during 15 °C to 25 °C.		





	ericht-Nr.: 15076111 001 Deport No.:		eite 9 von 14 Page 9 of 14	
Absatz	EN 14041:2004+AC:2005+AC:2006	Messergebnisse - Bemerkungen	Bewertung	g
Clause	Anforderungen - Prüfungen / Requirements - Tests	Measuring results - Remarks	Evaluation	n
		4. The test was applied by client indecently.		
4.5	Slip resistance	See detailed clauses as below.	P 🗵 N/A 🗆 N/T	
4.5.1	Classification  If a claim for slip resistance is made, the floor covering intended to be used in dry and non-contaminated conditions shall have a dynamic coefficient of friction of ≥ 0, 30 when tested ex-factory under dry conditions in accordance with EN 13893 and shall be declared as technical class DS.  Although such floors may be subjected to occasional spillage and wet cleaning, the manufacturer does not guarantee the performance under these conditions.  If no claim for slip resistance is made, the floor coverings for which no performance has been determined shall be declared as technical class NPD.	Longitudinal dynamic coefficient of friction:  μ <sub>mean</sub> =0.35 Horizontal dynamic coefficient of friction μ <sub>mean</sub> =0.33 μ <sub>final</sub> =0.33 Result: Class DS  Remark:  1. The test was performed in dry condition.  2. The floor covering intended to be used in dry and non-contaminated conditions shall have a dynamic coefficient of friction of ≥0, 30 when tested ex-factory under dry conditions in accordance with EN 13893 and shall be declared as technical class DS.	P K F N/A N/T	
4.5.2	Post-installation care  The floor covering shall be treated, cleaned and maintained in accordance with the manufacturer's instructions.  NOTE:  Slip resistance characteristics on an installed floor covering can be affected by its installation, the surface treatment that is given to it when installed, dirt accumulation and its cleaning and maintenance. Guidance on the reduction of slip hazards is given in Annex C.	The manufacturer's instruction provided mentioned the floor covering shall be smooth, flat, dry, clean and solid before post-installation.	P ⊠ F □ N/A □ N/T □	





	ericht-Nr.: 15076111 001 Deport No.:		ite 10 vo age 10	
Absatz	EN 14041:2004+AC:2005+AC:2006	Messergebnisse - Bemerkungen	Bewe	rtung
Clause	Anforderungen - Prüfungen / Requirements - Tests	Measuring results - Remarks	Evalu	ation
4.6	Electrical behaviour (static electricity)	No declaration by the client.	P F N/A N/T	
4.6.1	Applicability  For those floor coverings for which the manufacturer makes a claim for antistatic performance or electrical resistance.		P F N/A N/T	
4.6.2	Requirements		P F N/A N/T	
4.6.2.1	Antistatic floor coverings  The body voltage, measured in accordance with EN 1815 for resilient and laminate floor coverings or ISO 6356 for textile floor coverings, shall not exceed 2,0 kV when tested at 23 °C 1 °C and (25 2) % relative humidity after conditioning the test specimens in the same atmosphere for seven days.		P F N/A N/T	
4.6.2.2	Electrical resistance  ■ Static dissipative floor coverings: The vertical resistance, measured in accordance with EN 1081 for resilient and laminate floor coverings or ISO 10965 for textile floor coverings, shall not exceed $10^9 Ω$ .  ■ Conductive floor coverings: The vertical resistance, measured in accordance with EN 1081 for resilient and laminate floor coverings or ISO 10965 for textile floor coverings, shall not exceed $10^6 Ω$ .	v	P F N/A N/T	
4.6.3	Durability aspects  For textile antistatic floor coverings, a washing and cleaning procedure similar to that used in practice is required where applicable to verify the durability of surface antistatic treatments.  In such cases the specimens to be tested shall be subjected to the laboratory spray extraction cleaning procedure according to ISO 11379 with the following modifications.	PVC flooring is not applicable	P F N/A N/T	





	ericht-Nr.: 15076111 001 Report No.:		te 11 vo	
Absatz	EN 14041:2004+AC:2005+AC:2006	Messergebnisse - Bemerkungen	Bewe	ertung
Clause	Anforderungen - Prüfungen / Requirements - Tests	Measuring results - Remarks	Evalu	ıation
	Clean the test specimens three times, with an interval of 2 h 15 min between cycles, each cleaning cycle consisting of two strokes:  - for the first stroke use the spray extraction machine with simultaneous spray and extraction; - for the second stroke operate the machine only as an extraction machine.  Carry out the first cleaning cycle using the reference cleaning solution at ambient temperature 25 °C 10 °C and the second and third cleaning cycle with water at ambient temperature without any addition of chemicals.			
	After this, the test of 4.6.2 shall be repeated and the requirements met.  NOTE Dirt and application of polymers can affect the antistatic and electrical properties of resilient and laminate floor coverings.			
4.7	Thermal conductivity  When floor coverings are to be installed over an underfloor heating system the design thermal conductivity values given in EN 12524 shall be assumed for design calculation purposes. Alternatively, the thermal resistance measured in accordance with EN 12667 may be used.	No declaration by the client.	P F N/A N/T	  X 
5	Evaluation of conformity	See detailed clauses as below.	P F N/A N/T	
5.1	General  The conformity of floor coverings with the requirements of this standard (including classes) shall be demonstrated by:  — initial type testing;  — Factory production control by the manufacturer, including product assessment (see Annex D).  For the purposes of testing, floor coverings may be grouped into families (see 3.1), where it is considered that the results for a given characteristic from any one product within the family are valid for all other floor coverings within that family.	<ul> <li>ITT: see the relevant clauses of this test report.</li> <li>FPC system is controlled by manufacturer according to AVCP 3 system of CPR.</li> </ul>	P F N/A N/T	





	ericht-Nr.: 15076111 001 Report No.:		ite 12 vo age 12 d	
Absatz	EN 14041:2004+AC:2005+AC:2006	Messergebnisse - Bemerkungen	Bewer	rtung
Clause	Anforderungen - Prüfungen / Requirements - Tests	Measuring results - Remarks	Evalua	ation
5.2	Type testing	See detailed clauses as below.	P F N/A N/T	
5.2.1	Initial type testing  Initial type testing shall be performed to show conformity with this standard. Tests previously performed in accordance with the provisions of this standard (same product, same characteristic(s), test method, sampling procedure, system of attestation of conformity, etc.) may be taken into account. In addition, initial type testing shall be performed at the beginning of the production of a new product type (unless a member of the same family) or at the beginning of a new method of production (where this may affect the stated properties).  Whenever a change occurs in the product, the raw material or supplier of the components, or the production process (subject to the definition of a family), which would change significantly one or more of the characteristics, the type tests shall be repeated for the appropriate characteristic(s).	<ul> <li>Reaction to Fire</li> <li>Emission of Formaldehyde</li> <li>Content of PCP</li> <li>Slipperiness</li> </ul>	P F N/A N/T	
5.2.2	Sampling, testing and compliance criteria  The sample taken for testing shall be representative of the available material. Compliance criteria are specified in Clause 4.  The results of all type tests shall be recorded and held by the manufacturer for at least 5 years.	Samples were taken by manufactory.  Note: The results of all type tests shall be recorded and held by the manufacturer for at least 5 years.	P F N/A N/T	
5.3	Factory production control (FPC)  The manufacturer shall establish, document and maintain an FPC system to ensure that the products placed on the market conform to the stated performance requirements. The FPC system shall consist of procedures, regular inspections and tests and/or assessments and the use of the results to control raw and other incoming materials or components, equipment, the production process and the product. Elements needed for the methods of FPC are given in Annex D.	FPC system is controlled by manufactory according to AVCP 3 system of CPR.	P F N/A N/T	





	Seite 13 von 14         Page 13 of 14					
satz	EN 14041:2004+AC:2005+AC:	2006	Messergebnisse - Bemerkungen	Bewer	tung	
use	Anforderungen - Prüfungen / Requirem	ents - Tests	Measuring results - Remarks	Evalua	ation	
	Marking and labeling  Products which conform to the requirement document shall be clearly and indelibly manufacturer either on their package or or label with the following information:  a) The number and the year of this Eustandard, i.e. EN 14041:2004; b) The manufacturer's or supplier's idec) The product name and batch number code form).  Where the requirements of ZA.3 give the sinformation as this clause, the requirement clause are considered to have been met.	arked by the n an adhesive aropean entification; er (possibly in ame	See CE Marking confirmed by manufactory.	P F N/A N/T		
		PR2013-07-01[1	]			
	EN 14041:2004	+ AC:2005 + AC	:2006			
	Product	Luxury vinyl	tile(LVT)			
	Requirements to fire	Bfl-s1				
	Content of pentachlorophenol(PCP)	<5ppm				
	Formaldehyde emission	E <sub>1</sub>				
	Slipperiness	DS				
Remark: the label will be used as the insert paper in the package, or it will be printed out on the package.  Remark:  [1] Reference number of the Declaration of Performance. It's an identification number for each delivery batch of products and it is uniqueness and continuity between different batches.						



D

ZA

Annex D (normative)

Annex ZA (informative)

**Directives** 

→ See details in EN 14041:2004

→ See details in EN 14041:2004

Factory production control and reaction to fire testing



	rest Report No.:       15076111 001       Seite 14 von Page 14 on Page 1				
Absatz	EN 14041:2004+AC:2005+AC:2006	Messergebnisse - Bemerkungen	Bewertung		
Clause	Anforderungen - Prüfungen / Requirements - Tests	Measuring results - Remarks	Evaluation		
Α	Annex A (informative)  Other European Standards for resilient, textile and laminate floor Coverings  → See details in EN 14041:2004				
В	Annex B (normative)  Analysis of pentachlorophenol in floor coverings  → See details in EN 14041:2004				
С	Annex C (informative)  Guidance on the reduction of slip hazards  → See details in EN 14041:2004				

-END OF THE TEST REPORT-

Clauses of this European Standard addressing essential requirements or other provisions of EU



### Zulassung bauaufsichtliche Allgemeine

Bautechnisches Prüfamt Zulassungsstelle für Bauprodukte und Bauarten

Mitglied der EOTA, der UEAtc und der WFTAO Eine vom Bund und den Ländern gemeinsam getragene Anstalt des öffentlichen Rechts

Datum: Geschäftszeichen:

01.12.2015 II 42-1.156.603-115/15

Zulassungsnummer:

Z-156.603-1587

Antragsteller:

**≫LALU**₹

Geltungsdauer

vom: 1. Dezember 2015

14. April 2020

### Zulassungsgegenstand:

Heterogene PVC Bodenbeläge gemäß DIN EN 14041

"Luxury vinyl tile"

Verwendung in Aufenthaltsräumen mit Nachweis des Emissionsverhaltens Diese allgemeine bauaufsichtliche Zulassung regelt die Verwendbarkeit der unter dem Zulassungsgegenstand genannten Produkte nach der harmonisierten Norm DIN EN 14041 für die

Diese allgemeine bauaufsichtliche Zulassung umfasst fünf Seiten und eine Anlage. Der oben genannte Zulassungsgegenstand wird hiermit allgemein bauaufsichtlich zugelassen.







Allgemelne bauaufsichtliche Zulassung Nr. Z-156.603-1587

Seite 2 von 5 | 1. Dezember 2015

### ALLGEMEINE BESTIMMUNGEN

- \_ des Zulassungsgegenstandes im Sinne der Landesbauordnungen nachgewiesen. Mit der allgemeinen bauaufsichtlichen Zulassung ist die Verwendbarkeit bzw. Anwendbarkeit
- N durch gleichwertige Nachweise anderer Mitgliedstaaten der Europäischen Union belegt werden kann. Dies gilt ggf. auch für im Rahmen des Abkommens über den Europäischen Wirtschaftsraum (EWR) oder anderer bilateraler Abkommen vorgelegte gleichwertige Nachregelungen gestellt werden, ist zu beachten, dass diese Sachkunde und Erfahrung betrauten Personen nach Sofern in der allgemeinen bauaufsichtlichen Zulassung Anforderungen an die besondere Sachkunde und Erfahrung der mit der Herstellung von Bauprodukten und Bauarten g der mit der Herstellung von Bauprodukten und Bauarten den § 17 Abs. 5 Musterbauordnung entsprechenden Länderauch
- ω Die allgemeine bauaufsichtliche Zulassung ersetzt nicht de Bauvorhaben gesetzlich vorgeschriebenen Genehmigungen, ersetzt nicht die für die Durchführung von Zustimmungen und Bescheini-
- 4 dere privater Schutzrechte, erteilt. Die allgemeine bauaufsichtliche Zulassung wird unbeschadet der Rechte Dritter, insbeson-
- O Zulassung an der Verwendungsstelle vorliegen muss. Auf Anforderung sind den beteiligten Behörden Kopien der allgemeinen bauaufsichtlichen Zulassung zur Verfügung zu stellen. Verfügung nersteller und Vertreiber des Zulassungsgegenstandes haben, unbeschadet weiter gehender Regelungen in den "Besonderen Bestimmungen", dem Verwender bzw. Anwender des Zulassungsgegenstandes Kopien der allnamainen hausenderichten zur Anwender Zulassungsgegenstandes Kopien der allgemeinen bauaufsichtlichen Zulassung zur Ŋ stellen und darauf hinzuweisen, dass die allgemeine bauaufsichtliche
- auszugsweise Veröffentlichung bedarf der Zustimmung des Deutschen Instituts für Bautechnik. Texte und Zeichnungen von Werbeschriften dürfen der allgemeinen bauaufsichtlichen Zulassung nicht widersprechen. Im Falle von Unterschieden zwischen der deutschen Fassung der allgemeinen bauaufsichtlichen Zulassung und ihrer englischen Übersetzung hat die deutsche Fassung Vorrang. Übersetzungen der allgemeinen bauaufsichtlichen Zulassung müssen den Hinweis "Vom Deutschen Institut für Bautechnik nicht geprüfte Übersetzung der deutschen Originalfassung" enthalten. Die allgemeine bauaufsichtliche Zulassung darf nur vollständig vervielfältigt werden. Eine

0

7 werden, insbesondere, wenn neue technische Erkenntnisse dies erfordern. Die allgemeine bauaufsichtliche Zulassung wird widerruflich erteilt. Die Bestimmungen der allgemeinen bauaufsichtlichen Zulassung können nachträglich ergänzt und geändert

Z86167.15 1.156.603-115/15





Allgemeine bauaufsichtliche Zulassung Nr. Z-156.603-1587

Seite 3 von 5 | 1. Dezember 2015

## II BESONDERE BESTIMMUNGEN

# 1 Zulassungsgegenstand und Anwendungsbereich

Die allgemeine bauaufsichtliche Zulassung gilt für die Herstellung und Verwendung der heterogenen PVC-Bodenbeläge "Luxury vinyl tile" mit CE-Kennzeichnung nach der Norm DIN EN 140411. mit CE-Kennzeichnung nach der Norm

wendet werden Die Bodenbeläge erfüllen die Anforderungen der "Grundsätze zur gesundheitlichen Bewer-tung von Bauprodukten in Innenräumen"<sup>2</sup> und dürfen demgemäß in Aufenthaltsräumen verund dürfen demgemäß in Aufenthaltsräumen ver-

## 2 Bestimmungen für das Bauprodukt

## 2.1 Eigenschaften und Zusammensetzung

- 2.1.1 Bodenbeläge müssen bestehen aus sowie den Bestimmungen dieser allgemeinen bauaufsichtlichen Zulassung entsprechen. Die Die heterogenen PVC-Bodenbeläge müssen den Bestimmungen der Norm DIN EN 14041
- der Oberflächenvergütung auf Polyurethan-Acrylatbasis
- der transparenten Nutzschicht aus PVC,
- einem bedruckten Film aus PVC sowie
- dem Trägermaterial aus PVC.

Die Gesamtdicke der Bodenbeläge muss 2,0 mm bis 5,0 mm ( $\pm$  10 %) und das Gesamtflächengewicht 3720 g/m² bis 10380 g/m² ( $\pm$  10 %) betragen.

- 2.1.2 grenzung flüchtiger und schwer flüchtiger organischer Verbindungen erfüllen. Die Bodenbeläge müssen die Anforderungen der "Grundsätze zur gesundheitlichen Bewertung von Bauprodukten in Innenräumen" insbesondere hinsichtlich der Emissionsbe-
- 2.1.3 für Bautechnik hinterlegten übereinstimmen. Die chemische Zusammensetzung der Bodenbeläge muss mit der beim Deutschen Institut
- 2.1.4 Der in Abschnitt 1 genannte Zulassungsgegenstand umfasst eine Gruppe von Einzelprodukten, deren unterschiedliche Dicken und Flächengewichte den in Abschnitt 2.1.1 angegebenen Bereichen entsprechen müssen; sie müssen ansonsten in Aufbau und chemischer Anlage 1 beigefügt. Zusammensetzung identisch sein. Die Liste der Einzelprodukte ist der Zulassung in der
- 2.2 Herstellung und Kennzeichnung

### 2.2.1 Herstellung

Bei der Herstellung der Bauprodukte sind die Bestimmungen des Abschnitts 2.1 einzuhalten.

### 2.2.2 Kennzeichnung

Die Bauprodukte, ihre Verpackung oder die Beipackzettel müssen vom Hersteller zusätzlich zur CE-Kennzeichnung nach der Norm DIN EN 14041 mit dem Übereinstimmungszeichen (Ü-Zeichen) nach den Übereinstimmungszeichen-Verordnungen der Länder gekennzeichnet werden. Die Kennzeic Abschnitt 2.3 erfüllt sind. Kennzeichnung darf nur erfolgen, wenn die Voraussetzungen

N -

Z86167.15 1.156.603-115/15

des DIBt, <a href="http://www.dibt.de">http://www.dibt.de</a>. Eine Bewertung des Geruches erfolgt im Rahmen der Zulassung nicht. DIN EN 14041:2008-05: Elastische, textile und Laminat-Bodenbeläge bzw. die in den Mitgliedsstaaten in nationale Normen umgesetzte EN 14041:2004/AC:2005/AC:2006
Grundsätze zur gesundheitlichen Bewertung von Bauprodukten in Innenräumen, veröffentlicht auf der Homepage





Allgemeine bauaufsichtliche Zulassung Nr. Z-156.603-1587

Seite 4 von 5 | 1. Dezember 2015

Die Kennzeichnung muss deutlich lesbar folgende Angaben enthalten:

- "[Produktname]"
- Übereinstimmungszeichen (Ü-Zeichen) mit Namen des Herstellers und des Herstellwerks Zertifizierungsstelle (kann auch verschlüsselt angegeben werden), Zulassungsnummer und Bezeichnung der
- "Emissionsgeprüftes Bauprodukt nach DIBt-Grundsätzen"

### 2.3 Übereinstimmungsnachweis

### 2.3.1 Allgemeines

Maßgabe der folgenden Bestimmungen erfolgen. regelmäßigen Fremdüberwachung einschließlich einer Erstprüfung der Bauprodukte nach Die Bestätigung der Übereinstimmung der Bauprodukte mit den Bestimmungen dieser allgemeinen bauaufsichtlichen Zulassung muss für jedes Herstellwerk mit einem Übereinstimmungszertifikat auf der Grundlage einer werkseigenen Produktionskontrolle und einer

einzuschalten. hierfür anerkannte Zertifizierungsstelle sowie eine hierfür anerkannte Überwachungsstelle der dabei durchzuführenden Produktprüfungen hat der Hersteller der Bauprodukte eine Für die Erteilung des Übereinstimmungszertifikats und die Fremdüberwachung einschließlich

auf den Verwendungszweck abzugeben. zeichnung der Bauprodukte mit dem Übereinstimmungszeichen (U-Zeichen) unter Hinweis Die Erklärung, dass ein Übereinstimmungszertifikat erteilt ist, hat der Hersteller durch Kenn-

erteilten Übereinstimmungszertifikats zur Kenntnis zu geben Dem Deutschen Institut für Bautechnik ist von der Zertifizierungsstelle eine Kopie des von ihr

## 2.3.2 Werkseigene Produktionskontrolle

Es gelten die Regelungen der Norm DIN EN 14041 sowie die im Folgenden aufgeführten Bestimmungen.

führen. Unter werkseigener Produktionskontrolle wird die vom Hersteller vorzunehmende kontinuierliche Überwachung der Produktion verstanden, mit der dieser sicherstellt, dass das von ihm hergestellte Bauprodukt den Bestimmungen dieser allgemeinen bauaufsichtlichen Zulassung entspricht In jedem Herstellwerk ist eine werkseigene Produktionskontrolle einzurichten und durchzu-

werten. Die Aufzeichnungen müssen mindestens folgende Angaben enthalten: <u>Die</u> Ergebnisse der werkseigenen Produktionskontrolle sind aufzuzeichnen nnd d

- Bezeichnung des Bauprodukts bzw. des Ausgangsmaterials und der Bestandteile
- Art der Kontrolle oder Prüfung
- Datum der Herstellung und der Prüfung des Bauprodukts bzw. des Ausgangsmaterials oder der Bestandteile
- Ergebnis der Kontrollen und Prüfungen und, soweit zutreffend, Vergleich mit den Anforderungen
- Unterschrift des für die werkseigene Produktionskontrolle Verantwortlichen

Maßnahmen zur Abstellung des Mangels zu treffen. Bauprodukte, die den Anforderungen nicht entsprechen, sind so zu handhaben, dass Verwechslungen mit übereinstimmenden ausgeschlossen werden. Nach Abstellung des Mangels ist - soweit technisch möglich und zum Nachweis der Mängelbeseitigung erforderlich - die betreffende Prüfung unverzüglich zu für Bautechnik und der zuständigen obersten Bauaufsichtsbehörde auf Verlangen vorzuwachung eingeschalteten Überwachungsstelle vorzulegen. Sie sind dem Deutschen Institut Die Aufzeichnungen sind mindestens fünf Jahre aufzubewahren und der für die Fremdüberlegen. Bei ungenügendem Prüfergebnis sind vom Hersteller unverzüglich die erforderlichen

286167.15 1.156.603-115/15





Allgemeine bauaufsichtliche Zulassung Nr. Z-156.603-1587

Seite 5 von 5 | 1. Dezember 2015

## 2.3.3 Fremdüberwachung

wachung regelmäßig zu überprüfen, mindestens jedoch einmal jährlich. Dabei ist sicherzustellen, dass im Überwachungszeitraum die geprüften Einzelprodukte repräsentativ für die gesamte Gruppe sind. Im Rahmen der Fremdüberwachung ist eine Erstprüfung des Bauprodukts durchzuführen, und es können auch Proben für Stichprobenprüfungen entnommen Verlangen vorzulegen. Deutschen Institut für Bautechnik und der zusfändigen obersten Bauaufsichtsbehörde auf stelle. Die Ergebnisse der Zertifizierung und Fremdüberwachung sind mindestens fünf Jahre aufzubewahren. Sie sind von der Zertifizierungsstelle bzw. der Überwachungsstelle dem werden. Die Probenahme und Prüfungen obliegen jeweils der anerkannten Überwachungs-In jedem Herstellwerk ist die werkseigene Produktionskontrolle durch eine Fremdüber-

prüfung oder eine adäquate Kurzzeitprüfung, die mit dem DIBt abzustimmen ist, durchzuführen. Im Rahmen der vorzugsweise letzten Fremdüberwachung ist eine vollständige Prüfung des Emissionsverhaltens (28 Tage oder entsprechend der Abbruchkriterien 3 oder 7 Tage³) durchzuführen. Die Hinweise für die Entnahme von Bodenbelagsproben im Werk für die Emissionsprüfung sind zu beachten³. Bewertung von Bauprodukten in Innenräumen" ist einmal jährlich eine 3-tägige Emissions-Zum Nachweis des Emissionsverhaltens gemäß den "Grundsätzen zur gesundheitlichen

Weitere Maßnahmen und Prüfungen im Rahmen der abzustimmen. Fremdüberwachung sind mit dem DIBt

Wolfgang Misch Referatsleiter

Veröffentlicht auf der Homepage des DIBt, http://www.dibt.de

w

Z86167.15 1.156.603-115/15



### Anlage 1

Zulassungsgegenstand: "Luxury vinyl tile"

Auflistung der in der Zulassung geregelten Einzelprodukte:

Nr. Name des Bodenbelags		7.5
es	_	. i
	JH-LVT	Name des Bodenbelags



Z96401.15 1.156.603-115/15

## Precisely Right. **TÜV**Rheinland®

## **CLASSIFICATION OF REACTION TO FIRE IN ACCORDANCE WITH EN 13501-1:2007**

Sponsor:

Verie: 20140220



Prepared by:

Josink Esweg 7545 PN 6 TÜV Rheinland Nederland B.V.

ENSCHEDE

The Netherlands

Notified Body number:

0336 \*

Product name:

Luxury Vinyl Tile

Classification report number: C-89206631-1

Project number:

89206631

Issue number:

1st

Date of issue:

02-10-2014

This classification report consists of 6 pages and may only be used or reproduced in its

To be used for CE marking only

## All rights reserved.

No part of this report may be reproduced, provided to and/or examined by third parties, and/or published by print, photoprint, microfilm, in electronic form or any other means without the explicit previous written consent of TÜV Rheinland Nederland B.V.

In case this report was drafted within the context of an assignment to TÜV Rheinland Nederland B.V., the rights and obligations of contracting parties are subject to the General Terms & Conditions for Advisory, Research and Certification assignments to TÜV Rheinland Nederland B.V. and/or the relevant agreement concluded between the contracting parties.

© 2010 TÜV Rheinland Nederland B.V.

Boogschutterstraat 11A P.O. Box 541 7300 AM Apeldoorn Tel. +31 (0)88 888 7 888 Fax +31 (0)88 888 7 879

Locations: Vissenstraat 6 P.O. Box 541 7324 AL Apeldoorn

Tel. +31 (0)88 888 7 888 Fax +31 (0)88 888 7 879

Eiberkamp 10 P.O. Box 37 9350 AA Leek

Tel. +31 (0)88 888 7 888 Fax +31 (0)88 888 7 859

TÜV Rheinland Nederland B.V. is a registered compa at the Dutch Chamber of Commerce under number 27288788 info@nl.tuv.com/nl

Josink Esweg 10 P.O. Box 337 7500 AH Enschede

Reaction to fire according to EN 13501-1, product : Luxury Vinyl Tile





## CONTENTS:

6 Appro	5 Limitations	4.1 Re 4.2 CI 4.3 Fi	4 Classi	3.1 Te 3.2 Te	3 Test re	2.1 Gr 2.2 Pr	2 Details	1 Introduction
6 Approval of document	ations	Reference of classification Classification Field of application	Classification and fiels of application	Test reports references Test results	Test reports and test results in support of classification	General Product description	2 Details of classified product	luction
0,	0,	01 01 01	OI .	ω 4	ω	ωω	ω	ω





## 1 Introduction

This classification report defines the classification assigned to Luxury Vinyl Tile in accordance with the procedures given in EN 13501-1:2007.

# 2 Details of classified product

## 2.1 General

The product, Luxury Vinyl Tile, is defined as a heterogeneous PVC floor covering in accordance with EN-ISO 10582:2012\*.

## 2.2 Product description

The product, Luxury Vinyl Tile, is described below and is described in the test reports provided in support of classification listed in 3.1.

Product description : Luxury Vinyl Tile

Floor covering type : Heterogeneous polyvinyl chloride floor coverings in accordance with the

requirements of EN-ISO 10582

Product name : Luxury Vinyl Tile

Nominal thickness : 2.0 - 5.0 mm

Mass per unit area : 3.853 - 10.03 kg/m²

## ယ Test reports and test results in support of classification

## 3.1 Test reports references

® TÜV, TUEV and TUV are registered trademarks. Any use or application requires prior approval.

Name of laboratory	Name of sponsor	Test report no.	Test method
TÜV Rheinland	Chiping Jiahua Plastics Co Ltd	00000001016	EN-ISO 11925-2:2010
Nederland B.V.		03200031.0101	EN-ISO 9239-1:2010
TÜV Rheinland	Chining Jiahua Plastics Co Ltd		EN-ISO 11925-2:2010
Nederland B.V.		09200031.0201	EN-ISO 9239-1:2010

<sup>\*</sup> To be used for CE marking.

Classification report no.: C-89206631-1 | Dated: 02-10-2014 | Page 4 of 6

Reaction to fire according to EN 13501-1, product: Luxury Vinyl Tile





## 3.2 Test results

Product name : Luxury Vinyl Tile

Test report no. : 89206631.01br

Nominal thickness : 5.0 mm

Mass per unit area : 10.03 kg/m²

Test method and number	Parameter	No. of	Results	Its
		tests	Continuous parameter – mean	Compliance with parameter
Reaction to fire -Single- flame source test, 15 s exposure time. EN-ISO 11925-2:2010	Flame spread (Fs) ≤ 150 mm	Ō	≤150 mm	Compliant
Reaction to fire tests for floorings – Radiant heat	Critical heat flux Class B <sub>fl</sub> ≥ 8.0 kW/m <sup>2</sup>	သ	≥ 10.9 kW/m <sup>2</sup>	Compliant
source. EN-ISO 9239-1:2010	Smoke production s1: Smoke ≤ 750 %·minutes	з	62 %·minutes	Compliant

Product name : Luxury Vinyl Tile

Test report no. : 89206631.02br

Nominal thickness : 2.0 mm

Mass per unit area : 3.853 kg/m²

Test method and number	Parameter	No. of	Results	Its
		tests	Continuous parameter – mean	Compliance with parameter
Reaction to fire -Single-flame source test, 15 s exposure time. EN-ISO 11925-2:2010	Flame spread (Fs) ≤ 150 mm	O	≤150 mm	Compliant
Reaction to fire tests for floorings – Radiant heat	Critical heat flux Class B <sub>fl</sub> ≥ 8.0 kW/m <sup>2</sup>	а	10.1 kW/m <sup>2</sup>	Compliant
source. EN-ISO 9239-1:2010	Smoke production s1: Smoke ≤ 750 % minutes	3	126 %·minutes	Compliant





# 4 Classification and fields of application

## 4.1 Reference of classification

This classification has been carried out in accordance with EN 13501-1:2007.

## 4.2 Classification

The product, Luxury Vinyl Tile, in relation to its reaction to fire behavior is classified:  $\mathbf{B}_n$  The additional classification in relation to smoke production is:  $\mathbf{s1}$ 

# Reaction to fire classification: B<sub>fl</sub> - s1

## 4.3 Field of application

This classification is valid for the following product parameters:

Total mass per unit area  $3.853 - 10.03 \text{ kg/m}^2$ , with allowed deviation:  $\frac{+13}{-10}$  % Thickness of wear layer 0.2-0.55 mm, with allowed deviation:  $\frac{+0.13}{-0.10}$  %. Total thickness of 2.0 - 5.0 mm, with allowed deviation:  $\frac{+0.13}{-0.10}$  mm.

Reference: see reports mentioned under paragraph 3.1.

The classification is valid for the following end use applications:

- As a floor covering
- On an end use substrates of classes A1 and A2-s1,d0 according to EN 13238:2010
- By any methods and means of fixing.

® TÜV, TUEV and TUV are registered trademarks. Any use or application requires prior approval.

Page 6

of 6





## 5 Limitations

This classification document does not represent type approval or certification of the product.

Statement when the product is being CE marked under attestation of conformity system 3:

the Construction Products Directive. by the manufacturer within the context of system 3 attestation of conformity and CE marking under "The classification assigned to the product in this report is appropriate to a declaration of conformity

system 3 attestation is appropriate design requires no specific processes, procedures or stages (e.g. no addition of flame-retardants, limitation of organic content, or addition of fillers) that are aimed at enhancing the fire performance in order to obtain the classification achieved. As a consequence the manufacturer has concluded that The manufacturer has made a declaration, which is held on file. This confirms that the products

holds appropriate references, supplied by the manufacturer, to provide for traceability of the samples The test laboratory has, therefore, played no part in sampling the product for the test, although it

## 6 Approval of document

olff and project leader Flooring ed	Author	Signature of person undertaking classification
	Dutilo	oliginature of person anaertaking classification
	J. de Wolff	
		A
		(Anna)
ed	Expert and project leader Flooring	
H. Smit	Approved	Signature of person authorising this report
	H. Smit	All Marie Contractions of the Contraction of the Co

® TÜV, TUEV and TUV are registered trademarks. Any use or application requires prior approval

# **TÜV Rheinland Nederland B.V.**



Return address: P.O. box 337, 7500 AH Enschede, The Netherlands



The Netherlands TÜV Rheinland Nederland B.V.

P.O. Box 337 Postal address:

7500 AH Enschede

Josink Esweg 10 7545 PN Enschede Parking and delivery

www.tuv.com/nl

Jaring.de.Wolff@nl.tuv.com

02-10-2014

Project number 89206631

Report number 89206331.01br

Article

Luxury Vinyl Tile

I : Flooring Radiant Panel Single Specimen Report – 8 pages

Report

Project number: 89206631

Report number: 89206631.01br

Received:

A sample of a 5 mm thick heterogeneous resilient floorcovering, marked as: "Luxury

Vinyl Tile"; TÜV reference: MT14-154063673-40.01

selected by the applicant. The test house has had no influence on the sampling The samples have been received on the 11<sup>nd</sup> of September 2014. The samples are

procedure.

Identification parameters received from the manufacturer: : Luxury Vinyl Tile

Pattern no. : JH-6017-3

Batch no : JH20140808

Dimensions : 304.8 mm x 609.6 mm x 5.0 mm

Package : 1.858 m<sup>2</sup>

Total thickness : 5.0 mm

Total mass per unit area : 10.03 kg/m<sup>2</sup>

Wear layer : 0.55 mm

Composition / Material

: PVC, CaC03, DOTP

Use of fire-retardant Classification standard .. Zo : ISO 10852

Classification of burning behaviour according to EN 13501-1:2007+ A1:2009.

Test method:

Ignitability (direct impingement of flame) : EN ISO 11925-2:2010 : EN ISO 9239-1:2010

Reaction to fire (radiant panel)

Results:

See page two and three

Appendix:

See page four up to and including eleven.

civil affairs at the Court in Zutphen (the Netherlands) under number 35/2010, which are filed at the office of the Clerk for TRN applies General Terms & Conditions dated November 17th 2010





Date

02-10-2014

TEST RESULTS

Ignitability EN-ISO 11925-2:2010

Date of testing : 17-9-2014

Report number 89206331.01br

89206631 Project number

Article

Luxury Vinyl Tile

Conditioning time, climate Description of substrate :  $\geq$  3 days, 23  $\pm$  2 °C and 50  $\pm$  5 %

: 6 mm. Fibre cement board, 1800 kg/m<sup>3</sup>.

Flame application : Surface. : 15 seconds.

Application time

Page 2/11

Direction:	l n l	In production	tion	Acro	Across production	action
Total burning time <sup>1</sup> (15 s)	15	15	15	15	15	15
Flame tip reaches 150 mm (s)	no	on	no	no	no	No
Extent of damaged area, length (mm)	51	48	58	58	58	55
Extent of damaged area, width (mm)	17	12	12	12	12	12
Material melts (yes/no)	no	no	no	no	no	no
Shrinks away <sup>2</sup> (yes/no)	no	on	on	no	no	no
Glowing <sup>3</sup> (sec)	no	no	no	no	no	no
Flaming debris (yes/no)	no	no	no	no	no	no
Ignition of filter paper (yes/no)	no	no	no	no	no	no
		,			750 C C C C	

Inclusive a flame application time of 15 or 30 seconds with surface or edge impingement Shrinks away from flame without being ignited

## Radiant Panel test ISO 9239-1:2010

Date of testing : 17-9-2014

 $:\ge 3$  days,  $23\pm 2$  °C and  $50\pm 5$  %

Conditioning time, climate Description of substrate : Fibre cement board 6 mm, 1800±200 kg/m<sup>3</sup>

conforming to EN 13238.

Sampling procedure : By contractor.

Fixing method Description of cleaning used : None. : None, loose laid.

\* = manufacturer's declaration

Mean <sub>2-4</sub>	4,↑	კ. →	2,↑	1,⊥	Test specimen, orientation
6.3	7.0	7.0	5.0	6.0	Flame spread (cm) CRF (kW/m2)
≥ 10.9	≥ 10.9	≥ 10.9	≥ 10.9	≥ 10.9	CRF (kW/m2)
24.0	25.1	22.6	24.2	17.6	Peak light attenuation (%)
62	58	67	62	44	Smoke production (%.min)

Remarks: There is flashing & transitory observed, there is no sustained flaming observed.

All four tested specimen extinguished naturally before the end of the test duration

<sup>3</sup> The time at which it occurs and its duration





CONCLUSION

Date 02-10-2014

Project number

89206331.01br 89206631 Report number

Luxury Vinyl Tile Article

The aforementioned quality meets the requirement of reaction to fire classification:

quality **Luxury Vinyl Tile**, in relation to its reaction to fire behaviour is classified:  $\mathbf{B}_{n}$ . The additional classification in relation to smoke production is:  $\mathbf{s1}$ .

According to EN 13501-1:2007+ A1:2009 the tested sample of the aforementioned

Page 3/11

 $B_{\Pi}-s1$ 

The classification is valid for the following end use applications:

- End use substrates of classes A1 and A2-s1,d0, for example fibre cement board
- Any way of fixation.

### Statements:

or heat radiant sources. use. The method might not be suitable if the product is exposed to much larger flames intended to be the sole criterion for assessing the potential fire hazard of the product in product under the particular conditions of the test in laboratory conditions; they are not The test results only relate to the behaviour of the test specimens of the examined

alterations or modifications of the examined product (combination)(s) and/or the approval of the testing laboratory. criteria. This report shall not be reproduced, except in full, without the written The validity of this report will expire five years after its issue or directly after

This document does not represent type approval or certification of the product.

Author:

Mr. J. de Wolff

Review:

Mr. R. Boerboom

All rights reserved

No part of this report may be reproduced, provided to and/or examined by third parties, and/or published by print, photoprint, microfilm, in electronic form or any other means without the explicit previous written consent of TÜV Rheinland Nederland B.V. The results are based upon the samples received and have not to be representative for the total production. TÜV Rheinland Nederland B.V. had no influence on the sampling.

In case this report was drafted within the context of an assignment to TÜV Rheinland Nederland B.V., the rights and obligations of contracting parties are subject to the General Terms & Conditions for Advisory, Research and Certification assignments to TÜV Rheinland Nederland B.V. and/or the relevant agreement concluded between the contracting parties

© 2010 TÜV Rheinland Nederland B.V.





Date

02-10-2014

Project number

89206631

APPENDIX I: Flooring Radiant Panel Single Specimen Report

Report produced with the Fice Testing Technology FRPSoft software

Page 1 Report number

Article 89206331.01br

Flooring Radiant Panel Single Specimen Report Luxury Vinyl Tile

Page 4/11

Standard Laboratory

: EN ISO 9239-1:2002 : TÜV Rheinland Nederland B.V. : Tuv ShangHai 89206631 : Sep. 17 2014

Date of test Sponsor

Test name Specimen description : Grijs Laminaat MT14-154063673-40.01 Prod #1 D:\FRPFILES\\14090021.CSV

Test number in series File name

Flux calibration file name CAFRPSOFT\CALIB\FLX14014.CSV

Thickness (mm) Density (kg/m³)

Substrate used? Test duration 12 minutes 06 seconds (726 s) Yes

Fixing method Conditioned? Substrate : Calcium silicate : none : Yes : 23 : 50

Conditioning temp. (°C) Conditioning RH (%)

Test Results

HF-30 (kW/m²)
Flame spread at 10 minutes (mm)
Flame spread at 20 minutes (mm)
Flame spread at 30 minutes (mm)
Plame spread at 30 minutes (mm)
Peak light attenuation (%) Time to ignition
Time to flameout Smoke production classification Potential classification Total integrated smoke (%.min) Time to peak light attenuation Critical flux at exlinguishment (kW/m²) HF-10 (kW/m²) HF-20 (kW/m²) Extent of burning (mm) : -1 : 24.18 : 3 minutes 53 seconds (233 s) : 61.74 : A2(f1)/B(f1) : s1 :>=10.9 :>=10.9 : 2 minutes 01 seconds (121 s) : 12 minutes 03 seconds (723 s) : 50 : >= 10.9 >= 10.9 50

These results relate only to the behaviour of the specimens of the product under the particular conditions of the test; they are not intended to be the sale enterior for assessing the potential fire hazard of the product in use.





Report produced with the Fire Testing Technology FRPSoft software

page 2


Project number 89206631

Date 02-10-2014

Report number 89206331.01br

Article Luxury Vinyl Tile

**Page** 5/11

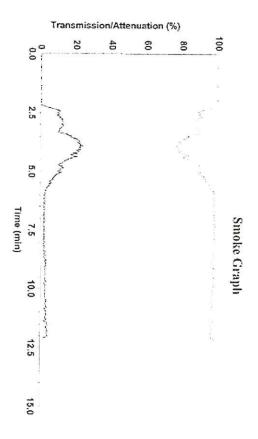

Test name: Prod #1
File name: DAFRPELES(14090021,CSV

### Rake Results

Position (mm) Time (s) Flux (kW/m²) Qsb (MI/m²) Position (mm) Time (s) Flux (kW/m²) Qsb (MI/m²) 60 1160 210 260 310 410 460 11.7 10.8 10.0 9.1 9.1 8.0 7.0 6.1 5.2 4.3 510 560 610 660 710 760 810 860 910 3.6 2.6 2.2 1.8 1.5 1.5 . . . . . . . . . .

<u>Comments</u>
Specimen extinguished naturally.

These results relate only to the behaviour of the specimens of the product under the particular conditions of the test; they are not intended to be the sole criterion for assessing the potential fire lazard of the product in use.





Date 02-10-2014

89206631 Project number

89206331.01br Report number

Spol

Luxury Vinyl Tile Article

Page 6/11

Flooring Radiant Panel Single Specimen Report

Report produced with the Fire Testing Technology FRPSoft software

Standard Laboratory Sponsor : EN ISO 9239-1:2002 : TÜV Rheinland Nederland D. V. : Tuv ShangHai 89206631 : Sep. 17 2014

Date of test

Specimen description

File name Test number in series Test name : Click PVC grijs MT14-154063673-40.01 : Prod #2 : D:\FRPFILES\14090025.CSV

Flux calibration file name : C:\FRPSOFT\CALIB\FLX14014.CSV

Density (kg/m3) Thickness (mm)

Substrate used? Test duration 12 minutes 03 seconds (723 s) Yes

Substrate Fixing method : Calcium silicate

Conditioned? : none : Yes : 23 : 50

Conditioning temp. (°C) Conditioning RH (%)

Time to ignition Time to flameout HF-20 (kW/m²) HF-30 (kW/m²) Total integrated smoke (%.min) Flame spread at 10 minutes (mm) Flame spread at 20 minutes (mm) Flame spread at 30 minutes (mm) Peak light attenuation (%)
Time to peak light attenuation Extent of burning (mm)
Critical flux at extinguishment (kW/m²)
HF-10 (kW/m²) Potential classification : A2(f1)/B(f1) : s1 : 17.62 : 3 minutes 56 seconds (236 s) : 43.88 : 2 minutes 01 seconds (121 s) : 12 minutes 02 seconds (722 s) : 70 70 10.9 10.9 0.9 10.9

These results relate only to the behaviour of the specimens of the product under the particular conditions of the test; they are not intended to be the sole criterion for assessing the potential line hazard of the product in use.

Smoke production classification





Report produced with the Fire Testing Technology FRPSoft software

rage 2


Project number 89206631

Date 02-10-2014

Report number 89206331.01br

Page 7/11

Luxury Vinyl Tile Article

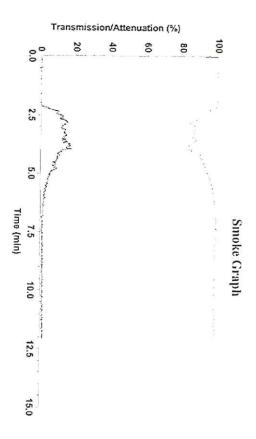

Test name : Prod #2 File name : DNFRPFILES\14090025.CSV

### Rake Results

Position (nun) Time (s) Flux (kW/m²) Qsb (MJ/m¹) Position (nun) Time (s) Flux (kW/m²) Qsb (MJ/m²) 60 110 160 210 210 260 310 360 410 11.7 10.8 10.0 9.1 8.0 7.0 6.1 5.2 2.058 510 560 610 660 710 760 810 860 3.6 3.0 2.6 2.2 1.8 1.5 1.3

### Comments

Specimen extinguished naturally.

These results relate only to the behaviour of the specimens of the product under the particular conditions of the test; they are not intended to be the sole criterion for assessing the potential fine hazard of the product in use.





Report produced with the Fire Testing Technology FRPSoft software

02-10-2014

Date

89206631 Project number

page 1

89206331.01br Report number

Flooring Radiant Panel Single Specimen Report

Luxury Vinyl Tile Article

Page 8/11

Date of test : EN ISO 9239-1:2002 : TÜV Rheinland Nederland B.V. : Tuv ShangHai 89206631 : Sep. 17 2014 Click PVC grijs MT14-154063673-40.01

Test name Specimen description : Prod #3 : D:\/FRPFILES\\\14090026.C:SV : 4

Laboratory Sponsor

Standard

Test number in series

File name

Flux calibration file name : C:\FRPSOFT\CALIB\FLX14014.CSV

Density (kg/m³) Thickness (mm)

Substrate used? Test duration 12 minutes 39 seconds (759 s) Yes

Fixing method Conditioned? Substrate : Calcium silicate

Conditioning temp. (°C) Conditioning RH (%) : none : Yes : 23 : 50

Test Results

Time to ignition Time to flameout : 2 minutes 04 seconds (124 s) : 12 minutes 07 seconds (727 s) : 70

Extent of burning (mm)

Critical flux at extinguishment (kW/m²) HF-10 (kW/m²) : >= 10.9: >= 10.9

Flame spread at 10 minutes (mm)
Flame spread at 20 minutes (mm)
Flame spread at 30 minutes (mm)
Peak light attenuation (%)
Time to peak light attenuation HF-30 (kW/m²) :>= 10.9 70

HF-20 (kW/m²)

>= 10.9

: 22.56 : 4 minutes 16 seconds (256 s) : 66.92

Potential classification Total integrated smoke (%.min) : A2(f1)/B(f1) : s1

Smoke production classification

These results relate only to the behaviour of the specimens of the product under the particular conditions of the test; they are not intended to be the sole criterion for assessing the potential fire bazard of the product in use.





Report produced with the Fire Testing Technology FRPSoft software

page 2

Report number 89206331.01br

Article Luxury Vinyl Tile

Page 9/11

Project number 89206631

Date 02-10-2014

100 40 60 80 Time (min) Smoke Graph 10.0 12.5 15.0

Transmission/Attenuation (%)

Test name : Prod #3
File name : DAFRPFILES\14090026.CSV

### Rake Results

Position (mm) Time (s) Plux (kW/m²) Qsb (MJ/m²) Position (mm) Time (s) Flux (kW/m²) Qsb (MJ/m²) 1160 2100 3100 3100 3100 3100 11.7 10.8 10.0 9.1 8.0 7.0 7.0 7.0 4.3 3.038 510 560 610 660 710 760 810 860 910 3.6 3.0 2.2 1.8 1.5 1.2

Comments

Specimen extinguished naturally.

These results relate only to the behaviour of the specimens of the product under the particular conditions of the test; they are not intended to be the sole enterior for assessing the potential fire hazard of the product in use.





Date

02-10-2014

89206631 Project number

Report produced with the Fire Testing Technology FRPSoft software

APPENDIX I: Flooring Radiant Panel Single Specimen Report

P286 89206331.01br Report number

Flooring Radiant Panel Single Specimen Report

Article Luxury Vinyl Tile

Page 10/11

Laboratory

: EN ISO 9239-1:2002 : TÜV Rheinland Nederland B.V. : Tuv ShangHai 89206631 : Sep. 17 2014

Sponsor Date of test

Specimen description : Grijs Laminaat MT14-154063673-40.01 : Cross #1 : D:VFRPFILES\14090022,CSV : 4

Test name

File name

Test number in series

Flux calibration file name : C:\FRPSOFT\CALIB\FLX14014.CSV

Density (kg/m³) Thickness (mm)

Test duration 12 minutes 13 seconds (733 s) Yes

Substrate used? Substrate

Fixing method : Calcium silicate

Conditioned? : none : Yes : 23 : 50

Conditioning temp. (°C) Conditioning RH (%)

Test Results

Time to ignition Time to flameout : 2 minutes 01 seconds (121 s) : 12 minutes 11 seconds (731 s) : 60

10.9

Extent of burning (mm)
Critical flux at extinguishment (kW/m²)
HF-10 (kW/m²)
HF-20 (kW/m²)
HF-30 (kW/m²) 10.9 10.9 10.9

: 60

Flame spread at 10 minutes (mm)
Flame spread at 20 minutes (mm)
Flame spread at 30 minutes (mm)

Time to peak light attenuation Peak light attenuation (%) : 25.08 : 3 minutes 56 seconds (236 s) : 57.57

Total integrated smoke (%.min)

Smoke production classification Potential classification : A2(II)/B(II) : s1

These results relate only to the behaviour of the specimens of the product under the particular conditions of the test; they are not intended to be the safe criterion for assessing the potential fire hazzed of the product in use.





Report produced with the Fire Testing Technology FRPSoft software

page ?

Report number 89206331.01br

Article

Luxury Vinyl Tile

Page 11/11

Project number 89206631

Date 02-10-2014

Transmission/Attenuation (%) 100 40 80 2,5 5.0 Time (min) Smoke Graph 7.5 10.0 12.5 15.0

Test name: Cross #1
File name: D:\FRPFILES\14090022.CSV

### Rake Results

Position (mm) Time (s) Flux (kW/m²) Qsb (MJ/m²) Position (mm) Time (s) Flux (kW/m²) Qsb (MJ/m²) 60 195 11.7 2.101 510 . 3.6 10.8 . 560 . 3.0 110 110 160 210 260 310 310 410 11.7 10.8 10.0 9.1 8.0 7.0 6.1 5.2 510 560 610 660 710 760 810 810 910 3.6 2.6 2.2 1.8 1.3 2 2 5 3 5 6 3 6

Comments
Specimen extinguished naturally.

These results relate only to the behaviour of the specimens of the product under the particular conditions of the test; they are not intended to be the sole criterion for assessing the potential fire bazard of the product in use.

# TÜV Rheinland Nederland B.V.



Return address: P.O. box 337, 7500 AH Enschede, The Netherlands

The Netherlands TÜV Rheinland Nederland B.V.

7500 AH Enschede P.O. Box 337 Postal address:

7545 PN Enschede Josink Esweg 10 Parking and delivery:

www.tuv.com/nl

Jaring.de.Wolff@nl.tuv.com

02-10-2014

Project number 89206631

89206331.02br Report number

Article

Luxury Vinyl Tile

: Flooring Radiant Panel Single

Specimen Report - 8 pages

Report

Project number: 89206631 Report number: 89206631.02br

Received:

A sample of a 2 mm thick heterogeneous Resilient floorcovering, marked as: "Luxury

Vinyl Tile"; TÜV reference: MT14-154063673-40.02

selected by the applicant. The test house has had no influence on the sampling The samples have been received on the 11<sup>nd</sup> of September 2014. The samples are

procedure.

Name Identification parameters received from the manufacturer: Luxury Vinyl Tile

Pattern no. JH-0211

Batch no : JH20140816

Dimensions : 457.2 mm x 457.2 mm x 2.0 mm

Package  $2.71 \text{ m}^2$ 

Total thickness 2.0 mm

Total mass per unit area Wear layer : 3.853 kg/m<sup>2</sup> : 0.2 mm

Classification standard : ISO 10852

Composition / Material

PVC, CaC03, DOTP

Use of fire-retardant No O

Classification of burning behaviour according to EN 13501-1:2007+ A1:2009.

Test method:

Ignitability (direct impingement of flame) : EN ISO 11925-2:2010 : EN ISO 9239-1:2010

Reaction to fire (radiant panel)

Results:

See page two and three

Netherlands) under number 35/2010, civil affairs at the Court in Zutphen (the which are filed at the office of the Clerk for TRN applies General Terms & Conditions

dated November 17th 2010

Appendix:

See page four up to and including eleven.





TEST RESULTS

Ignitability EN-ISO 11925-2:2010

Date of testing : 17-9-2014

Report number 89206331.02br

89206631 Project number **Date** 02-10-2014

Conditioning time, climate  $: \ge 3$  days,  $23 \pm 2$  °C and  $50 \pm 5$  %

Description of substrate : 6 mm. Fibre cement board, 1800 kg/m<sup>3</sup>.

Flame application : Surface.

Application time : 15 seconds.

Page 2/11

Luxury Vinyl Tile

Article

Direction:	ln F	In production	tion	Acro	Across production	ıction
Total burning time <sup>1</sup> (15 s)	15	15	15	15	15	15
Flame tip reaches 150 mm (s)	no	no	no	no	no	No
Extent of damaged area, length (mm)	52	60	62	56	60	51
Extent of damaged area, width (mm)	11	12	12	12	12	11
Material melts (yes/no)	no	no	on	no	no	no
Shrinks away <sup>2</sup> (yes/no)	no	on	on	no	no	no
Glowing <sup>3</sup> (sec)	no	no	on	no	no	no
Flaming debris (yes/no)	no	no	no	no	no	no
Ignition of filter paper (yes/no)	no	no	no	no	no	no

<sup>1</sup> Inclusive a flame application time of 15 or 30 seconds with surface or edge impingement 2 Shrinks away from flame without being ignited

## Radiant Panel test ISO 9239-1:2010

Date of testing : 17-9-2014

Conditioning time, climate Description of substrate :  $\geq$  3 days, 23  $\pm$  2 °C and 50  $\pm$  5 %

: Fibre cement board 6 mm, 1800±200 kg/m<sup>3</sup>

conforming to EN 13238.

Sampling procedure : By contractor.

Description of cleaning used : None.

Fixing method : None, loose laid.

= manufacturer's declaration

126	28.1	10.1	15.3	Mean <sub>2-4</sub>
125	27.1	10.2	15.0	4, ⊥
130	30.0	9.6	18.0	3,⊥
124	27.2	10.5	13.0	2,⊥
77	20.2	10.8	11.0	1,↑
Smoke production (%.min)	Peak light attenuation (%)	CRF (kW/m2)	Flame spread (cm) CRF (kW/m2)	Test specimen, orientation

Remarks: There is flashing & transitory observed, there is no sustained flaming observed.

All four tested specimen extinguished naturally before the end of the test duration

<sup>3</sup> The time at which it occurs and its duration





CONCLUSION

Date 02-10-2014

89206631 Project number

89206331.02br Report number

Luxury Vinyl Tile Article

The aforementioned quality meets the requirement of reaction to fire classification:

The additional classification in relation to smoke production is: s1.

quality Luxury Vinyl Tile, in relation to its reaction to fire behaviour is classified: B<sub>fl</sub>. According to EN 13501-1:2007+ A1:2009 the tested sample of the aforementioned

Page 3/11

SI

The classification is valid for the following end use applications:

- End use substrates of classes A1 and A2-s1,d0, for example fibre cement board
- Any way of fixation.

or heat radiant sources. use. The method might not be suitable if the product is exposed to much larger flames intended to be the sole criterion for assessing the potential fire hazard of the product in product under the particular conditions of the test in laboratory conditions; they are not The test results only relate to the behaviour of the test specimens of the examined

approval of the testing laboratory. criteria. This report shall not be reproduced, except in full, without the written alterations or modifications of the examined product (combination)(s) and/or the The validity of this report will expire five years after its issue or directly after

This document does not represent type approval or certification of the product.

Author:

Mr. J, de Wolff

Review:

Mr. R. Boerboom

All rights reserved.

No part of this report may be reproduced, provided to and/or examined by third parties, and/or published by print, photoprint, microfilm, in electronic form or any other means without the explicit previous written consent of TÜV Rheinland Nederland B.V. The results are based upon the samples received and have not to be representative for the total production. TÜV Rheinland Nederland B.V. had no influence on the sampling.

In case this report was drafted within the context of an assignment to TÜV Rheinland Nederland B.V., the rights and obligations of contracting parties are subject to the General Terms & Conditions for Advisory, Research and Certification assignments to TÜV Rheinland Nederland B.V. and/or the relevant agreement concluded between the contracting parties.

© 2010 TÜV Rheinland Nederland B.V.





Date

02-10-2014

Project number

89206631

APPENDIX I: Flooring Radiant Panel Single Specimen Report

Report produced with the Fire Testing Technology FRPSoft software

Page ! 89206331.02br Report number

Article

Luxury Vinyl Tile

Page

Flooring Radiant Panel Single Specimen Report

Laboratory Sponsor Test name Specimen description Date of test : Grifs laminaat MT14-154063673-40.02 : Prod #1 : DNFRPFILESN14090019.CSV : 4 : EN ISO 9239-1:2002 : TÜV Rheinland Nederland B.V. : Tuv ShangHai 89206631 : Sep. 17 2014

File name Test number in series

Flux calibration file name : CAFRPSOFTACALIBAPLX14014.CSV

Density (kg/m³) Thickness (mm)

Substrate used? Test duration : 12 minutes 06 seconds (726 s)
: Yes
: Calcium silicate
: none
: Yes
: Yes
: 23

Substrate Fixing method

Conditioning temp. (°C) Conditioning RH (%) Conditioned?

Test Results

Time to ignition Time to flameout : 2 minutes 01 seconds (121 s) : 12 minutes 02 seconds (722 s) : 110

Flame spread at 10 minutes (mm)
Flame spread at 20 minutes (mm)
Flame spread at 30 minutes (mm)
Peak light attenuation (%) Extent of burning (num)
Critical flux at extinguishment (kW/m²)
HF-10 (kW/m²)
HF-20 (kW/m²) HF-30 (kW/m²) : >= 10.9 : >= 10.9 : 10.77 : 10.77

Potential classification Total integrated smoke (%.min) Time to peak light attenuation : A2(f1)/B(f1) : s1 : 20.24 : 8 minutes 48 seconds (528 s) : 76.95

Smoke production classification

These results relate only to the behaviour of the specimens of the product under the particular conditions of the test, they are not intended to be the sale criterion for assessing the potential fire bazard of the product in use.





Report produced with the Fire Testing Technology ERPSoft software

page 2


Project number 89206631

Date 02-10-2014

Report number 89206331.02br

Article Luxury Vinyl Tile

**Page** 5/11

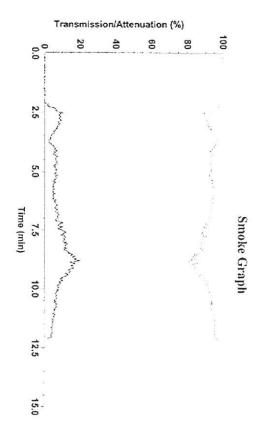

Test name: Prod #1
File name: D:\FRPFILES\14090019,CSV

### Rake Results

460	410	360	310	260	210	160	110	60	Position (mm)
¥	ï				•		612	301	Time (s)
4.3	5.2	1.6	7.0	8.0	9,1	10.0	10.8	11.7	Flux (kW/m²)
*	ĸ	•	٠		ě		6.116	3.243	Qsb (MJ/m²)
910	860	810	760	710	660	010	560	\$10	Position (mm)
9	•	٠	٠	٠	٠	ě	٠	÷	Tinue (s)
1.2	1.3	1.5	1.6	7.00	2.2	2.6	3.0	3.6	Flux (kW/m²)
œ		0 <b>9</b> 7:	i.e	e	•	7.8	٠	0.00	Qsb (MJ/m²)

<u>Comments</u>
Specimen extinguished naturally.

These results relate only to the behaviour of the specimens of the product under the particular conditions of the test; they are not intended to be the sole criterion for assessing the potential fire bazard of the product in use.





Date 02-10-2014

Project number

89206631

Report number 89206331.02br

page 1

Article Luxury Vinyl Tile

Page 6/11

Flooring Radiant Panel Single Specimen Report

Report produced with the Fire Testing Technology FRPSoft suftware

Standard

Laboratory Sponsor : El 2002 : TÜV Rheinland Nederland : Tuv ShangHai 89206631 : Sep. 17 2014

Date of lest

Specimen description : Beige Laminaat MT14-15406367-40.02 : Cross #1 : DAFRPFILESA14090020,CSV

Test name

Test number in series File name

Density (kg/m³) Thickness (mm)

Flux calibration file name

: C:\FRPSOFT\CALIB\FLX14014.CSV

Test duration 12 minutes 08 seconds (728 s) Yes

Substrate Substrate used? Calcium silicate

Conditioned? Fixing method : Yes : Yes : 23 : 50

Conditioning temp. (°C) Conditioning RH (%)

Test Results

Time to ignition Time to flameout : 2 minutes 03 seconds (123 s) : 12 minutes 06 seconds (726 s) : 130 : 10.46

Extent of burning (mm)
Critical flux at extinguishment (kW/m²)
HF-10 (kW/m²)
HF-20 (kW/m²) : 10.46

HF-30 (kW/m²)

: >= 10.9 : >= 10.9 : 130 : ·1

Plame spread at 10 minutes (mm)
Flame spread at 20 minutes (mm)
Flame spread at 30 minutes (mm)
Peak light attenuation (%)
Time to peak light attenuation

Total integrated smoke (%.min) Potential classification : 27.24 : 8 minutes 08 seconds (488 s) : 124.27

Smoke production classification : A2(fl)/B(fl) : s1

These results relate only to the behaviour of the specimens of the product under the particular conditions of the test, they are not intended to be the sole enterior for assessing the potential life hazard of the product in use.





Report produced with the Fire Testing Technology FRPSoft software


page 2

Report number 89206331.02br

Page 7/11

Luxury Vinyl Tile Article Project number 89206631

Date 02-10-2014

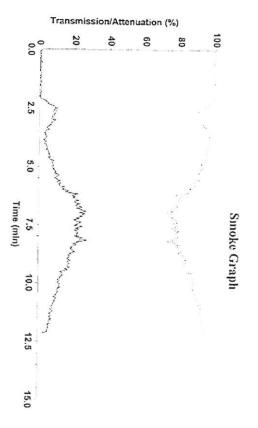

Test name : Cross #1
File name : D:\FRPFILES\14090020.CSV

### Rake Results

400	410	360	310	260	210	160	110	60	Position (mm)
	ē	9		£	(*)	*	509	365	Time (s)
4.3	5.2	6.1	7.0	8.0	9.1	10.0	10.8	11.7	Plux (kW/m²)
٠	*	,	٠	٠		*0	5.087	3.933	Qsb (MJ/m²)
910	860	810	760	710	660	610	\$60	510	Position (num)
•	ì	0				٠	•	£.	Time (s)
1.2	-		1.6	isc isc	2.2	2.6	3.0	3.6	Flux (kW/m²)
•		•			•		<b>(</b> 2)	3	Qsb (MJ/m²)

### Comments

Specimen extinguished naturally.

Thesa results relate only to the behaviour of the specimens of the product under the particular conditions of the test, they are not intended to be the sole enterior for assessing the potential fire bazard of the product in use,





Report produced with the Fire Testing Technology FRPSoft software

02-10-2014 Date

89206631 Project number

P482 |

89206331.02br Report number

Flooring Radiant Panel Single Specimen Report

Article Luxury Vinyl Tile

**Page** 8/11

Specimen description : Beige Click PVC MT14-15406367-40.02 : Cross #2 : D:\|FRPFILES\\\14090023.CSV : 4

: FIN ISO 9239-1:2002 : TÜV Rheinland Nederland B.V. : Tuv ShangHai 89206631 : Sep. 17 2014

est name

Date of test Sponsor Laboratory Standard

File name

Test number in series

Flux calibration file name ; C:\FRPSOFT\CALIB\FLX14014.CSV

Density (kg/m³) Thickness (mm)

Test duration 12 minutes 03 seconds (723 s) Yes

Substrate used? Substrate Fixing method Calcium silicate

: none : Yes : 23 : 50

Conditioned? Conditioning temp. (°C) Conditioning RH (%)

Test Results

Time to ignition Time to flameout 2 minutes 01 seconds (121 s) 112 minutes 02 seconds (722 s) 180

Extent of burning (mm)
Critical flux at extinguishment (kW/m²)
HF-10 (kW/m²) 9.63

HF-30 (kW/m²) HF-20 (kW/m²) :>= 10.9 :>= 10.9 : 180

Flame spread at 10 minutes (mm)
Flame spread at 20 minutes (mm)
Flame spread at 30 minutes (mm)
Peak light attenuation (%)

Time to peak light attenuation Total integrated smoke (%.min) : 30.04 : 7 minutes 29 seconds (449 s) : 129.52

Potential classification Smoke production classification : A2(f1)/B(f1) : s1

These results relate only to the behaviour of the specimens of the product under the particular conditions of the test, they not intended to be the sole enterior for assessing the potential fine hazard of the product in use.





Report produced with the Fire Testing Technology FRFSoft software


page 2

Report number 89206331.02br

Page 9/11

Luxury Vinyl Tile Article Project number 89206631

Date 02-10-2014

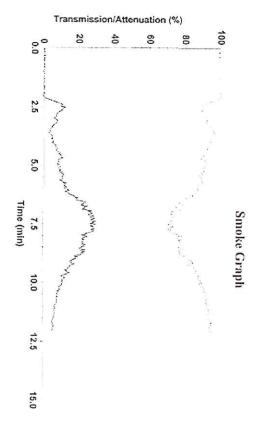

Test name : Cross #2
File name : D:\FRPFILES\14090023.CSV

### Rake Results

460	410	360	310	260	210	160	110	60	ositioa (nun)
	14	τ	ı			578	508	376	Time (s) I
4.3	5.2	6.1	7.0	8.0	9.1	10.0	10.8	11.7	lux (kW/m²)
3401	,	*		×	×	5,256	5.077	4.057	Qsb (MJ/m²)
016	860	810	760	710	660	610	560	510	Position (mm)
	æ		a			9 <b>3</b> 0	•	£	Time (s)
1.2	1.3	1.5	1.6	_ %	2.2	2.6	3.0	3.6	Flux (kW/m²)
				•	٠	*		•	Qsb (MII/m²)

Comments
Specimen extinguished naturally.

These results relate only to the behaviour of the specimens of the product under the garticular conditions of the test; they are not intended to be the sole criterion for assessing the potential fire hazard of the product in use.





Date

02-10-2014

89206631 Project number

APPENDIX I: Flooring Radiant Panel Single Specimen Report

Report produced with the Fire Testing Technology FRPSoft software

Report number 89206331.02br

page !

Article

Flooring Radiant Panel Single Specimen Report

Luxury Vinyl Tile

10/11 Page

Specimen description Beige Click PVC MT14-15406367-40.02 Cross #3 Standard Laboratory

Sponsor

: EN ISO 9239-1:2002 : TÜV Rheinland Nederland B.V. : Tuv ShangHai 89206631 : Sep. 17 2014

Date of test

File name Test number in series Test name D:\FRPFILES\14090024.CSV

Flux calibration file name : CAFRPSOFTACALIBAFLX14014.CSV

Thickness (nm) Density (kg/m³)

: 12 minutes 04 seconds (724 s) : Yes : Calcium siliente

Test duration Substrate used? Substrate

Fixing method Conditioned?

: none : Yes : 23 : 50

Conditioning temp. (°C) Conditioning RH (%)

Test Results

Time to ignition Time to flameout : 2 minutes 01 seconds (121 s) :12 minutes 03 seconds (723 s) :150 :10.15 :10.31

Extent of burning (mm)
Critical flux at extinguishment (kW/m²)
HF-10 (kW/m²)

HF-30 (kW/m²) HF-20 (kW/m²) : >= 10.9 : >= 10.9 : 140

Flame spread at 10 minutes (mm) Flame spread at 20 minutes (mm) Flame spread at 30 minutes (mm)

Peak light attenuation (%)
Time to peak light attenuation : 27.11 : 8 minutes 01 seconds (481 s) : 125.16

Potential classification Total integrated smoke (%.min)

Smoke production classification : A2(fi)/B(fi) : s1

These results relate only to the behaviour of the specimens of the product under the particular conditions of the test, they are not interded to be the sole criterion for assessing the potential fire hazard of the product in use.





Report produced with the Fire Testing Technology FRPSaft software

page 2

Report number 89206331.02br

Page 11/11

Luxury Vinyl Tile Article Project number 89206631

Date 02-10-2014

100 6 2.5 5.0 Time (mln) Smoke Graph 10.0 12.5 15.0

Transmission/Attenuation (%)

Test name: Cross #3
File name: D:\FRPFILES\14090024.CSV

## Rake Results

Position (mm) Time (s) Flux (kW/m²) Qsb (MJ/m²) Position (mm) Time (s) Flux (kW/m²) Qsb (MJ/m²) 110 160 210 260 310 360 410 11.7 10.8 10.0 9.1 8.0 7.0 6.1 8.2 4.159 5.087 510 560 610 660 710 760 810 860 

Comments
Specimen extinguished naturally.

These results relate only to the behaviour of the specimens of the product under the particular conditions of the test; they are not intended to be the sole enternor for assessing the potential fire bazard of the product in use.

SCS Global Services does hereby certify that an independent assessment has been conducted on behalf of:



For the following product(s):

## Vinyl Tile:

JH-LVT

This product meets all of the necessary qualifications to be certified for the following claim:

## **FloorScore**<sup>®</sup>

Indoor Air Quality Certified to SCS-EC10.3-2014

Conforms to the CDPH/EHLB Standard Method v1.1-2010 (effective January 1, 2012) for the school classroom and private office parameters when modeled as Flooring.

Measured Concentration of Total Volatile Organic Compounds (TVOC): Less than/equal to 0.5 mg/m³ (in compliance with CDPH/EHLB Standard Method v1.1-2010)

# Registration # SCS-FS-03809

Valid from: December 21, 2015 to December 31, 2016

SCS Global Services is currently the only certification body approved by the Resilient Floor Covering Institute (RFCI) to provide FloorScore® product certification; certified products are only listed on the SCS Green Products Guide, http://www.scsglobalservices.com/certified-green-products-guide.



CERTIFIED BY SCS Global Services

Hobert J. Huber

Robert J. Hrubes, Ph.D., Executive Vice President

2000 Powell Street, Ste. 600, Emeryville, CA 94608 USA

SCSGODO SERVICES





**Test Report** No.: SHHG1512050955SD Page: 1 of 3 Date: JAN. 07, 2016



The following sample(s) was/were submitted and identified by the client as:

: JH-LVT, LUXURY VINYL TILE, FLOORING USED Sample Description

**INDOOR** 

: JH-6005-1 Style/ Item No.

Manufacturer LALUR

Country of Destination : NETHERLANDS Sample Receiving Date : DEC. 21, 2015

**Testing Period** : DEC. 21, 2015 TO JAN. 07, 2016

**Test Performed** : SELECTED TEST(S) AS REQUESTED BY APPLICANT : DETERMINATION OF DIMENSIONAL STABILITY AND Test Requested

CURING AFTER EXPOSURE TO HEAT (EN ISO

23999:2012)

Test Result(s) : FOR FURTHER DETAILS, PLEASE REFER TO THE

FOLLOWING PAGE(S)

Conclusion : THE TEST DATA WERE PROVIDED TO CLIENT FOR

THEIR OWN ANALYSIS.

\*\*\*\*\*

Signed for and on behalf of

SGS-CSTC Standards Technical Services (Shanghai) Co., Ltd.

Yomoro Gu Supervisor







**Test Report** No.: SHHG1512050955SD Date: JAN. 07, 2016 Page: 2 of 3

### **Test Conducted:**

### Determination of dimensional stability and curing after exposure to heat (EN ISO 23999:2012)

Test Property	Test procedures/requirements	Rating/ Result
Determination of dimensional stability and curing after exposure to heat	<ol> <li>Measure the curling and dimension of the sample.</li> <li>Store the test pieces for 360+15 min in the oven, which had previously been stabilized at (80±2) °C.</li> <li>Remove the metal plates bearing the test pieces from the oven. Allow these to cool and recondition at a temperature of (23±2) °C and relative humidity (50±5) % for a further 24 h, unless otherwise specified for the product.</li> <li>After reconditioning, measure the dimensional changes to the test specimen.</li> <li>Measure the vertical distance between the support plate and the wear surface of the test specimen in four places around the edge (usually the corners), where the distance is greatest. Carryout the measurements with the micrometer.</li> <li>L<sub>0</sub> is the initial length L<sub>1</sub> is the length after test</li> </ol>	Curling: 0mm  Dimensional change: Length direction: 0.10% Width direction: 0.05%







### **Test Report**


No.: SHHG1512050955SD

Date: JAN. 07, 2016


Page: 3 of 3

### Sample Photo:

### Test sample (front view)



Test sample (back view)



SGS authenticate the photo on original report only

\*\*\*End of Report\*\*\*







Prüfbericht-Nr.: Test Report No.: 21233119 002

Auftrags-Nr.: Order No.:

3146078

Seite 1 von 10 Page 1 of 10

Kunden-Referenz-Nr.: Client Reference No.:

N/A

Auftragsdatum: Order date:

22.04.2014 2014-04-22

Auftraggeber:

Client:

**⊗LVLUS** 

Prüfgegenstand:

Test item:

**PVC-Bodenbelag** 

**PVC Floor Covering** 

Bezeichnung / Typ-Nr.: Luxury vinyl tile, N/A

Identification / Type No.:

Auftrags-Inhalt: Order content:

Prüfung auf die Emission flüchtiger organischer Substanzen (VOC)

Examination regarding the emissions of volatile organic compounds (VOC)

Prüfarundlage:

DEVL1101903D

Test specification:

Décret n° 2011-321 du 23 mars 2011 relatif à l'étiquetage des produits de construction ou de revêtement de mur ou de sol et des peintures et vernis sur leurs émissions de

polluants volatils

Wareneingangsdatum:

Date of receipt:

10.04.2015

2015-04-10

Prüfmuster-Nr.:

A000094327-001

Test sample No.: Prüfzeitraum:

Testing period:

14.04.2015 - 11.05.2015

2015-04-14 - 2015-05-11

Ort der Prüfung: Place of testing:

Emissionsprüfung Nürnberg **Emission Testing Nuremberg** 

Prüflaboratorium:

TÜV Rheinland LGA Products

Testing laboratory: **GmbH** 

Prüfergebnis\*: Test result\*:

geprüft von / tested by:

kontrolliert von / reviewed by:

11.05.2015

i.A. Dr. Bernd Maclej, Expert

**Pass** 

11.05.2015

Datum

Date

i.V. Dr. Christian Schelle, Head of laboratory

Datum Date

Name / Stellung Name / Position

Unterschrift Signature

Name / Stellung Name / Position

Unterschrift Signature

Sonstiges / Other:

Zustand des Prüfgegenstandes bei Anlieferung: Condition of the test item at delivery:

Prüfmuster vollständig und unbeschädigt Test item complete and undamaged

\* Legende:

1 = sehr gut

3 = befriedigend

4 = ausreichend

5 = mangelhaft

Legend:

P(ass) = entspricht o.g. Prüfgrundlage(n)

F(ail) = entspricht nicht o.g. Prüfgrundlage(n)

N/A = nicht anwendbar

N/T = nicht getestet

1 = very good

2 = good

3 = satisfactory

4 = sufficient

5 = poor

P(ass) = passed a.m. test specification(s)

F(ail) = failed a.m. test specification(s)

N/A = not applicable

N/T = not tested

Dieser Prüfbericht bezieht sich nur auf das o.g. Prüfmuster und darf ohne Genehmigung der Prüfstelle nicht auszugsweise vervielfältigt werden. Dieser Bericht berechtigt nicht zur Verwendung eines Prüfzeichens.

This test report only relates to the a. m. test sample. Without permission of the test center this test report is not permitted to be duplicated in extracts. This test report does not entitle to carry any test mark.





Prüfbericht-Nr.: 21233119 002

Test Report No.:

Seite 2 von 10 Page 2 of 10

### Liste der verwendeten Prüfmittel List of used test equipment

Prüfmittel Test equipment	Prüfmittel-Nr. / ID-Nr. Equipment No. / ID-No.	Nächste Kalibrierung Next calibration
Die Messunsicherheit wird auf Anfrage mitgeteilt /	Information on standard uncertain	nty on client's request.
Prüfkammer Nr. 69 / Test chamber Nr. 69	06829	12/2015
Probenahmepumpe Desaga 6 / Sampling pump Desaga 6	06958	03/2016
Probenahmepumpe Desaga 12 / Sampling pump Desaga 12	06878	03/2017
Probenahmepumpe GSA 3 / Sampling pump GSA 3	06824	12/2015
Probenahmepumpe GSA 4 / Sampling pump GSA 4	06820	12/2015
Seifenblasen-Durchflussmesser Gilian Nr. 6 / Air Flow Calibration System Gilian No. 6	06713	09/2016
Thermo-Hygrometer Lufft 1 / Thermo hygrometer Lufft 1	07887	08/2015
Spektral-Photometer (UV-VIS) Perkin-Elmer, Lambda 2 / Spectral-Photometer (UV-VIS) Perkin-Elmer, Lambda 2	06911	02/2016
GC - Agilent 7980A MS - Agilent 5975C, Thermodesorber – Turbo Matrix 650	06666 / 06667	12/2015



Prüfbericht-Nr.: 21233119 002

Test Report No.:

Seite 3 von 10 Page 3 of 10

## Produktbeschreibung Product description

1	Produktdetails Product details	PVC-Bodenbelag PVC Floor Covering
2	Hersteller Manufacturer	<b>♦LALU</b> R
3	Model / Programm Model / program	Luxory vinyl tile, Thickness: 5.0/0.55 mm, UV coating
4	Abmessung/ Dimension	457 mm x 457 mm x 5 mm
5	Artikel Nummer Article number	N/A
6	Chargen Nummer Batch number	ITT samples
7	Produktionsdatum Date of production	05.04.2015 2015-04-05
8	Verpackungsdatum Date of packaging	06.04.2015 2015-04-06
9	Sonstiges Other	Die detaillierten Untersuchungsergebnisse können der ADAM-Auswertemaske im Anhang entnommen werden./ Detailed information about the test results can be found in the attached ADAM evaluation mask.





Prüfbericht-Nr.: 21233119 002 Test Report No.: Seite 4 v			
Absatz	DEVL1101903D	Messergebnisse - Bemerkungen	Bewertung
Clause	Anforderungen - Prüfungen / Requirements - Tests	Measuring results - Remarks	Evaluation

## 1. Untersuchungsmethode / Examination method

## 1.1 Prüfkammermessung / Emission test chamber

Die Prüfkammeruntersuchung erfolgte entsprechend der DIN EN ISO 16000-9: Innenraumluftverunreinigungen – Teil 9: Bestimmung der Emission von flüchtigen organischen Verbindungen aus Bauprodukten und Einrichtungsgegenständen – Emissionsprüfkammer-Verfahren.

Testing in the test chamber was performed in accordance with DIN EN ISO 16000-9: Indoor air pollution – Part 9: Determining the emissions of volatile organic compounds from building materials and furnishings – Emission test chamber method.

Klimabedingungen\*) / Climatic conditions\*):

Kammervolumen / Chamber volume:  $0.25 \text{ m}^3$ Temperatur / Temperature:  $(23 \pm 1) ^{\circ}\text{C}$ Rel. Luftfeuchtigkeit / Rel. air humidity:  $50 \% \pm 3 \%$ Luftgeschwindigkeit / Air velocity: 0.1 bis 0.3 m/s

Luftwechselrate / Air exchange rate:  $1.25 \text{ m}^3/(\text{m}^2 \text{ h}) \pm 0.01 \text{ m}^3/(\text{m}^2 \text{ h})$ 

Folgende Probenahmen wurden durchgeführt:

#### Konditionierungsdauer 3 Tage

- VOC, mittels Tenax-Röhrchen, Analyse durch Thermodesorber/GC-MS
- Aldehyde, DNPH-Methode, Analyse durch HPLC/DAD

### Konditionierungsdauer 7 Tage

- VOC, mittels Tenax-Röhrchen, Analyse durch Thermodesorber/GC-MS
- Aldehyde, DNPH-Methode, Analyse durch HPLC/DAD

#### GC Systembeschreibung:

- GC Agilent 6890N, MS Agilent 5973, Thermodesorber Perkin Elmer ATD 400
- Säule RTX-200, 60 m x 0,32 mm x 1 μm von Restek

#### **HPLC-Systembeschreibung:**

- HPLC Agilent 1200-System mit Dioden Array Detector (DAD)
- Macherey & Nagel, EC50/4 Nucleodur Sphinx RP 1.8 μm

<sup>\*)</sup> Zahlenangaben in englischer Schreibweise / Values in English notation







	Prüfbericht-Nr.: 21233119 002 Test Report No.:		
Absatz	DEVL1101903D	Messergebnisse - Bemerkungen	Bewertung
Clause	Anforderungen - Prüfungen / Requirements - Tests	Measuring results - Remarks	Evaluation

Sampling was performed as follows:

#### 3 days of conditioning

- VOC, using Tenax tubes, analysed using thermo desorption/GC-MS
- aldehydes, DNPH technique, analysed using HPLC/DAD

### 7 days of conditioning

- VOC, using Tenax tubes, analysed using thermo desorption/GC-MS
- aldehydes, DNPH technique, analysed using HPLC/DAD

### GC system description:

- GC Agilent 6890N, MS Agilent 5973, Thermodesorber Perkin Elmer ATD 400
- Restek GC-column RTX-200, 60 m x 0.32 mm x 1 μm

#### HPLC system description:

- HPLC Agilent 1100/1200-system, Dioden Array Detector (DAD)
- column Macherey & Nagel, EC50/4 Nucleodur Sphinx RP 1.8 μm

### 1.2 Prüfmethoden / Test methods

DIN ISO 16000-3:2013-01: Innenraumluftverunreinigungen - Teil 3: Messen von Formaldehyd und anderen Carbonylverbindungen in der Innenraumluft und in Prüfkammern - Probenahme mit einer Pumpe (ISO 16000-3:2011)

DIN ISO 16000-6:2012-11: Innenraumluftverunreinigungen - Teil 6: Bestimmung von VOC in der Innenraumluft und in Prüfkammern, Probenahme auf Tenax TA®, thermische Desorption und Gaschromatographie mit MS oder MS-FID (ISO 16000-6:2011)

DIN EN ISO 16000-9:2008-04: Innenraumluftverunreinigungen - Teil 9: Bestimmung der Emission von flüchtigen organischen Verbindungen aus Bauprodukten und Einrichtungsgegenständen - Emissionsprüfkammer-Verfahren (ISO 16000-9:2006); Deutsche Fassung EN ISO 16000-9:2006







Prüfbericht-Nr.: 21233119 002 Test Report No.: Seite 6 Page			
Absatz	DEVL1101903D	Messergebnisse - Bemerkungen	Bewertung
Clause	Anforderungen - Prüfungen / Requirements - Tests	Measuring results - Remarks	Evaluation

DIN ISO 16000-3:2013-01: Indoor air - Part 3: Determination of formaldehyde and other carbonyl compounds in indoor air and test chamber air - Active sampling method (ISO 16000-3:2011)

DIN ISO 16000-6:2012-11: Indoor air - Part 6: Determination of volatile organic compounds in indoor and test chamber air by active sampling on Tenax TA® sorbent, thermal desorption and gas chromatography using MS or MS-FID (ISO 16000-6:2011)

DIN EN ISO 16000-9:2008-04: Indoor air - Part 9: Determination of the emission of volatile organic compounds from building products and furnishing - Emission test chamber method (ISO 16000-9:2006); German version EN ISO 16000-9:2006

# 2. Untersuchungsergebnisse / Examination results

Die detaillierten Untersuchungsergebnisse können der Tabelle 1 und der Einzelstoffliste im Anhang entnommen werden.

The detailed examination results can be seen in table 1 and in the attached list of detected compounds.





Prüfbericht-Nr.: 21233119 002 Test Report No.: Seite 7 von Page 7 of				
Absatz	DEVL1101903D	Messergebnisse - Bemerkungen	Bewertung	
Clause	Anforderungen - Prüfungen / Requirements - Tests	Measuring results - Remarks	Evaluation	

Table 1: Einstufung entsprechend Décret n° 2011-321 Table 1: Classification according to Décret n° 2011-321

Substances	CAS Nr. Cas no		Emission Class [µg/m³]			
		A+	А	В	С	
Formaldehyd Formaldehyde	50-00-0	< 10	< 60	< 120	> 120	2
Acetaldehyd Acetaldehyde	75-07-0	< 200	< 300	< 400	> 400	2
Toluol Toluene	108-88-3	< 300	< 450	< 600	> 600	79
Tetrachlorethylen Tetrachloroethylene	127-18-4	< 250	< 350	< 500	> 500	< 1
Xylol Xylene	1330-20-7	< 200	< 300	< 400	> 400	< 1
1,2,4-Trimethylbenzol 1,2,4-Trimethylbenzene	95-63-6	< 1,000	< 1,500	< 2,000	> 2,000	< 1
1,4-Dichlorobenzol 1,4-Dichlorobenzene	106-46-7	< 60	< 90	< 120	> 120	< 1
Ethylbenzol Ethylbenzene	100-41-4	< 750	< 1,000	< 1,500	> 1,500	< 1
2-Butoxyethanol 2-Butoxyethanol	111-76-2	< 1,000	< 1,500	< 2,000	> 2,000	< 1
Styrol Styrene	100-42-5	< 250	< 350	< 500	> 500	< 1
TVOC <sup>1</sup>	-/-	< 1,000	< 1,500	< 2,000	> 2,000	162

<sup>&</sup>lt;sup>1</sup> TVOC: Summe flüchtige organische Verbindungen im Retentionszeitbereich  $C_6 - C_{22}$  / TVOC: total volatile organic compounds within retention range of  $C_6 - C_{22}$ 








Prüfbericht-Nr.: 21233119 002 Test Report No.:			
Absatz	DEVL1101903D	Messergebnisse - Bemerkungen	Bewertung
Clause	Anforderungen - Prüfungen / Requirements - Tests	Measuring results - Remarks	Evaluation

## 3. Beurteilung / Evaluation

Das geprüfte Produkt "Luxury vinyl tile" wurde entsprechend der französischen VOC-Kennzeichnungsverordnung Décret DEVL1101903D, veröffentlicht am 23. März 2011 und des Erlasses Arrêté DEVL1104875A, veröffentlicht am 13. Mai 2011 in die Emissionsklasse A+eingestuft.

The tested product "Luxury vinyl tile" has been evaluated to the French VOC labelling regulation as published on March 23, 2011 (Décret DEVL1101903D) and the order as published on May 13, 2011 (Arrêté DEVL1104875A) as emission class A+.

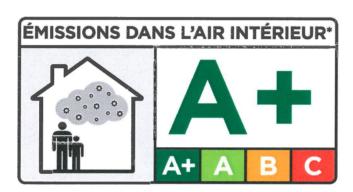





Prüfbericht-Nr.: 21233119 002 Test Report No.: Seit				
Absatz	DEVL1101903D	Messergebnisse - Bemerkungen	Bewertung	
Clause	Anforderungen - Prüfungen / Requirements - Tests	Measuring results - Remarks	Evaluation	

Tabelle 2. Detektierte Einzelkomponenten in μg/m³

Table 2: Detected compounds in ug/m<sup>3</sup>

Substant / Commound	CAC#	Konzentration / Concentration		
Substanz / Compound	CAS#	3 Tage / 3 days	7 Tage / 7 days	
Formaldehyd (VVOC) / Formaldehyde (VVOC) 1)	50-00-0	2.0	1.8	
Acetaldehyd (VVOC) / Acetaldehyde (VVOC)	75-07-0	2.0	1.6	
Toluol / Toluene <sup>2)</sup>	108-88-3	86	79	
n-Butanol / n-Butanol	71-36-3	1.9	1.9	
2-Ethyl-1-hexanol / 2-Ethyl-1-hexanol	104-76-7	7.2	4.4	
1-Methoxy-2-propanol / 1-Methoxy-2-propanol	107-98-2	1.6	1.1	
n-Nonanal / n-Nonanal	124-19-6	3.0	2.3	
n-Decanal / n-Decanal	112-31-2	2.0	2.3	
Aceton (VVOC) / Acetone (VVOC)	67-64-1	4.7	3.6	
Butanon / Butanone	78-93-3	53	37	
4-Methyl-2-pentanon / 4-Methyl-2-pentanone	108-10-1	1.7	1.4	
Cyclohexanone	108-94-1	3.0	2.9	
Ethylacetat (VVOC) / Ethyl acetate (VVOC)	141-78-6	7.1	5.2	
n-Butylacetat / n-Butyl acetate	123-86-4	2.3	1.9	
Dimethylphthalat / Methyl phthalate(SVOC) 3)	131-11-3	2.7	1.2	
n-Propylacetat / n-Propyl acetate	109-60-4	27	23	
2-Phenylpropen / 2-Phenylpropene	98-83-9	1.4	1.1	
Benzaldehyd / Benzaldehyde	100-52-7	2.5	1.9	
Acetophenon / Acetophenone	98-86-2	2.0	1.4	

<sup>1)</sup> VVOC: leichtflüchtige organische Verbindungen / VVOC: very volatile organic compounds

<sup>&</sup>lt;sup>2)</sup> Reproduktionstoxizität, Kategorie 2, EG-Einstufung gemäß Verordnung (EG) Nr. 1272/2008 / Reproductive toxicity, Category 2, EC classification according to Regulation (EC) No 1272/2008

<sup>&</sup>lt;sup>3)</sup> SVOC: schwerflüchtige organische Verbindungen / SVOC: semi volatile organic compounds



			e 10 von 10 age 10 of 10
Absatz	DEVL1101903D	Messergebnisse - Bemerkungen	Bewertung
Clause	Anforderungen - Prüfungen / Requirements - Tests	Measuring results - Remarks	Evaluation

# Attestation

Based on the Test Report No. 21233119 002 the product

Luxury vinyl tile, Article No.: N/A



has been evaluated in compliance with the French VOC labelling regulation as published on March 23, 2011 (Décret DEVL1101903D) and the order as published on May 13, 2011 (Arrêté DEVL1104875A) as

Emission class A+



11.05.2015

Dr. Bernd Maeiej

**Expert** 

Dr. Christian Schelle

Head of Laboratory



No. CANEC1513030015

Date: 31 Jul 2015

Page 1 of 15



The following sample(s) was/were submitted and identified on behalf of the clients as: Hot Melt Adhesive

SGS Job No.: CP15-042965 - GZ

Tested Sample Info. : HM-811M

Client Ref. Info.: HM-811M, HM-815LKF, HM-866HF, HM-803KF, HM-805KF, HM-837KF,

HM-868KF, HM-823K, HM-828T, HM-837, HM-801Y, HM-825, HM-806, HM-823L, HM-868, HM-801E, HM-805, HM-256, HM-259PF, HM-220

Date of Sample Received: 27 Jul 2015

Testing Period: 27 Jul 2015 - 31 Jul 2015

Test Requested:

As requested by client, SVHC screening is performed according to:

(i) One hundred and sixty three (163) substances in the Candidate List of Substances of Very High Concern (SVHC) for authorization published by European Chemicals Agency (ECHA) on and before Jun 15, 2015 regarding

Regulation (EC) No 1907/2006 concerning the REACH.

Test Results: Please refer to next page(s).

Summary:

According to the specified scope and analytical techniques, concentrations of tested	PASS
SVHC are ≤ 0.1% (w/w) in the submitted sample.	

Signed for and on behalf of

Almay

SGS-CSTC Standards Technical Services Co., Ltd. Guangzhou Branch

Almay Gao

Approved Signatory



This document is issued by the Company subject to its General Conditions of Service printed overleaf, available on request or accessible at <a href="http://www.sgs.com/en/Terms-and-Conditions.aspx">http://www.sgs.com/en/Terms-and-Conditions.aspx</a> and, for electronic format documents, subject to Terms and Conditions for Electronic Documents at <a href="http://www.sgs.com/en/Terms-and-Conditions/Terms-a-Document.aspx">http://www.sgs.com/en/Terms-and-Conditions/Terms-a-Document.aspx</a>. Attention is drawn to the limitation of liability, indemnification and jurisdiction issues defined therein. Any holder of this document is advised that information contained hereon reflects the Company's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Company's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents. This document cannot be reproduced except in full, without prior written approval of the Company. Any unauthorized alteration, forgery or falsification of the content or appearance of this document is unlawful and offenders may be prosecuted to the fullest extent of the law. Unless otherwise stated the results shown in this test report refer only to the sample(s) tested.

\*\*Attention\*\* Technick the authenticity of testing inspection report & certificate, please conjugate use ttemplone; (86-758) 8307 1443.

Attention: To check the authenticity of testing /inspection report & certificate, please contact us attelephone: (86-755) 8307 1443, or email: CN\_Doccheck@sgs.com

[198 Kezhu Road,Scientech Park Guangzhou Economic & Technology Development District, Guangzhou, China 510663 t (86-20) 82155555 f (86-20) 82075113 www.sgsgroup.com.cn

中国·广州·经济技术开发区科学城科珠路198号 邮编: 510663 t (86-20) 82155555 f (86-20) 82075113 e sgs.china@sgs.com





Date: 31 Jul 2015

# Test Report (SVHC)

No. CANEC1513030015

Page 2 of 15

#### Remark:

(1) The chemical analysis of specified SVHC is performed by means of currently available analytical techniques against the following SVHC related documents published by ECHA: http://echa.europa.eu/web/guest/candidate-list-table

These lists are under evaluation by ECHA and may subject to change in the future.

#### (2) Concerning article(s):

In accordance with Regulation (EC) No 1907/2006, any EU producer or importer of articles shall notify ECHA, in accordance with paragraph 4 of Article 7, if a substance meets the criteria in Article 57 and is identified in accordance with Article 59(1) of the Regulation, if (a) the substance in the Candidate List is present in those articles in quantities totaling over one tonne per producer or importer per year; and (b) the substance in the Candidate List is present in those articles above a concentration of 0.1% weight by weight (w/w).

Article 33 of Regulation (EC) No 1907/2006 requires supplier of an article containing a substance meeting the criteria in Article 57 and identified in accordance with Article 59(1) in a concentration above 0.1% weight by weight (w/w) shall provide the recipient of the article with sufficient information, available to the supplier, to allow safe use of the article including, as a minimum, the name of that substance in the Candidate List.

SGS adopts the interpretation of ECHA for SVHC in article unless indicated otherwise. Detail explanation is available at the following link:

http://webstage.contribute.sgs.net/corpreach/documents/SGS-CTS\_SVHC-paper-EN-11.pdf

#### (3) Concerning material(s):

Test results in this report are based on the tested sample. This report refers to testing result of tested sample submitted as homogenous material(s). In case such material is being used to compose an article, the results indicated in this report may not represent SVHC concentration in such article. If this report refers to testing result of composite material group by equal weight proportion, the material in each composite test group may come from more than one article.

If the sample is a substance or mixture, and it directly exports to EU, client has the obligation to comply with the supply chain communication obligation under Article 31 of Regulation (EC) No. 1907/2006 and the conditions of Authorization of substance of very high concern included in the Annex XIV of the Regulation (EC) No. 1907/2006.

### (4) Concerning substance and preparation:

If a SVHC is found over 0.1% (w/w) and/or the specific concentration limit which is set in Regulation (EC) No 1272/2008 and No 790/2009, client is suggested to prepare a Safety Data Sheet (SDS) against the SVHC to comply with the supply chain communication obligation under Regulation (EC) No 1907/2006, in which:

- a substance that is classified as hazardous under the CLP Regulation (EC) No 1272/2008.
- a mixture that is classified as dangerous according Dangerous Preparations Directive



This document is issued by the Company subject to its General Conditions of Service printed overleaf, available on request or accessible at <a href="http://www.sgs.com/en/Terms-and-Conditions.aspx">http://www.sgs.com/en/Terms-and-Conditions.aspx</a> and, for electronic format documents, subject to Terms and Conditions for Electronic Documents at <a href="http://www.sgs.com/en/Terms-and-Conditions/Terms-a-Document.aspx">http://www.sgs.com/en/Terms-and-Conditions/Terms-a-Document.aspx</a>. Attention is drawn to the limitation of liability indemnification and jurisdiction issues defined therein. Any holder of this document is advised that information contained hereon reflects the Company's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Company's sole responsibility is to its Client and this document does not expertise to a transaction from exercising all their rights and obligations under the transaction documents. This document cannot be reproduced except in full, without prior written approval of the Company. Any unauthorized atteration, forgery or falsification of the content or appearance of this document is unlawful and offenders may be prosecuted to the fullest extent of the law. Unless otherwise stated the results shown in this test report refer only to the sample(s) tested.

\*\*Attention:\*\*To check the authenticity of testing inspection report & certificate, please contact us at telephone; (86-755) 8307 1443.

198 Kezhu Road, Scientech Park Guangzhou Economic & Technology Development District, Guangzhou, China 510663 t (86-20) 82155555 f (86-20) 82075113 www.sgsgroup.com.cn 中国・广州・经济技术开发区科学城科珠路198号 邮编: 510663 t (86-20) 82155555 f (86-20) 82075113 e sgs.china@sgs.com





No. CANEC1513030015

Page 3 of 15

1999/45/EC or classified as hazardous under the CLP Regulation (EC) No 1272/2008, when their concentrations are equal to, or greater than, those defined in the Article 3(3) of 1999/45/EC or the lower values given in Part 3 of Annex VI of Regulation (EC) No. 1272/2008; or

Date: 31 Jul 2015

- a mixture is not classified as dangerous under Directive 1999/45/EC, but contains either:
- (a) a substance posing human health or environmental hazards in an individual concentration of  $\geq$  1 % by weight for mixtures that are solid or liquids (i.e., non-gaseous mixtures) or  $\geq$  0.2 % by volume for gaseous mixtures; or
- (b) a substance that is PBT, or vPvB in an individual concentration of ≥ 0.1 % by weight for mixtures that are solid or liquids (i.e., non-gaseous mixtures); or
- (c) a substance on the SVHC candidate list (for reasons other than those listed above), in an individual concentration of  $\geq 0.1$  % by weight for non-gaseous mixtures; or
- (d) a substance for which there are Europe-wide workplace exposure limits.
- (5) If a SVHC is found over the reporting limit, client is suggested to identify the component which contains the SVHC and the exact concentration of the SVHC by requesting further quantitative analysis from the laboratory.

#### Test Sample:

#### Sample Description:

Specimen No. SGS Sample ID Description

SN1 CAN15-130300.008 Transparent soft material

#### Test Method:

SGS In-House method- GZTC CHEM-TOP-092-01, GZTC CHEM-TOP-092-02, Analyzed by ICP-OES, UV-VIS, GC-MS, HPLC-DAD/MS and Colorimetric Method.







No. CANEC1513030015

Date: 31 Jul 2015

Page 4 of 15

#### Test Result: (Substances in the Candidate List of SVHC)

Batch	Substance Name	CAS No.	008 Concentration (%)	RL (%)
-	All tested SVHC in candidate list	-	ND	-

#### Notes:

- 1.The table above only shows detected SVHC, and SVHC that below RL are not reported. Please refer to Appendix for the full list of tested SVHC.
- 2.RL = Reporting Limit. All RL are based on homogenous material.ND = Not detected (lower than RL), ND is denoted on the SVHC substance.
- 3.\*The test result is based on the calculation of selected element(s) / marker(s) and to the worst-case scenario. For detail information, please refer to the SGS REACH
- website: www.reach.sgs.com/substance-of-very-high-concern-analysis-information-page.htm.
- 4. RL = 0.005% is evaluated for element (i.e. cobalt, arsenic, lead, chromium (VI), aluminum, zirconium, boron, strontium, zinc, antimony, cadmium, titanium and barium respectively), except molybdenum RL=0.0005%, boron RL=0.0025% (only for Lead bis(tetrafluoroborate)).
- 5. Calculated concentration of boric compounds are based on the water extractive boron by ICP-OES.
- 6.  $\triangle$  CAS No. of diastereoisomers identified (α-HBCDD, β-HBCDD, γ-HBCDD): 134237-50-6, 134237-51-7, 134237-52-8.
- 7. ★ CAS No. of Hexahydromethylphthalic anhydride, Hexahydro-4-methylphthalic anhydride, Hexahydro-1-methylphthalic anhydride, Hexahydro-3-methylphthalic anhydride: 25550-51-0, 19438-60-9, 48122-14-1, 57110-29-9; EC No. of those: 247-094-1, 243-072-0, 256-356-4, 260-566-1.
- 8. § The substance is proposed for the identification as SVHC only where it contains Michler's ketone (CAS Number: 90-94-8) or Michler's base (CAS Number: 101-61-1) ≥0.1% (w/w).







No. CANEC1513030015

Date: 31 Jul 2015

Page 5 of 15

### **Appendix**

### Full list of tested SVHC:

Batch	No.	Substance Name	CAS No.	RL (%)
I	1	4,4' -Diaminodiphenylmethane(MDA)	101-77-9	0.050
I	2	5-tert-butyl-2,4,6-trinitro-m-xylene (musk xylene)	81-15-2	0.050
I	3	Alkanes, C10-13, chloro (Short Chain Chlorinated Paraffins)	85535-84-8	0.050
I	4	Anthracene	120-12-7	0.050
I	5	Benzyl butyl phthalate (BBP)	85-68-7	0.050
I	6	Bis (2-ethylhexyl)phthalate (DEHP)	117-81-7	0.050
I	7	Bis(tributyltin)oxide (TBTO)	56-35-9	0.050
I	8	Cobalt dichloride*	7646-79-9	0.005
I	9	Diarsenic pentaoxide*	1303-28-2	0.005
I	10	Diarsenic trioxide*	1327-53-3	0.005
I	11	Dibutyl phthalate (DBP)	84-74-2	0.050
ı	12	Hexabromocyclododecane (HBCDD) and all major diastereoisomers identified (α-HBCDD, β-HBCDD, γ-HBCDD) <sup>Δ</sup>	25637-99-4, 3194- 55-6	0.050
I	13	Lead hydrogen arsenate*	7784-40-9	0.005
ı	14	Sodium dichromate*	7789-12-0, 10588-01-9	0.005
I	15	Triethyl arsenate*	15606-95-8	0.005
II	16	2,4-Dinitrotoluene	121-14-2	0.050
II	17	Acrylamide	79-06-1	0.050
II	18	Anthracene oil*	90640-80-5	0.050
II	19	Anthracene oil, anthracene paste*	90640-81-6	0.050
II	20	Anthracene oil, anthracene paste, anthracene fraction*	91995-15-2	0.050







No. CANEC1513030015

Date: 31 Jul 2015

Page 6 of 15

### **Appendix**

### Full list of tested SVHC:

Batch	No.	Substance Name	CAS No.	RL (%)
II	21	Anthracene oil, anthracene paste, distn. lights*	91995-17-4	0.050
II	22	Anthracene oil, anthracene-low*	90640-82-7	0.050
II	23	Diisobutyl phthalate	84-69-5	0.050
II	24	Lead chromate*	7758-97-6	0.005
II	25	Lead chromate molybdate sulphate red (C.I. Pigment Red 104)*	12656-85-8	0.005
II	26	Lead sulfochromate yellow (C.I. Pigment Yellow 34)*	1344-37-2	0.005
II	27	Pitch, coal tar, high temp.*	65996-93-2	0.050
II	28	Tris(2-chloroethyl)phosphate	115-96-8	0.050
III	29	Ammonium dichromate*	7789-09-5	0.005
III	30	Boric acid*	10043-35-3, 11113-50-1	0.005
III	31	Disodium tetraborate, anhydrous*	1303-96-4, 1330-43-4, 12179-04-3	0.005
III	32	Potassium chromate*	7789-00-6	0.005
III	33	Potassium dichromate*	7778-50-9	0.005
III	34	Sodium chromate*	7775-11-3	0.005
III	35	Tetraboron disodium heptaoxide, hydrate*	12267-73-1	0.005
III	36	Trichloroethylene	79-01-6	0.050
IV	37	2-Ethoxyethanol	110-80-5	0.050
IV	38	2-Methoxyethanol	109-86-4	0.050
IV	39	Chromic acid, Oligomers of chromic acid and dichromic acid, Dichromic acid*	7738-94-5 - 13530-68-2	0.005







No. CANEC1513030015

Date: 31 Jul 2015

Page 7 of 15

### **Appendix**

### Full list of tested SVHC:

Batch	No.	Substance Name	CAS No.	RL (%)
IV	40	Chromium trioxide*	1333-82-0	0.005
IV	41	Cobalt(II) carbonate*	513-79-1	0.005
IV	42	Cobalt(II) diacetate*	71-48-7	0.005
IV	43	Cobalt(II) dinitrate*	10141-05-6	0.005
IV	44	Cobalt(II) sulphate*	10124-43-3	0.005
V	45	1,2,3-trichloropropane	96-18-4	0.050
V	46	1,2-Benzenedicarboxylic acid, di-C6-8-branched alkyl esters, C7-rich	71888-89-6	0.050
V	47	1,2-Benzenedicarboxylic acid, di-C7-11-branched and linear alkyl esters	68515-42-4	0.050
V	48	1-methyl-2-pyrrolidone	872-50-4	0.050
V	49	2-ethoxyethyl acetate	111-15-9	0.050
V	50	Hydrazine	7803-57-8, 302-01-2	0.050
V	51	Strontium chromate*	7789-06-2	0.005
VI	52	1,2-Dichloroethane	107-06-2	0.050
VI	53	2,2'-dichloro-4,4'-methylenedianiline	101-14-4	0.050
VI	54	2-Methoxyaniline; o-Anisidine	90-04-0	0.050
VI	55	4-(1,1,3,3-tetramethylbutyl)phenol	140-66-9	0.050
VI	56	Aluminosilicate Refractory Ceramic Fibres *	650-017-00-8 (Index no.)	0.005
VI	57	Arsenic acid*	7778-39-4	0.005
VI	58	Bis(2-methoxyethyl) ether	111-96-6	0.050
VI	59	Bis(2-methoxyethyl) phthalate	117-82-8	0.050







No. CANEC1513030015

Date: 31 Jul 2015

Page 8 of 15

### **Appendix**

### Full list of tested SVHC:

Batch	No.	Substance Name	CAS No.	RL (%)
VI	60	Calcium arsenate*	7778-44-1	0.005
VI	61	Dichromium tris(chromate) *	24613-89-6	0.005
VI	62	Formaldehyde, oligomeric reaction products with aniline	25214-70-4	0.050
VI	63	Lead diazide, Lead azide*	13424-46-9	0.005
VI	64	Lead dipicrate*	6477-64-1	0.005
VI	65	Lead styphnate*	15245-44-0	0.005
VI	66	N,N-dimethylacetamide	127-19-5	0.050
VI	67	Pentazinc chromate octahydroxide*	49663-84-5	0.005
VI	68	Phenolphthalein	77-09-8	0.050
VI	69	Potassium hydroxyoctaoxodizincatedichromate*	11103-86-9	0.005
VI	70	Trilead diarsenate*	3687-31-8	0.005
VI	71	Zirconia Aluminosilicate Refractory Ceramic Fibres*	650-017-00-8 (Index no.)	0.005
VII	72	[4-[[4-anilino-1-naphthyl][4- (dimethylamino)phenyl]methylene]cyclohexa-2,5-dien-1-ylide ne] dimethylammonium chloride (C.I. Basic Blue 26)§	2580-56-5	0.050
VII	73	[4-[4,4'-bis(dimethylamino) benzhydrylidene]cyclohexa-2,5-dien-1-ylidene]dimethylamm onium chloride (C.I. Basic Violet 3)§	548-62-9	0.050
VII	74	1,2-bis(2-methoxyethoxy)ethane (TEGDME; triglyme)	112-49-2	0.050
VII	75	1,2-dimethoxyethane; ethylene glycol dimethyl ether (EGDME)	110-71-4	0.050
VII	76	4,4'-bis(dimethylamino) benzophenone (Michler's Ketone)	90-94-8	0.050
VII	77	4,4'-bis(dimethylamino)-4"-(methylamino)trityl alcohol§	561-41-1	0.050
VII	78	Diboron trioxide*	1303-86-2	0.005







No. CANEC1513030015

Date: 31 Jul 2015

Page 9 of 15

## **Appendix**

### Full list of tested SVHC:

Batch	No.	Substance Name	CAS No.	RL (%)
VII	79	Formamide	75-12-7	0.050
VII	80	Lead(II) bis(methanesulfonate)*	17570-76-2	0.005
VII	81	N,N,N',N'-tetramethyl-4,4'-methylenedianiline (Michler's base)	101-61-1	0.050
VII	82	TGIC (1,3,5-tris(oxiranylmethyl) -1,3,5-triazine-2,4,6(1H,3H,5H)-trione)	2451-62-9	0.050
VII	83	α,α-Bis[4-(dimethylamino)phenyl]-4 (phenylamino)naphthalene-1-methanol (C.I. Solvent Blue 4) §	6786-83-0	0.050
VII	84	β-TGIC (1,3,5-tris[(2S and 2R)-2,3-epoxypropyl] -1,3,5-triazine-2,4,6-(1H,3H,5H)-trione)	59653-74-6	0.050
VIII	85	[Phthalato(2-)]dioxotrilead*	69011-06-9	0.005
VIII	86	1,2-Benzenedicarboxylic acid, dipentylester, branched and linear	84777-06-0	0.050
VIII	87	1,2-Diethoxyethane	629-14-1	0.050
VIII	88	1-Bromopropane	106-94-5	0.050
VIII	89	3-Ethyl-2-methyl-2-(3-methylbutyl)-1,3-oxazolidine	143860-04-2	0.050
VIII	90	4-(1,1,3,3-tetramethylbutyl)phenol, ethoxylated	-	0.050
VIII	91	4,4'-Methylenedi-o-toluidine	838-88-0	0.050
VIII	92	4,4'-Oxydianiline and its salts	101-80-4	0.050
VIII	93	4-Aminoazobenzene	60-09-3	0.050
VIII	94	4-Methyl-m-phenylenediamine	95-80-7	0.050
VIII	95	4-Nonylphenol, branched and linear	-	0.050
VIII	96	6-Methoxy-m-toluidine	120-71-8	0.050
VIII	97	Acetic acid, lead salt, basic*	51404-69-4	0.005







No. CANEC1513030015

Date: 31 Jul 2015

Page 10 of 15

### **Appendix**

### Full list of tested SVHC:

Batch	No.	Substance Name	CAS No.	RL (%)
VIII	98	Biphenyl-4-ylamine	92-67-1	0.050
VIII	99	Bis(pentabromophenyl) ether (DecaBDE)	1163-19-5	0.050
VIII	100	Cyclohexane-1,2-dicarboxylic anhydride, cis-cyclohexane-1,2-dicarboxylic anhydride, trans-cyclohexane-1,2-dicarboxylic anhydride	85-42-7, 13149-00-3, 14166-21-3	0.050
VIII	101	Diazene-1,2-dicarboxamide (C,C'-azodi(formamide))	123-77-3	0.050
VIII	102	Dibutyltin dichloride (DBTC)	683-18-1	0.050
VIII	103	Diethyl sulphate	64-67-5	0.050
VIII	104	Diisopentylphthalate	605-50-5	0.050
VIII	105	Dimethyl sulphate	77-78-1	0.050
VIII	106	Dinoseb	88-85-7	0.050
VIII	107	Dioxobis(stearato)trilead*	12578-12-0	0.005
VIII	108	Fatty acids, C16-18, lead salts*	91031-62-8	0.005
VIII	109	Furan	110-00-9	0.050
VIII	110	Henicosafluoroundecanoic acid	2058-94-8	0.050
VIII	111	Heptacosafluorotetradecanoic acid	376-06-7	0.050
VIII	112	Hexahydromethylphathalic anhydride, Hexahydro-4-methylphathalic anhydride, Hexahydro-1-methylphathalic anhydride, Hexahydro-3-methylphathalic anhydride	A	0.050
VIII	113	Lead bis(tetrafluoroborate)*	13814-96-5	0.005
VIII	114	Lead cyanamidate*	20837-86-9	0.005
VIII	115	Lead dinitrate*	10099-74-8	0.005
VIII	116	Lead monoxide*	1317-36-8	0.005







No. CANEC1513030015

Date: 31 Jul 2015

Page 11 of 15

### **Appendix**

### Full list of tested SVHC:

Batch	No.	Substance Name	CAS No.	RL (%)
VIII	117	Lead oxide sulfate*	12036-76-9	0.005
VIII	118	Lead tetroxide (orange lead)*	1314-41-6	0.005
VIII	119	Lead titanium trioxide*	12060-00-3	0.005
VIII	120	Lead titanium zirconium oxide*	12626-81-2	0.005
VIII	121	Methoxyacetic acid	625-45-6	0.050
VIII	122	Methyloxirane (Propylene oxide)	75-56-9	0.050
VIII	123	N,N-dimethylformamide	68-12-2	0.050
VIII	124	N-Methylacetamide	79-16-3	0.050
VIII	125	N-Pentyl-isopentylphthalate	776297-69-9	0.050
VIII	126	o-Aminoazotoluene	97-56-3	0.050
VIII	127	o-Toluidine	95-53-4	0.050
VIII	128	Pentacosafluorotridecanoic acid	72629-94-8	0.050
VIII	129	Pentalead tetraoxide sulphate*	12065-90-6	0.005
VIII	130	Pyrochlore, antimony lead yellow*	8012-00-8	0.005
VIII	131	Silicic acid, barium salt, lead-doped*	68784-75-8	0.005
VIII	132	Silicic acid, lead salt*	11120-22-2	0.005
VIII	133	Sulfurous acid, lead salt, dibasic*	62229-08-7	0.005
VIII	134	Tetraethyllead*	78-00-2	0.005
VIII	135	Tetralead trioxide sulphate*	12202-17-4	0.005
VIII	136	Tricosafluorododecanoic acid	307-55-1	0.050
VIII	137	Trilead bis(carbonate)dihydroxide (basic lead carbonate)*	1319-46-6	0.005







No. CANEC1513030015

Date: 31 Jul 2015

Page 12 of 15

### **Appendix**

### Full list of tested SVHC:

Batch	No.	Substance Name	CAS No.	RL (%)
VIII	138	Trilead dioxide phosphonate*	12141-20-7	0.005
IX	139	4-Nonylphenol, branched and linear, ethoxylated	-	0.050
IX	140	Ammonium pentadecafluorooctanoate (APFO)	3825-26-1	0.050
IX	141	Cadmium oxide*	1306-19-0	0.005
IX	142	Cadmium*	7440-43-9	0.005
IX	143	Dipentyl phthalate (DPP)	131-18-0	0.050
IX	144	Pentadecafluorooctanoic acid (PFOA)	335-67-1	0.050
Х	145	Cadmium sulphide*	1306-23-6	0.005
Х	146	Dihexyl phthalate	84-75-3	0.050
Х	147	Disodium 3,3'-[[1,1'-biphenyl] -4,4'-diylbis(azo)]bis(4-aminonaphthalene-1-sulphonate) (C.I. Direct Red 28)	573-58-0	0.050
X	148	Disodium 4-amino-3-[[4'-[(2,4-diaminophenyl)azo] [1,1'-biphenyl]-4-yl]azo] -5-hydroxy-6- (phenylazo)naphthalene-2,7-disulphonate (C.I. Direct Black 38)	1937-37-7	0.050
X	149	Imidazolidine-2-thione; (2-imidazoline-2-thiol)	96-45-7	0.050
Х	150	Lead di(acetate)*	301-04-2	0.005
Х	151	Trixylyl phosphate	25155-23-1	0.050
ΧI	152	1,2-Benzenedicarboxylic acid, dihexyl ester, branched and linear	68515-50-4	0.050
ΧI	153	Cadmium chloride*	10108-64-2	0.005
ΧI	154	Sodium perborate; perboric acid, sodium salt*	-	0.005
ΧI	155	Sodium peroxometaborate*	7632-04-4	0.005



This document is issued by the Company subject to its General Conditions of Service printed overleaf, available on request or accessible at <a href="http://www.sgs.com/en/Terms-and-Conditions.aspx">http://www.sgs.com/en/Terms-and-Conditions.aspx</a> and, for electronic format documents, subject to Terms and Conditions for Electronic Documents at <a href="http://www.sgs.com/en/Terms-and-Conditions/Terms-e-Document.aspx">http://www.sgs.com/en/Terms-and-Conditions/Terms-e-Document.aspx</a>. Attention is drawn to the limitation of liability, indemnification and jurisdiction issues defined therein. Any holder of this document is advised that information contained hereon reflects the Company's findings at the time of its intervention only and within the limits of Client information contained hereon reflects its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents. This document cannot be reproduced except in full, without prior written approval of the Company. Any unauthorized alteration, forgery or falsification of the content or appearance of this document is unlawful and offenders may be prosecuted to the fullest extent of the law. Unless otherwise stated the results shown in this test report refer only to the sample(s) tested.

\*\*Attention: To check the authenticity of testing /inspection report & certificate, please contact us at telephone: (86-755) 83071443, or email: CN.Doccheck@sgs.com

| 198 Kezhu Road, Scientech Park Guangzhou Economic & Technology Development District, Guangzhou, China 510663 t (86-20) 82155555 f (86-20) 82075113 www.sgsgroup.com.cn 中国・广州・经济技术开发区科学城科珠路198号 邮编: 510663 t (86-20) 82155555 f (86-20) 82075113 e sgs.china@sgs.com





No. CANEC1513030015

Date: 31 Jul 2015

Page 13 of 15

### **Appendix**

### Full list of tested SVHC:

Batch	No.	Substance Name	CAS No.	RL (%)
XII	156	2-(2H-Benzotriazol-2-yl)-4,6-ditertpentylphenol (UV-328)	25973-55-1	0.050
XII	157	2-benzotriazol-2-yl-4,6-di-tert-butylphenol (UV-320)	3846-71-7	0.050
XII	158	2-Ethylhexyl 10-ethyl-4,4-dioctyl-7-oxo-8-oxa-3,5-dithia-4-stannatetradeca noate; DOTE	15571-58-1	0.050
XII	159	Reaction mass of 2-ethylhexyl 10-ethyl-4,4-dioctyl-7-oxo-8-oxa-3,5-dithia-4-stannatetradeca noate & 2-ethylhexyl 10-ethyl-4-[[2-[(2-ethylhexyl)oxy] -2-oxoethyl]thio] -4-octyl-7-oxo-8-oxa-3,5-dithia-4-stannatetradecanoate (reaction mass of DOTE & MOTE)	-	0.050
XII	160	Cadmium fluoride*	7790-79-6	0.005
XII	161	Cadmium sulphate*	10124-36-4, 31119-53-6	0.005
XIII	162	1,2-benzenedicarboxylic acid, di-C6-10-alkyl esters; 1,2-benzenedicarboxylic acid, mixed decyl and hexyl and octyl diesters with ≥ 0.3% of dihexyl phthalate	68515-51-5, 68648-93-1	0.050
XIII	163	5-sec-butyl-2-(2,4-dimethylcyclohex-3-en-1-yl) -5-methyl-1,3-dioxane [1], 5-sec-butyl-2- (4,6-dimethylcyclohex-3-en-1-yl)-5-methyl-1,3-dioxane [2] [covering any of the individual isomers of [1] and [2] or any combination thereof]	-	0.050







No. CANEC1513030015


Date: 31 Jul 2015

Page 14 of 15

### **ATTACHMENTS**

### **SVHC Testing Flow Chart**

- 1) Name of the person who made testing: Martin He / Alison Zhang
- 2) Name of the person in charge of testing: Cutey Yu

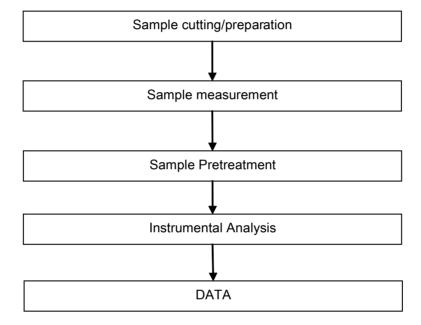








Date: 31 Jul 2015

# Test Report (SVHC)

No. CANEC1513030015

Page 15 of 15

Sample photo:

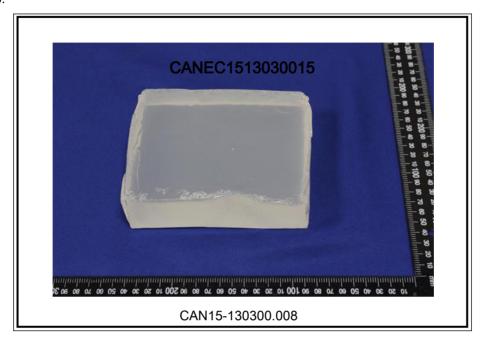

SGS authenticate the photo on original report only

\*\*\* End of Report \*\*\*





**Test Report** No.: SHHG1204010946BM Date: JUN.15,2012 Page: 1 of 7

The following sample(s) was/were submitted and identified by the client as:

Sample Description

Manufacturer

Sample Receiving Date

**Testing Period Test Performed** Test Requested : PVC FLOOR TILE



: APR.16,2012

: APR.16,2012 TO JUN.12,2012

: SELECTED TEST(S) AS REQUESTED BY APPLICANT

: ALL OF THE FOLLOWING TEST ITEMS WERE CONDUCTED ACCORDING TO BS EN649:2011 AND

THE STANDARD SPECIFIED BY CLIENT

- 1. RESISTANCE TO CHEMICALS(EN 423:1993)
- 2. EFFECT OF A CASTOR CHAIR (EN 425:1994)
- SIDE LENGTH, SQUARENESS AND STRAIGHTNESS OF TILES (EN 427:1994)
- OVERALL THICKNESS (EN 428:1993) 4.
- THE THICKNESS OF LAYERS (EN 429:1993)
- MASS PER UNIT AREA (EN 430:1994)
- 7. PEELING STRENGTH OF LAYERS(EN 431:1994)
- 8. RESIDUAL INDENTATION AFTER STATIC LOADING (EN433:1994)
- 9. DIMENSIONAL STABILITY AND CURING AFTER EXPOSURE TO HEAT (EN434:1994)
- 10. DETERMINATION OF FLEXIBILITY (EN 435:1994)
- 11. WEAR RESISTANCE (EN660-2:1999)
- 12. RESILIENT, TEXTILE AND LAMINATE **FLOOR** COVERINGS-CLASSIFICATION(EN685:2007)
- 13. COLOR FASTNESS TO LIGHT(EN20 105-B02:1999)
- 14. 8 TOXIC ELEMENT TEST(EN 71-3:1995)
- 15. REACTION TO FIRE TEST(EN 13501-1:2007)
- 16. SLIP RESISTANCE TEST (DIN 51130: 2010)
- 17. DYNAMIC COEFFICIENT OF FRICTION ON DRY FLOOR SURFACES(EN 13893:2002)
- 18. PHTHALATE CONTENT(EN 14372:2004)
- 19. FUNGUS TEST(ASTM G21:1999)
- 20. DETERMINATION OF DENSITY(EN 436:1994)

This document is issued by the Company subject to its General Conditions of Service printed overleaf, available on request or accessible at <a href="https://www.sgs.com/terms\_and\_conditions.htm">https://www.sgs.com/terms\_and\_conditions.htm</a> and, for electronic format documents, subject to Terms and Conditions for Electronic Documents at <a href="https://www.sgs.com/terms\_a-document.htm">www.sgs.com/terms\_a-document.htm</a>. Attention is drawn to the limitation of liability, indemotive and jurisdiction issues defined therein. Any holder of this document is advised that information contained hereon reflects the Company's findings at the time of its interveptor and this document does not exonerate parties to a transaction from excepting all their riggs, and obligations under the transaction documents. This document cannot be reproduced except in full, without prior written approval of the Company. Any upsettorized alteration">https://www.sgs.com/terms\_a-document.htm</a>. Any upsettorized alteration's pergery or faisification of the content or appearance of this document is unlawful and offenders may be prosecuted to the fullest extent of the law. Unless otherwise stated the reactits shown in this test report refer only to the sample(s) tested and such sample(s) are retained for 30 days only.

Ltd. | 3<sup>rd</sup> Building,No.889,Yishan Road, Xuhui District Shanghai,China 200233 t (86-21)61402666\*2013 f (86-21)54500353 中国・上海・徐汇区宜山路889号3号楼 邮编:200233 t (86-21)61402666\*2013 f (86-21)54500353





**Test Report** Page: 2 of 7 No.: SHHG1204010946BM Date: JUN.15,2012

Test Result(s) : FOR FURTHER DETAILS, PLEASE REFER TO THE

FOLLOWING PAGE(S)

Conclusion : THE TEST DATA WERE PROVIDED TO CLIENT FOR

THEIR OWN ANALYSIS.

Signed for and on behalf of SGS-CSTC Ltd.

Yomoro Gu Supervisor

This document is issued by the Company subject to its General Conditions of Service printed overleaf, available on request or accessible at http://www.sgs.com/terms\_and\_conditions. htm and, for electronic format documents, subject to Terms and Conditions for Electronic Documents at www.sgs.com/terms\_e-document.htm. Attention is drawn to the limitation of liability, indemptise and jurisdiction issues defined therein. Any holder of this document is advised that information contained hereon reflects the Company's findings at the time of its interverbegging all which which in the limits of Client's instructions, if any. The Company's sole responsibility is to its Client and this document does not exonerate parties to a transaction from excepting all their riggle, and obligations under the transaction documents. This document cannot be reproduced except in full, without prior written approval of the Company. Any upstatronized alteration's green or faisification of the content or appearance of this document insurful and offenders may be prosecuted to the fullest extent of the law. Unless otherwise stated the readits shown in this test report refer only to the sample(s) tested and such sample(s) are retained for 30 days only.





**Test Report** No.: SHHG1204010946BM Date: JUN.15,2012 Page: 3 of 7

#### **Test Conducted:**

- 1. Resistance to chemicals (EN 423:1993)
- 2. Effect of a castor chair (EN 425:1994)
- 3. Side length, squareness and straightness of tiles (EN 427:1994)
- 4. Overall thickness (EN 428:1993)
- 5. The thickness of layers (EN 429:1993)
- 6. Mass per unit area (EN 430:1994)
- 7. Peeling strength of layers (EN 431:1994)
- 8. Residual indentation after static loading (EN433:1994)
- 9. Dimensional stability and curing after exposure to heat (EN434:1994)
- 10. Determination of flexibility (EN 435:1994)
- 11. Wear resistance (EN660-2:1999)
- 12. Resilient, textile and laminate floor coverings-classification (EN685:2007)
- 13. Color fastness to light (EN20 105-B02:1999)
- 14. 8 Toxic element test (EN 71-3:1995)
- 15. Reaction to fire test (EN 13501-1:2007)
- 16.Slip resistance test (DIN 51130: 2010)
- 17. Dynamic coefficient of friction on dry floor surfaces (EN 13893:2002)
- 18. Phthalate content (EN 14372:2004)
- 19. Fungus test (ASTM G21:1999)
- 20. Determination of density (EN 436:1994)





**Test Report** No.: SHHG1204010946BM Date: JUN.15,2012 Page: 4 of 7

Test Property	Test Method	Test requirements	<u>Nominal</u>	Result	Rating
Resistance to chemicals	EN 423:1993	Meet Class 0		Class 0	Pass
Effect of a castor chair	EN 425:1994	Record the nature of damage observed		No obvious damage	Pass
Side length, squareness and straightness of tiles	EN 427:1994	Squareness and straightness ≤ 0.25mm for side length ≤ 400mm, ≤ 0.35mm for side length > 400mm)  Dimension: ≤ 0.13% of nominal length up to 0.5mm maximum	304.8x304.8 406.4x406.4 457.2x457.2 6 0 0 x 6 0 0 101.6x914.4 152.4x914.4 304.8x609.6 228.6x 1219.2mm	Squareness, straightness: <0.25mm Dimension: <0.13%	Pass
Overall thickness	EN 428:1993	Average :nominal value $^{+0.13}_{-0.10}$ mm Individual : average value±0.15mm	2.0/2.5/3.0/ 4.0/5.0mm	Average: -0.02/ -0.01/0.03/ -0.04/0.05mm Individual: 0.07/-0.04; 0.04/-0.05; 0.04/-0.05; 0.06/-0.03; 0.03/-0.10mm	Pass
The thickness of layers	EN 429:1993	Average :nominal +13% value <sup>-10%</sup> mm Individual : average value±0.05mm or 15% below	0.3/0.5/0.7 mm	0.32/0.53/ 0.74mm	Pass
Mass per unit area	EN 430:1994	Average :nominal +13% value <sup>-10%</sup> mm	0.3/2.0 0.3/2.5 0.3/3.0 0.5/2.5 0.5/3.0 0.7/2.5 0.7/3.0	3704g/m <sup>2</sup> 4619g/m <sup>2</sup> 5819g/m <sup>2</sup> 4460g/m <sup>2</sup> 5330g/m <sup>2</sup> 4211g/m <sup>2</sup> 5232g/m <sup>2</sup>	

This document is issued by the Company subject to its General Conditions of Service printed overleaf, available on request or accessible at <a href="http://www.sgs.com/terms\_and\_conditions">http://www.sgs.com/terms\_and\_conditions</a>. htm and, for electronic format documents, subject to Terms and Conditions for Electronic Documents at <a href="http://www.sgs.com/terms\_e-document.htm">www.sgs.com/terms\_e-document.htm</a>. Attention is drawn to the limitation of liability, indemptication and jurisdiction issues defined therein. Any holder of this document is advised that information contained hereon reflects the Company's findings at the time of its interversion of the Columnt in Survival to the first can do bligations under the transaction documents. This document cannot be reproduced except in full, without prior written approval of the Company. Any unsuffering degrad of light first can defined from the produced except in full, without prior written approval of the Company. Any unsuffering degrad of first degrad of this document is unlawful and offenders may be prosecuted to the fullest extent of the law. Unless otherwise stated the readults shown in this test report refer only to the sample(s) tested and such sample(s) are retained for 30 days only.

| Section | Sec



**Test Report** Page: 5 of 7 No.: SHHG1204010946BM Date: JUN.15,2012

Test Property	Test Method	Test requirements	<u>Nominal</u>	Result	Rating
Peeling strength of layers	EN 431:1994	Record the test result		Len.90.6N Tran.91.1N	
Residual indentation after static loading	EN433:1994	≤0.1mm		0.08mm	Pass
Dimensional stability and curing after exposure to heat	EN434:1994	Shrinkage ≤0.25% Curling ≤2mm	0.3/2.0 0.3/2.5 0.3/3.0 0.5/2.5 0.5/3.0 0.7/2.5 0.7/3.0	Len./Tran./Cur. 0.09%/0.09%/0.02 0.08%/0.05%/0.04 0.11%/0.09%/0.11 0.08%/0.02%/0.02 0.07%/0.06%/0.04 0.05%/0.03%/0.09 0.10%/0.07%/0.13	Pass
Determination of flexibility	EN 435:1994	Bend around 20mm mandrel shows no signs of cracking		Bend around 15mm mandrel shows no signs of cracking	Pass
Wear resistance	EN660-2:1999	≤2.0mm <sup>3</sup>		1.2mm <sup>3</sup> Wear group:T	Pass
Resilient, textile and laminate floor coverings- classification	EN685:2007	Record the Classification	0.3/2.0 0.3/2.5 0.3/3.0 0.5/2.5 0.5/3.0 0.7/2.5 0.7/3.0	23/31 23/31 23/31 32 32 34 34	
Color fastness to light	EN20 105- B02:1999	≽Grade 6		≽Grade 6	Pass
8 Toxic element test	EN 71-3:1995	Pb≤90PPM Sb≤60PPM As≤25PPM Ba≤1000PPM Cd≤75PPM Cr≤60PPM Hg≤60PPM Se≤500PPM		<5 PPM <5 PPM <2.5 PPM <10 PPM <5 PPM <5 PPM <5 PPM <10 PPM	Pass

This document is issued by the Company subject to its General Conditions of Service printed overleaf, available on request or accessible at <a href="http://www.sgs.com/terms\_and\_conditions">http://www.sgs.com/terms\_and\_conditions</a>. htm and, for electronic format documents, subject to Terms and Conditions for Electronic Documents at <a href="https://www.sgs.com/terms\_e-document.htm">www.sgs.com/terms\_e-document.htm</a>. Attention is drawn to the limitation of liability, indemptication and jurisdiction issues defined therein. Any holder of this document is advised that information contained hereon reflects the Company's findings at the time of its interversion of the Columnt in Survival to the Cilent and this document dos not exonerate parties to a transaction from expressing all their rights and obligations under the transaction documents. This document cannot be reproduced except in full, without prior written approval of the Company. Any unsuffering the gradient of the content or appearance of this document is unlawful and offenders may be prosecuted to the fullest extent of the law. Unless otherwise stated the realities shown in this test report refer only to the sample(s) tested and such sample(s) are retained for 30 days only.

SGS





**Test Report** Page: 6 of 7 No.: SHHG1204010946BM Date: JUN.15,2012

Test Property	Test Method	Test requirements	<u>Nominal</u>	Result	Rating
Reaction to fire test	EN 13501- 1:2007	Record the test result		B <sub>fl</sub> -S1	
Slip resistance test	DIN 51130: 2010			R9	
Dynamic coefficient of friction on dry floor surfaces	EN 13893:2002	Record the test result		0.610	
Phthalate content	EN 14372:2004	Total (DBP+BBP+DEHP) ≤ 0.1%ppm Total (DINP+DNOP+DIDP ) ≤ 0.1%ppm		Total (DBP+BBP+D EHP): 0.01%ppm Total (DINP+DNOP +DIDP) ≤ 0.023%ppm	Pass
Fungus test	ASTM G21:1999	Record the test result		Grade 0	
Determination of density	EN 436:1994	Record the test result	0.3/2.0 0.3/2.5 0.3/3.0 0.5/2.5 0.5/3.0 0.7/2.5 0.7/3.0	1719kg/m <sup>3</sup> 1823kg/m <sup>3</sup> 1840kg/m <sup>3</sup> 1685kg/m <sup>3</sup> 1738kg/m <sup>3</sup> 1636kg/m <sup>3</sup>	

This document is issued by the Company subject to its General Conditions of Service printed overleaf, available on request or accessible at <a href="http://www.sgs.com/terms\_and\_conditions">http://www.sgs.com/terms\_and\_conditions</a>. htm and, for electronic format documents, subject to Terms and Conditions for Electronic Documents at <a href="https://www.sgs.com/terms\_e-document.htm">www.sgs.com/terms\_e-document.htm</a>. Attention is drawn to the limitation of liability, indemptication and jurisdiction issues defined therein. Any holder of this document is advised that information contained hereon reflects the Company's findings at the time of its interversion of the Columnt in Survival to the Cilent and this document dos not exonerate parties to a transaction from expressing all their rights and obligations under the transaction documents. This document cannot be reproduced except in full, without prior written approval of the Company. Any unsuffering the gradient of the content or appearance of this document is unlawful and offenders may be prosecuted to the fullest extent of the law. Unless otherwise stated the realities shown in this test report refer only to the sample(s) tested and such sample(s) are retained for 30 days only.

| Section | Sec





**Test Report** Page: 7 of 7 No.: SHHG1204010946BM Date: JUN.15,2012

### Annex: Single test item corresponding to SGS test NO. list as follows:

TEST REQUETED	SGS Test NO.
1.RESISTANCE TO CHEMICALS (EN 423:1993)	SHHG1204010967BM
2.EFFECT OF A CASTOR CHAIR	SHHG1204010966BM
(EN425:1994)	
3.SIDE LENGTH,SQUARENESS AND	SHHG1205013757BM
STRAIGHTNESS OF TILES (EN 427:1994)	
4.OVERALL THICKNESS(EN428:1993)	SHHG1204010964BM
5.THE THICKNSS OF LAYERS (EN 429:1993)	SHHG1204010963BM
6.MASS PER UNIT AREA(EN 430:1994)	SHHG1205013752BM
7.PEELING STRENGTH OF LAYERS (EN	SHHG1204010961BM
431:1994)	
8.RESIDUAL INDENTATION AFTER STATIC	SHHG1204010960BM
LOADING(EN433:1994	
9.DIMENSIONAL STABILITY AND CURING	SHHG1205013751BM
AFTER EXPOSURE TO HEAT (EN434:1994)	
10.DETERMINATION OF	SHHG1204010958BM
FLEXIBILITY(EN435:1994)	
11.WEAR RESISTANCE(EN660-2:1999)	SHHG1204010957BM
12.RESILIENT,TEXTILE AND LAMINATE FLOOR	SHHG1204010956BM
COVERINGS -CLASSIFICATION(EN685:2007)	
13.COLOR FASTENSS TO LIGHT (EN20105-	SHHG1204010955BM
B02:1999)	
14. 8 TOXIC ELEMENT TEST (EN 71-3:1995)	SHHG1204010954BM
15.REACTION OF FIRE TEST(EN13501-1:2007)	SHHG1204010953BM
16.SLIP RESISTANCE TEST(DIN 51130:2010)	SHHG1204010952BM
17.DYNAMIC COEFFICIENT OF FRICTION ON	SHHG1204010951BM
DRY FLOOR SURFACES (EN13893:2002)	
18.PHTHALATE CONETENT(EN14372:2004)	SHHG1204010950BM
19.FUNGUS TEST(ASTM G21:1999)	SHHG1204010949BM
20.DETERMINATION OF DENSITY(EN436:1994)	SHHG1205013753BM

<sup>\*\*\*</sup>End of Report\*\*\*

This document is issued by the Company subject to its General Conditions of Service printed overleaf, available on request or accessible at http://www.sgs.com/terms\_and\_conditions. htm and, for electronic format documents, subject to Terms and Conditions for Electronic Documents at www.sgs.com/terms\_e-document.htm. Attention is drawn to the limitation of liability, indemptise and jurisdiction issues defined therein. Any holder of this document is advised that information contained hereon reflects the Company's findings at the time of its interverbegging all which which in the limits of Client's instructions, if any. The Company's sole responsibility is to its Client and this document does not exonerate parties to a transaction from excepting all their riggle, and obligations under the transaction documents. This document cannot be reproduced except in full, without prior written approval of the Company. Any upstatronized alteration's green or faisification of the content or appearance of this document insurful and offenders may be prosecuted to the fullest extent of the law. Unless otherwise stated the readits shown in this test report refer only to the sample(s) tested and such sample(s) are retained for 30 days only.

Ltd. 3<sup>rd</sup> Building,No.889,Yishan Road, Xuhui District Shanghai,China 200233 t (86-21)61402666\*2013 f (86-21)54500353

Laboratory 中国・上海・徐汇区宜山路889号3号楼 邮编:200233 t (86-21)61402666\*2013 f (86-21)54500353





No. SHAHG1512973401

Date: 10 Jul 2015

Page 1 of 14



The following sample(s) was/were submitted and identified on behalf of the clients as :

THICKNESS:5.0MM;WEARLAYER:0.7MM

SGS Job No. : SHHG1506021651SD - SH

Style No. : JH-C2107-1

Date of Sample Received : 03 Jul 2015

Testing Period: 03 Jul 2015 - 10 Jul 2015

Test Requested: As requested by client, SVHC screening is performed according to:

(i) One hundred and sixty three (163) substances in the Candidate List of Substances of Very High Concern (SVHC) for authorization published by European Chemicals Agency (ECHA) on and before Jun 15, 2015 regarding

Regulation (EC) No 1907/2006 concerning the REACH.

Test Results: Please refer to next page(s).

Summary:

According to the specified scope and analytical techniques, concentrations of tested SVHC are ≤ 0.1% (w/w) in the submitted sample.

Signed for and on behalf of

SGS-CSTC Standards Technical Services (Shanghai) Co., Ltd.

Serena Wang

Approved Signatory



This document is issued by the Company subject to its General Conditions of Service printed overleaf, available on request or accessible at <a href="http://www.sgs.com/en/Terms-and-Conditions.aspx">http://www.sgs.com/en/Terms-and-Conditions.aspx</a> and, for electronic format documents, subject to Terms and Conditions for Electronic Documents at <a href="http://www.sgs.com/en/Terms-end-Conditions/Terms-en





Date: 10 Jul 2015

# Test Report (SVHC)

No. SHAHG1512973401

Page 2 of 14

#### Remark:

(1) The chemical analysis of specified SVHC is performed by means of currently available analytical techniques against the following SVHC related documents published by ECHA: http://echa.europa.eu/web/guest/candidate-list-table

These lists are under evaluation by ECHA and may subject to change in the future.

#### (2) Concerning article(s):

In accordance with Regulation (EC) No 1907/2006, any EU producer or importer of articles shall notify ECHA, in accordance with paragraph 4 of Article 7, if a substance meets the criteria in Article 57 and is identified in accordance with Article 59(1) of the Regulation, if (a) the substance in the Candidate List is present in those articles in quantities totaling over one tonne per producer or importer per year; and (b) the substance in the Candidate List is present in those articles above a concentration of 0.1% weight by weight (w/w).

Article 33 of Regulation (EC) No 1907/2006 requires supplier of an article containing a substance meeting the criteria in Article 57 and identified in accordance with Article 59(1) in a concentration above 0.1% weight by weight (w/w) shall provide the recipient of the article with sufficient information, available to the supplier, to allow safe use of the article including, as a minimum, the name of that substance in the Candidate List.

SGS adopts the interpretation of ECHA for SVHC in article unless indicated otherwise. Detail explanation is available at the following link:

http://webstage.contribute.sgs.net/corpreach/documents/SGS-CTS\_SVHC-paper-EN-11.pdf

#### (3) Concerning material(s):

Test results in this report are based on the tested sample. This report refers to testing result of tested sample submitted as homogenous material(s). In case such material is being used to compose an article, the results indicated in this report may not represent SVHC concentration in such article. If this report refers to testing result of composite material group by equal weight proportion, the material in each composite test group may come from more than one article.

If the sample is a substance or mixture, and it directly exports to EU, client has the obligation to comply with the supply chain communication obligation under Article 31 of Regulation (EC) No. 1907/2006 and the conditions of Authorization of substance of very high concern included in the Annex XIV of the Regulation (EC) No. 1907/2006.

#### (4) Concerning substance and preparation:

If a SVHC is found over 0.1% (w/w) and/or the specific concentration limit which is set in Regulation (EC) No 1272/2008 and No 790/2009, client is suggested to prepare a Safety Data Sheet (SDS) against the SVHC to comply with the supply chain communication obligation under Regulation (EC) No 1907/2006, in which:

- a substance that is classified as hazardous under the CLP Regulation (EC) No 1272/2008.
- a mixture that is classified as dangerous according Dangerous Preparations Directive







No. SHAHG1512973401 Date: 10 Jul 2015

Page 3 of 14

1999/45/EC or classified as hazardous under the CLP Regulation (EC) No 1272/2008, when their concentrations are equal to, or greater than, those defined in the Article 3(3) of 1999/45/EC or the lower values given in Part 3 of Annex VI of Regulation (EC) No. 1272/2008; or

- a mixture is not classified as dangerous under Directive 1999/45/EC, but contains either:
- (a) a substance posing human health or environmental hazards in an individual concentration of  $\geq$  1 % by weight for mixtures that are solid or liquids (i.e., non-gaseous mixtures) or  $\geq$  0.2 % by volume for gaseous mixtures; or
- (b) a substance that is PBT, or vPvB in an individual concentration of ≥ 0.1 % by weight for mixtures that are solid or liquids (i.e., non-gaseous mixtures); or
- (c) a substance on the SVHC candidate list (for reasons other than those listed above), in an individual concentration of  $\geq$  0.1 % by weight for non-gaseous mixtures; or
- (d) a substance for which there are Europe-wide workplace exposure limits.
- (5) If a SVHC is found over the reporting limit, client is suggested to identify the component which contains the SVHC and the exact concentration of the SVHC by requesting further quantitative analysis from the laboratory.

#### Test Sample:

#### Sample Description:

Specimen No. SGS Sample ID Description

SN1 SHA15-129734.001 White plastic board with black back

#### Test Method:

SGS In-House method-SHTC-CHEM-SOP-97-T, SHTC-CHEM-SOP-302-T, Analyzed by ICP-OES, UV-VIS, GC-MS, HPLC-DAD/MS and Colorimetric Method.







No. SHAHG1512973401

Date: 10 Jul 2015

Page 4 of 14

Test Result: (Substances in the Candidate List of SVHC)

Batch	Substance Name	CAS No.	001 Concentration (%)	RL (%)
-	All tested SVHC in candidate list	-	ND	-

#### Notes:

- (1)The table above only shows detected SVHC, and SVHC that below RL are not reported. Please refer to Appendix for the full list of tested SVHC.
- (2) RL = Reporting Limit. All RL are based on homogenous material ND = Not detected (lower than RL), ND is denoted on the SVHC substance.
- (3)  $\triangle$ CAS No. of diastereoisomers identified ( $\alpha$ -HBCDD,  $\beta$ -HBCDD,  $\gamma$ -HBCDD): 134237-50-6, 134237-51-7, 134237-52-8
  - ☆CAS No. of Hexahydromethylphathalic anhydride, Hexahydro-4-methylphathalic anhydride, Hexahydro-1-methylphathalic anhydride, Hexahydro-3-methylphathalic anhydride: 25550-51-0, 19438-60-9, 48122-14-1, 57110-29-9; EC No. of those: 247-094-1, 243-072-0, 256-356-4, 260-566-1.
- (4) \* The test result is based on the calculation of selected element(s) / marker(s) and to the worst-case scenario. For detail information, please refer to the SGS REACH website: <a href="www.reach.sgs.com/substance-of-very-high-concern-analysis-information-page.htm">www.reach.sgs.com/substance-of-very-high-concern-analysis-information-page.htm</a> Calculated concentration of boric compounds are based on the water extractive boron by ICP-OES.
  - RL = 0.005% is evaluated for element (i.e. cobalt, arsenic, lead, chromium (VI), aluminum, zirconium, strontium, zinc, antimony, titanium, barium and cadmium respectively), except molybdenum RL=0.0005%, boron RL=0.0025 %( only for Lead bis (tetrafluoroborate)).
- (5) § The substance is proposed for the identification as SVHC only where it contains Michler's ketone (CAS Number: 90-94-8) or Michler's base (CAS Number: 101-61-1) ≥0.1% (w/w).







No. SHAHG1512973401

Date: 10 Jul 2015

Page 5 of 14

### **Appendix**

#### Full list of tested SVHC:

Batch	No.	Substance Name	CAS No.	RL (%)
I	1	4,4' -Diaminodiphenylmethane(MDA)	101-77-9	0.050
I	2	5-tert-butyl-2,4,6-trinitro-m-xylene (musk xylene)	81-15-2	0.050
I	3	Alkanes, C10-13, chloro (Short Chain Chlorinated Paraffins)	85535-84-8	0.050
I	4	Anthracene	120-12-7	0.050
I	5	Benzyl butyl phthalate (BBP)	85-68-7	0.050
I	6	Bis (2-ethylhexyl)phthalate (DEHP)	117-81-7	0.050
I	7	Bis(tributyltin)oxide (TBTO)	56-35-9	0.050
I	8	Cobalt dichloride*	7646-79-9	0.005
I	9	Diarsenic pentaoxide*	1303-28-2	0.005
I	10	Diarsenic trioxide*	1327-53-3	0.005
I	11	Dibutyl phthalate (DBP)	84-74-2	0.050
I	12	Hexabromocyclododecane (HBCDD) and all major diastereoisomers identified (α-HBCDD, β-HBCDD, γ-HBCDD) <sup>Δ</sup>	25637-99-4, 3194- 55-6	0.050
I	13	Lead hydrogen arsenate*	7784-40-9	0.005
I	14	Sodium dichromate*	7789-12-0, 10588-01-9	0.005
I	15	Triethyl arsenate*	15606-95-8	0.005
II	16	2,4-Dinitrotoluene	121-14-2	0.050
II	17	Acrylamide	79-06-1	0.050
II	18	Anthracene oil*	90640-80-5	0.050
II	19	Anthracene oil, anthracene paste*	90640-81-6	0.050
II	20	Anthracene oil, anthracene paste, anthracene fraction*	91995-15-2	0.050



This document is issued by the Company subject to its General Conditions of Service printed overleaf, available on request or accessible at <a href="http://www.sgs.com/en/Terms-and-Conditions.aspx">http://www.sgs.com/en/Terms-and-Conditions.aspx</a> and, for electronic format documents, subject to Terms and Conditions for Electronic Documents at <a href="http://www.sgs.com/en/Terms-and-Conditions/Terms-e-Document.aspx">http://www.sgs.com/en/Terms-and-Conditions/Terms-e-Document.aspx</a>. Attention is drawn to the limitation of liability, indemnification and jurisdiction issues defined therein. Any holder of this document is advised that information contained hereon reflects the Company's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Company's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents. This document cannot be reproduced except in full, without prior written approval of the Company. Any unauthorized alteration, forgery or falsification of the content or appearance of this document is unlawful and offenders may be prosecuted to the fullest extent of the law. Unless otherwise stated the results shown in this test report refer only to the sample(s) tested.

Attention: To check the authenticity of testing /inspection report & certificate, please contact us at telephone: (86-755) 8307 1443, or email: CN.Doccheck@sgs.com"

\*\*ESE (98-21) 6400559. \*\*LESE (

3<sup>rd</sup>Building, No. 889 Yishan Road Xuhui District, Shanghai China 200233 中国・上海・徐汇区宜山路889号3号楼 邮编: 200233 tE&E (86-21) 61402553 fE&E (86-21)64953679 www.sgsgroup.com.cn tHL (86-21) 61402594 fHL (86-21)61156899

e sgs.china@sgs.com





No. SHAHG1512973401

Date: 10 Jul 2015

Page 6 of 14

### **Appendix**

#### Full list of tested SVHC:

Batch	No.	Substance Name	CAS No.	RL (%)
II	21	Anthracene oil, anthracene paste, distn. lights*	91995-17-4	0.050
II	22	Anthracene oil, anthracene-low*	90640-82-7	0.050
II	23	Diisobutyl phthalate	84-69-5	0.050
II	24	Lead chromate*	7758-97-6	0.005
II	25	Lead chromate molybdate sulphate red (C.I. Pigment Red 104)*	12656-85-8	0.005
II	26	Lead sulfochromate yellow (C.I. Pigment Yellow 34)*	1344-37-2	0.005
II	27	Pitch, coal tar, high temp.*	65996-93-2	0.050
II	28	Tris(2-chloroethyl)phosphate	115-96-8	0.050
Ш	29	Ammonium dichromate*	7789-09-5	0.005
III	30	Boric acid*	10043-35-3, 11113-50-1	0.005
III	31	Disodium tetraborate, anhydrous*	1303-96-4, 1330-43-4, 12179-04-3	0.005
III	32	Potassium chromate*	7789-00-6	0.005
III	33	Potassium dichromate*	7778-50-9	0.005
III	34	Sodium chromate*	7775-11-3	0.005
III	35	Tetraboron disodium heptaoxide, hydrate*	12267-73-1	0.005
Ш	36	Trichloroethylene	79-01-6	0.050
IV	37	2-Ethoxyethanol	110-80-5	0.050
IV	38	2-Methoxyethanol	109-86-4	0.050
IV	39	Chromic acid, Oligomers of chromic acid and dichromic acid, Dichromic acid*	7738-94-5 - 13530-68-2	0.005



This document is issued by the Company subject to its General Conditions of Service printed overleaf, available on request or accessible at <a href="http://www.sgs.com/en/Terms-and-Conditions.aspx">http://www.sgs.com/en/Terms-and-Conditions.aspx</a> and, for electronic format documents, subject to Terms and Conditions for Electronic Documents at <a href="http://www.sgs.com/en/Terms-and-Conditions/Terms-e-Document.aspx">http://www.sgs.com/en/Terms-and-Conditions/Terms-e-Document.aspx</a>. Attention is drawn to the limitation of liability, indemnification and jurisdiction issues defined therein. Any holder of this document is advised that information contained hereon reflects the Company's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Company's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents. This document cannot be reproduced except in full, without prior written approval of the Company. Any unauthorized alteration, forgery or falsification of the content or appearance of this document is unlawful and offenders may be prosecuted to the fullest extent of the law. Unless otherwise stated the results shown in this test report refer only to the sample(s) tested.

Attention: To check the authenticity of testing /inspection report & certificate, please contact us at telephone: (86-755) 8307 1443, or email: CN.Doccheck@sgs.com"

\*\*ESE (98-21) 6400559. \*\*LESE (

3<sup>rd</sup>Building, No. 889 Yishan Road Xuhui District, Shanghai China 200233 中国・上海・徐汇区宜山路889号3号楼 邮编: 200233 tE&E (86-21) 61402553 fE&E (86-21)64953679 www.sgsgroup.com.cn tHL (86-21) 61402594 fHL (86-21)61156899

e sgs.china@sgs.com





No. SHAHG1512973401

Date: 10 Jul 2015

Page 7 of 14

### **Appendix**

#### Full list of tested SVHC:

Batch	No.	Substance Name	CAS No.	RL (%)
IV	40	Chromium trioxide*	1333-82-0	0.005
IV	41	Cobalt(II) carbonate*	513-79-1	0.005
IV	42	Cobalt(II) diacetate*	71-48-7	0.005
IV	43	Cobalt(II) dinitrate*	10141-05-6	0.005
IV	44	Cobalt(II) sulphate*	10124-43-3	0.005
V	45	1,2,3-trichloropropane	96-18-4	0.050
V	46	1,2-Benzenedicarboxylic acid, di-C6-8-branched alkyl esters, C7-rich	71888-89-6	0.050
V	47	1,2-Benzenedicarboxylic acid, di-C7-11-branched and linear alkyl esters	68515-42-4	0.050
V	48	1-methyl-2-pyrrolidone	872-50-4	0.050
V	49	2-ethoxyethyl acetate	111-15-9	0.050
V	50	Hydrazine	7803-57-8, 302-01-2	0.050
V	51	Strontium chromate*	7789-06-2	0.005
VI	52	1,2-Dichloroethane	107-06-2	0.050
VI	53	2,2'-dichloro-4,4'-methylenedianiline	101-14-4	0.050
VI	54	2-Methoxyaniline; o-Anisidine	90-04-0	0.050
VI	55	4-(1,1,3,3-tetramethylbutyl)phenol	140-66-9	0.050
VI	56	Aluminosilicate Refractory Ceramic Fibres *	650-017-00-8 (Index no.)	0.005
VI	57	Arsenic acid*	7778-39-4	0.005
VI	58	Bis(2-methoxyethyl) ether	111-96-6	0.050
VI	59	Bis(2-methoxyethyl) phthalate	117-82-8	0.050



This document is issued by the Company subject to its General Conditions of Service printed overleaf, available on request or accessible at <a href="http://www.sgs.com/en/Terms-and-Conditions.aspx">http://www.sgs.com/en/Terms-and-Conditions.aspx</a> and, for electronic format documents, subject to Terms and Conditions for Electronic Documents at <a href="http://www.sgs.com/en/Terms-and-Conditions/Terms-en-Document.aspx">http://www.sgs.com/en/Terms-and-Conditions/Terms-en-Document.aspx</a>. Attention is drawn to the limitation of liability, indemnification and jurisdiction issues defined therein. Any holder of this document is advised that information contained hereon reflects the Company's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Company's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents. This document cannot be reproduced except in full, without prior written approval of the Company. Any unauthorized alteration, forgery or falsification of the content or appearance of this document is unlawful and offenders may be prosecuted to the fullest extent of the law. Unless otherwise stated the results shown in this test report refer only to the sample(s) tested.

Attention: To check the authenticity of testing /inspection report & certificate, please contact us at telephone: (86-755) 8307 1443, or email: CN.Doccheck@sgs.com" | CN.Doccheck@sgs.com | CN

3<sup>rd</sup>Building, No. 889 Yishan Road Xuhui District, Shanghai China 200233 中国・上海・徐汇区宜山路889号3号楼 邮编: 200233 tE&E (86-21) 61402553 fE&E (86-21)64953679 www.sgsgroup.com.cn tHL (86-21) 61402594 fHL (86-21)61156899





No. SHAHG1512973401

Date: 10 Jul 2015

Page 8 of 14

### **Appendix**

#### Full list of tested SVHC:

Batch	No.	Substance Name	CAS No.	RL (%)
VI	60	Calcium arsenate*	7778-44-1	0.005
VI	61	Dichromium tris(chromate) *	24613-89-6	0.005
VI	62	Formaldehyde, oligomeric reaction products with aniline	25214-70-4	0.050
VI	63	Lead diazide, Lead azide*	13424-46-9	0.005
VI	64	Lead dipicrate*	6477-64-1	0.005
VI	65	Lead styphnate*	15245-44-0	0.005
VI	66	N,N-dimethylacetamide	127-19-5	0.050
VI	67	Pentazinc chromate octahydroxide*	49663-84-5	0.005
VI	68	Phenolphthalein	77-09-8	0.050
VI	69	Potassium hydroxyoctaoxodizincatedichromate*	11103-86-9	0.005
VI	70	Trilead diarsenate*	3687-31-8	0.005
VI	71	Zirconia Aluminosilicate Refractory Ceramic Fibres*	650-017-00-8 (Index no.)	0.005
VII	72	[4-[[4-anilino-1-naphthyl][4- (dimethylamino)phenyl]methylene]cyclohexa-2,5-dien-1-ylide ne] dimethylammonium chloride (C.I. Basic Blue 26)§	2580-56-5	0.050
VII	73	[4-[4,4'-bis(dimethylamino) benzhydrylidene]cyclohexa-2,5-dien-1-ylidene]dimethylamm onium chloride (C.I. Basic Violet 3)§	548-62-9	0.050
VII	74	1,2-bis(2-methoxyethoxy)ethane (TEGDME; triglyme) 112-49-2		0.050
VII	75	1,2-dimethoxyethane; ethylene glycol dimethyl ether (EGDME)	110-71-4	0.050
VII	76	4,4'-bis(dimethylamino) benzophenone (Michler's Ketone) 90-94-8		0.050
VII	77	4,4'-bis(dimethylamino)-4"-(methylamino)trityl alcohol§	561-41-1	0.050
VII	78	Diboron trioxide*	1303-86-2	0.005



This document is issued by the Company subject to its General Conditions of Service printed overleaf, available on request or accessible at <a href="http://www.sgs.com/en/Terms-and-Conditions.aspx">http://www.sgs.com/en/Terms-and-Conditions.aspx</a> and, for electronic format documents, subject to Terms and Conditions for Electronic Documents at <a href="http://www.sgs.com/en/Terms-and-Conditions/Terms-en-Document.aspx">http://www.sgs.com/en/Terms-and-Conditions/Terms-en-Document.aspx</a>. Attention is drawn to the limitation of liability, indemnification and jurisdiction issues defined therein. Any holder of this document is advised that information contained hereon reflects the Company's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Company's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents. This document cannot be reproduced except in full, without prior written approval of the Company. Any unauthorized alteration, forgery or falsification of the content or appearance of this document is unlawful and offenders may be prosecuted to the fullest extent of the law. Unless otherwise stated the results shown in this test report refer only to the sample(s) tested.

Attention: To check the authenticity of testing /inspection report & certificate, please contact us at telephone: (86-755) 8307 1443, or email: CN.Doccheck@sgs.com" | CN.Doccheck@sgs.com | CN

3<sup>rd</sup>Building, No. 889 Yishan Road Xuhui District, Shanghai China 200233 中国・上海・徐汇区宜山路889号3号楼 邮编: 200233 tE&E (86-21) 61402553 fE&E (86-21)64953679 www.sgsgroup.com.cn tHL (86-21) 61402594 fHL (86-21)61156899





No. SHAHG1512973401

Date: 10 Jul 2015

Page 9 of 14

### **Appendix**

#### Full list of tested SVHC:

Batch	No.	Substance Name	CAS No.	RL (%)
VII	79	Formamide	75-12-7	0.050
VII	80	Lead(II) bis(methanesulfonate)*	17570-76-2	0.005
VII	81	N,N,N',N'-tetramethyl-4,4'-methylenedianiline (Michler's base)	101-61-1	0.050
VII	82	TGIC (1,3,5-tris(oxiranylmethyl)-1,3,5-triazine-2,4,6(1H,3H,5H)-trio ne)	2451-62-9	0.050
VII	83	α,α-Bis[4-(dimethylamino)phenyl]-4 (phenylamino)naphthalene-1-methanol (C.I. Solvent Blue 4) §	6786-83-0	0.050
VII	84	β-TGIC (1,3,5-tris[(2S and 2R)-2,3-epoxypropyl]-1,3,5-triazine-2,4,6-(1H,3H,5H)-trione)	59653-74-6	0.050
VIII	85	[Phthalato(2-)]dioxotrilead*	69011-06-9	0.005
VIII	86	1,2-Benzenedicarboxylic acid, dipentylester, branched and linear	84777-06-0	0.050
VIII	87	1,2-Diethoxyethane	629-14-1	0.050
VIII	88	1-Bromopropane	106-94-5	0.050
VIII	89	3-Ethyl-2-methyl-2-(3-methylbutyl)-1,3-oxazolidine	143860-04-2	0.050
VIII	90	4-(1,1,3,3-tetramethylbutyl)phenol, ethoxylated	-	0.050
VIII	91	4,4'-Methylenedi-o-toluidine	838-88-0	0.050
VIII	92	4,4'-Oxydianiline and its salts	101-80-4	0.050
VIII	93	4-Aminoazobenzene	60-09-3	0.050
VIII	94	4-Methyl-m-phenylenediamine	95-80-7	0.050
VIII	95	4-Nonylphenol, branched and linear -		0.050
VIII	96	6-Methoxy-m-toluidine	120-71-8	0.050
VIII	97	Acetic acid, lead salt, basic*	51404-69-4	0.005



This document is issued by the Company subject to its General Conditions of Service printed overleaf, available on request or accessible at <a href="http://www.sgs.com/en/Terms-and-Conditions.aspx">http://www.sgs.com/en/Terms-and-Conditions.aspx</a> and, for electronic format documents, subject to Terms and Conditions for Electronic Documents at <a href="http://www.sgs.com/en/Terms-and-Conditions/Terms-en-Document.aspx">http://www.sgs.com/en/Terms-and-Conditions/Terms-en-Document.aspx</a>. Attention is drawn to the limitation of liability, indemnification and jurisdiction issues defined therein. Any holder of this document is advised that information contained hereon reflects the Company's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Company's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents. This document cannot be reproduced except in full, without prior written approval of the Company. Any unauthorized alteration, forgery or falsification of the content or appearance of this document is unlawful and offenders may be prosecuted to the fullest extent of the law. Unless otherwise stated the results shown in this test report refer only to the sample(s) tested.

Attention: To check the authenticity of testing /inspection report & certificate, please contact us at telephone: (86-755) 8307 1443, or email: CN.Doccheck@sgs.com" | CN.Doccheck@sgs.com | CN

3<sup>rd</sup>Building, No. 889 Yishan Road Xuhui District, Shanghai China 200233 中国・上海・徐汇区宜山路889号3号楼 邮编: 200233 tE&E (86-21) 61402553 fE&E (86-21)64953679 www.sgsgroup.com.cn tHL (86-21) 61402594 fHL (86-21)61156899





No. SHAHG1512973401

Date: 10 Jul 2015

Page 10 of 14

### **Appendix**

### Full list of tested SVHC:

Batch	No.	Substance Name	CAS No.	RL (%)
VIII	98	Biphenyl-4-ylamine	92-67-1	0.050
VIII	99	Bis(pentabromophenyl) ether (DecaBDE)	1163-19-5	0.050
VIII	100	Cyclohexane-1,2-dicarboxylic anhydride, cis-cyclohexane-1,2-dicarboxylic anhydride, trans-cyclohexane-1,2-dicarboxylic anhydride	85-42-7, 13149-00-3, 14166-21-3	0.050
VIII	101	Diazene-1,2-dicarboxamide (C,C'-azodi(formamide))	123-77-3	0.050
VIII	102	Dibutyltin dichloride (DBTC)	683-18-1	0.050
VIII	103	Diethyl sulphate	64-67-5	0.050
VIII	104	Diisopentylphthalate	605-50-5	0.050
VIII	105	Dimethyl sulphate	77-78-1	0.050
VIII	106	Dinoseb	88-85-7	0.050
VIII	107	Dioxobis(stearato)trilead*	12578-12-0	0.005
VIII	108	Fatty acids, C16-18, lead salts*	91031-62-8	0.005
VIII	109	Furan	110-00-9	0.050
VIII	110	Henicosafluoroundecanoic acid	2058-94-8	0.050
VIII	111	Heptacosafluorotetradecanoic acid	376-06-7	0.050
VIII	112	12 Hexahydromethylphathalic anhydride, Hexahydro-4-methylphathalic anhydride, Hexahydro-1-methylphathalic anhydride, Hexahydro-3-methylphathalic anhydride		0.050
VIII	113	Lead bis(tetrafluoroborate)*	13814-96-5	0.005
VIII	114	Lead cyanamidate*	20837-86-9	0.005
VIII	115	ead dinitrate* 10099-74-8		0.005
VIII	116	Lead monoxide*	1317-36-8	0.005



This document is issued by the Company subject to its General Conditions of Service printed overleaf, available on request or accessible at <a href="http://www.sgs.com/en/Terms-and-Conditions.aspx">http://www.sgs.com/en/Terms-and-Conditions.aspx</a> and, for electronic format documents, subject to Terms and Conditions for Electronic Documents at <a href="http://www.sgs.com/en/Terms-and-Conditions/Terms-en-Document.aspx">http://www.sgs.com/en/Terms-and-Conditions/Terms-en-Document.aspx</a>. Attention is drawn to the limitation of liability, indemnification and jurisdiction issues defined therein. Any holder of this document is advised that information contained hereon reflects the Company's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Company's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents. This document cannot be reproduced except in full, without prior written approval of the Company. Any unauthorized alteration, forgery or falsification of the content or appearance of this document is unlawful and offenders may be prosecuted to the fullest extent of the law. Unless otherwise stated the results shown in this test report refer only to the sample(s) tested.

Attention: To check the authenticity of testing /inspection report & certificate, please contact us at telephone: (86-755) 8307 1443, or email: CN.Doccheck@sgs.com" | CN.Doccheck@sgs.com | CN

3<sup>rd</sup>Building, No. 889 Yishan Road Xuhui District, Shanghai China 200233 中国・上海・徐汇区宜山路889号3号楼 邮编: 200233 tE&E (86-21) 61402553 fE&E (86-21)64953679 www.sgsgroup.com.cn tHL (86-21) 61402594 fHL (86-21)61156899





No. SHAHG1512973401

Date: 10 Jul 2015

Page 11 of 14

### **Appendix**

#### Full list of tested SVHC:

Batch	No.	Substance Name	CAS No.	RL (%)
VIII	117	Lead oxide sulfate*	12036-76-9	0.005
VIII	118	Lead tetroxide (orange lead)*	1314-41-6	0.005
VIII	119	Lead titanium trioxide*	12060-00-3	0.005
VIII	120	Lead titanium zirconium oxide*	12626-81-2	0.005
VIII	121	Methoxyacetic acid	625-45-6	0.050
VIII	122	Methyloxirane (Propylene oxide)	75-56-9	0.050
VIII	123	N,N-dimethylformamide	68-12-2	0.050
VIII	124	N-Methylacetamide	79-16-3	0.050
VIII	125	N-Pentyl-isopentylphthalate	776297-69-9	0.050
VIII	126	o-Aminoazotoluene	97-56-3	0.050
VIII	127	o-Toluidine	95-53-4	0.050
VIII	128	Pentacosafluorotridecanoic acid	72629-94-8	0.050
VIII	129	Pentalead tetraoxide sulphate*	12065-90-6	0.005
VIII	130	Pyrochlore, antimony lead yellow*	8012-00-8	0.005
VIII	131	Silicic acid, barium salt, lead-doped*	68784-75-8	0.005
VIII	132	Silicic acid, lead salt*	11120-22-2	0.005
VIII	133	Sulfurous acid, lead salt, dibasic*	62229-08-7	0.005
VIII	134	Tetraethyllead*	78-00-2	0.005
VIII	135	Tetralead trioxide sulphate*	12202-17-4	0.005
VIII	136	Tricosafluorododecanoic acid	307-55-1	0.050
VIII	137	Trilead bis(carbonate)dihydroxide (basic lead carbonate)*	1319-46-6	0.005



This document is issued by the Company subject to its General Conditions of Service printed overleaf, available on request or accessible at <a href="http://www.sgs.com/en/Terms-and-Conditions.aspx">http://www.sgs.com/en/Terms-and-Conditions.aspx</a> and, for electronic format documents, subject to Terms and Conditions for Electronic Documents at <a href="http://www.sgs.com/en/Terms-and-Conditions/Terms-e-Document.aspx">http://www.sgs.com/en/Terms-and-Conditions/Terms-e-Document.aspx</a>. Attention is drawn to the limitation of liability, indemnification and jurisdiction issues defined therein. Any holder of this document is advised that information contained hereon reflects the Company's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Company's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents. This document cannot be reproduced except in full, without prior written approval of the Company. Any unauthorized alteration, forgery or falsification of the content or appearance of this document is unlawful and offenders may be prosecuted to the fullest extent of the law. Unless otherwise stated the results shown in this test report refer only to the sample(s) tested.

Attention: To check the authenticity of testing /inspection report & certificate, please contact us at telephone: (86-755) 8307 1443, or email: CN\_Doccheck@sgs.com"

\*\*Policy of the converse of the content of the content or the content of the content or the

3<sup>rd</sup>Building, No. 889 Yishan Road Xuhui District, Shanghai China 200233 中国・上海・徐汇区宜山路889号3号楼 邮编: 200233 tE&E (86-21) 61402553 fE&E (86-21)64953679 www.sgsgroup.com.cn tHL (86-21) 61402594 fHL (86-21)61156899





No. SHAHG1512973401

Date: 10 Jul 2015

Page 12 of 14

### **Appendix**

#### Full list of tested SVHC:

Batch	No.	Substance Name	CAS No.	RL (%)
VIII	138	Trilead dioxide phosphonate*	12141-20-7	0.005
IX	139	4-Nonylphenol, branched and linear, ethoxylated	-	0.050
IX	140	Ammonium pentadecafluorooctanoate (APFO)	3825-26-1	0.050
IX	141	Cadmium oxide*	1306-19-0	0.005
IX	142	Cadmium*	7440-43-9	0.005
IX	143	Dipentyl phthalate (DPP)	131-18-0	0.050
IX	144	Pentadecafluorooctanoic acid (PFOA)	335-67-1	0.050
Х	145	Cadmium sulphide*	1306-23-6	0.005
Х	146	Dihexyl phthalate	84-75-3	0.050
Х	147	Disodium 3,3'- [[1,1'-biphenyl]-4,4'-diylbis(azo)]bis(4-aminonaphthalene-1-su lphonate) (C.I. Direct Red 28)	573-58-0	0.050
Х	148	Disodium 4-amino-3-[[4'-[(2,4-diaminophenyl)azo] [1,1'-biphenyl]-4-yl]azo] -5-hydroxy-6- (phenylazo)naphthalene-2,7-disulphonate (C.I. Direct Black 38)	1937-37-7	0.050
Х	149	Imidazolidine-2-thione; (2-imidazoline-2-thiol)	96-45-7	0.050
Х	150	Lead di(acetate)*	301-04-2	0.005
Х	151	Trixylyl phosphate	25155-23-1	0.050
XI	152	1,2-Benzenedicarboxylic acid, dihexyl ester, branched and linear	68515-50-4	0.05
ΧI	153	Cadmium chloride*	10108-64-2	0.005
ΧI	154	Sodium perborate; perboric acid, sodium salt* -		0.005
ΧI	155	Sodium peroxometaborate*	7632-04-4	0.005



This document is issued by the Company subject to its General Conditions of Service printed overleaf, available on request or accessible at <a href="http://www.sgs.com/en/Terms-and-Conditions.aspx">http://www.sgs.com/en/Terms-and-Conditions.aspx</a> and, for electronic format documents, subject to Terms and Conditions for Electronic Documents at <a href="http://www.sgs.com/en/Terms-and-Conditions/Terms-en-Document.aspx">http://www.sgs.com/en/Terms-and-Conditions/Terms-en-Document.aspx</a>. Attention is drawn to the limitation of liability, indemnification and jurisdiction issues defined therein. Any holder of this document is advised that information contained hereon reflects the Company's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Company's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents. This document cannot be reproduced except in full, without prior written approval of the Company. Any unauthorized alteration, forgery or falsification of the content or appearance of this document is unlawful and offenders may be prosecuted to the fullest extent of the law. Unless otherwise stated the results shown in this test report refer only to the sample(s) tested.

Attention: To check the authenticity of testing /inspection report & certificate, please contact us at telephone: (86-755) 8307 1443, or email: CN.Doccheck@sgs.com" | CN.Doccheck@sgs.com | CN

3<sup>rd</sup>Building, No. 889 Yishan Road Xuhui District, Shanghai China 200233 中国・上海・徐汇区宜山路889号3号楼 邮编: 200233 tE&E (86-21) 61402553 fE&E (86-21)64953679 www.sgsgroup.com.cn tHL (86-21) 61402594 fHL (86-21)61156899





No. SHAHG1512973401

Date: 10 Jul 2015

Page 13 of 14

### **Appendix**

#### Full list of tested SVHC:

Batch	No.	Substance Name	CAS No.	RL (%)
XII	156	2-(2H-benzotriazol-2-yl)-4,6-ditertpentylphenol (UV-328)	25973-55-1	0.050
XII	157	2-benzotriazol-2-yl-4,6-di-tert-butylphenol (UV-320)	3846-71-7	0.050
XII	158	2-ethylhexyl 10-ethyl-4,4-dioctyl-7-oxo-8-oxa-3,5-dithia-4-stannatetradeca noate (DOTE)	15571-58-1	0.050
XII	159	Cadmium fluoride*	7790-79-6	0.005
XII	160	Cadmium sulphate* 10124-36-4,311		0.005
XII	161	Reaction mass of 2-ethylhexyl 10-ethyl-4,4-dioctyl-7-oxo-8-oxa-3,5-dithia-4-stannatetradeca noate & 2-ethylhexyl 10-ethyl-4-[[2-[(2-ethylhexyl)oxy]-2-oxoethyl]thio]-4-octyl-7-oxo-8-oxa-3,5-di thia-4-stannatetradecanoate (reaction mass of DOTE & MOTE)		0.050
XIII	162	1,2-benzenedicarboxylic acid, di-C6-10-alkyl esters; 1,2-benzenedicarboxylic acid, mixed decyl and hexyl and octyl diesters with ≥ 0.3% of dihexyl phthalate	68515-51-5,68648-93 -1	0.050
XIII	163	5-sec-butyl-2- (2,4-dimethylcyclohex-3-en-1-yl)-5-methyl-1,3-dioxane [1], 5-sec-butyl-2- (4,6-dimethylcyclohex-3-en-1-yl)-5-methyl-1,3-dioxane [2] [covering any of the individual isomers of [1] and [2] or any combination thereof]		0.050







No. SHAHG1512973401

Date: 10 Jul 2015

Page 14 of 14

Sample photo:



SGS authenticate the photo on original report only

\*\*\* End of Report \*\*\*



This document is issued by the Company subject to its General Conditions of Service printed overleaf, available on request or accessible at <a href="http://www.sgs.com/en/Terms-and-Conditions.aspx">http://www.sgs.com/en/Terms-and-Conditions.aspx</a> and, for electronic format documents, subject to Terms and Conditions for Electronic Documents at <a href="http://www.sgs.com/en/Terms-and-Conditions/Terms-e-Document.aspx">http://www.sgs.com/en/Terms-and-Conditions/Terms-e-Document.aspx</a>. Attention is drawn to the limitation of liability, indemnification and jurisdiction issues defined therein. Any holder of this document is advised that information contained hereon reflects the Company's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Company's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents. This document cannot be reproduced except in full, without prior written approval of the Company. Any unauthorized alteration, forgery or falsification of the content or appearance of this document is unlawful and offenders may be prosecuted to the fullest extent of the law. Unless otherwise stated the results shown in this test report refer only to the sample(s) tested.

Attention: To check the authenticity of testing /inspection report & certificate, please contact us at telephone: (86-755) 8307 1443, or email: CN\_Doccheck@sgs.com"

\*\*Policy of the converse of the content of the content or the content of the content or the





### Test Report Number:151215003SHF-BP-21

Applicant Name:	<b>♦LNLU</b> R	Original Report Date: January 20, 2016

#### Sample Description:

Product: LOOSE LAY

Model: 6"X48"X5.0mm\*0.5mm; 18"X36"X5.0mm\*0.5mm

Samples Quantity: 63 pieces

Sample ID: S151215003SHF-001~063

Date Received: 2015-12-11

Date Test Conducted: 2015-12-15~2016-01-20

#### Tests Conducted:

Test Methods: Please see next page(s)

### **Conclusion:**

For details refer to attached page(s). The conclusions of this test report may not be used as part of the requirements for Intertek product certification. Authority to Mark must be issued for a product to become certified.

Should you have any queries about the test report, please contact:

Approved by:	Checked by:	Prepared by:	
2			
for her	Jodie Zhon	Saly Xie	
Sun Sun	Jodie Zhou	Sally Xie	
Assistant Manager	Senior Technical superv	isor Technical supervisor	
/ looistarie i lariagei	Seriior recrimedi saperv	Sor recrimed supervisor	

Intertek Testing Services Ltd., Shanghai
No.7 Building, No. 6958 Daye Road, Fengxian District, Shanghai
Tel: 021-61136116 Fay: 021-61189921 Webs

Tel: 021-61136116 Fax: 021-61189921 Website: <u>www.intertek.com</u>

Page 1 of 6





#### **Test Report** Report Number:151215003SHF-BP-21

### **Test Items, Method and Results:**

Table 1 Test result of model 6"X48"X5.0mm\*0.5mm based on ASTM F1700-13a

Test Item	Test Method	Test Result	Test Requirement	Verdict
Size	ASTM F2055-10	Claimed Length: 1219.2mm Width: 152.4mm Tested Length: 1218.48mm Width: 152.33mm	A tolerance of ±0.4mm/305mm	Pass
Thickness	ASTM F386-11	Claimed value: 5.0mm Average: 5.04mm Min.: 5.00mm Max.:5.06mm	A tolerance of ±0.13mm	Pass
Squareness	ASTM F2055-10	Short edge Max.: 0.06mm/152mm Long edge Max.: 0.16mm/600mm	≤0.25mm/305mm	Pass

Website: www.intertek.com





## **Test Report**

Report Number:151215003SHF-BP-21

Table 2 Test result of model 18"X36"X5.0mm\*0.5mm based on ASTM F1700-13a

Test Item	Test Method	Test Result	Test Requirement in	Verdict
Size	ASTM F2055-10	Claimed Length: 914.4mm Width: 457.2mm Tested Length: 914.43mm Width: 457.45mm	A tolerance of ±0.4mm/305mm	Pass
Thickness	ASTM F386-11	Claimed value: 5.0mm Average: 5.06mm Min.: 5.05mm Max.:5.08mm	A tolerance of ±0.13mm	Pass
Thickness of wear layer	ASTM F410- 08(2013)	Average: 0.50mm	Commercial, 0.5mm min	Pass
Squareness	ASTM F2055-10	Short edge Max.: 0.16mm/400mm Long edge Max.: 0.16mm/600mm	≤0.25mm/305mm	Pass
Residual indentation	ASTM F1914- 07(2011)	Average: 6.9% Max. : 7.3%	Average ≤ 8%  Max ≤ 10%	Pass
Flexibility	ASTM F137- 08(2013)	No crack or break when using Φ25.4mm mandrel	No crack or break when using Φ25.4mm mandrel	Pass
Dimension Stability	ASTM F2199-09	MD Max.: 0.06mm/180mm CMD Max.: 0.14mm/180mm	≤0.51mm/305mm	Pass
Resistance to Chemicals	ASTM F925-13	See Appendix B for details	No more than a slight change in surface dulling, surface attack or staining	Pass
Resistance to Heat	ASTM F1514- 03(2013)	ΔE*= 0.30	ΔE* shall not greater than 8.0 after 7 days exposure to 70 °C	Pass
Resistance to Light	ASTM F1515- 03(2008)	ΔE*= 1.81	ΔE* shall not greater than 8.0 after a 300h exposure	Pass

Page 3 of 6





## **Test Report**

Report Number:151215003SHF-BP-21

Table 3 Test result of model 18"X36"X5.0mm\*0.5mm based on other standards

Test Item	Test Method	Test Result
Formaldebude centent	ASTM D6007-14	ND
Formaldehyde content	ASTM D0007-14	Detection limit =0.02 ppm
Castor chair resistance	NALFA/ANSI LF-11	No visible damage after 25000 revolutions
		Static Coefficient of friction
Coefficient of friction	ACTM D2204 0E(2011)	Dry: 0.58, Wet: 0.74
Coefficient of friction	ASTM D2394-05(2011)	Sliding Coefficients of Friction
		Dry: 0.51, Wet: 0.69
Static coefficient of friction	ASTM C1028-07e1	Dry: 0.83 Wet: 0.65
Static load	ASTM F970-07(2011)	Applied load: 250lb
		Residual indentation: 0.05mm
Abrasion resistance	ASTM D4060-14	Type of wheels: CS-17
		Load: 1000g
		Revolutions: 1000
		Mass loss: 39.5mg
Fungi resistance <sup>1</sup>	ASTM G21-13	Rating 0
		Observed Growth on Specimens: None

### Note:

Intertek Testing Services Ltd., Shanghai Pag
No.7 Building, No. 6958 Daye Road, Fengxian District, Shanghai
Tel: 021-61136116 Fax: 021-61189921 Website: <a href="https://www.intertek.com">www.intertek.com</a>

Page 4 of 6

<sup>1.</sup> The test was conducted at the external approved/qualified facility, located at [Guangzhou].





### **Test Report**

### Report Number:151215003SHF-BP-21

### **Appendix A**: Sample photos






Model 6"X48"X5.0mm\*0.5mm

Model 18"X36"X5.0mm\*0.5mm

Fig.1-2 Sample received

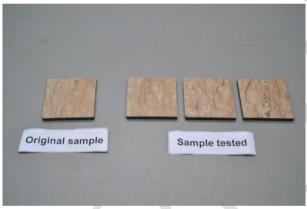






Fig.4 After resistance to light test



Fig.4 After fungi test

Intertek Testing Services Ltd., Shanghai No.7 Building, No. 6958 Daye Road, Fengxian District, Shanghai

Tel: 021-61136116 Fax: 021-61189921 Website: <u>www.intertek.com</u>





### Test Report Number:151215003SHF-BP-21

#### Appendix B

#### Test result of Resistance to Chemicals

Regent	Rating				
Regent	Surface attack	te attack Color change Surf			
White vinegar (5% acetic acid)	0	0 0 0			
Rubbing alcohol (70% isopropyl alcohol)	0	0	0		
White mineral oil (medicinal grade)	0	0	0		
Sodium hydroxide solution (5% NaOH)	0	0	0		
Hydrochloric acid solution (5% HCl)	0	0	0		
Sulfuric acid solution (5% H <sub>2</sub> SO <sub>4</sub> )	0	0	0		
Household ammonia solution (5% NH <sub>4</sub> OH)	0	0	0		
Household bleach (5.25% NaOCI)	0	0	0		
Olive oil (light)	0	0	0		
Kerozene (K1)	0	0	0		
Unleaded gasoline (regular grade)	0	0	0		
Phenol (5% active phenol)	0	0	0		

#### Notes:

According to ASTM F925-13, rating 0-3 represents:

0 = no change; 1 = slight change; 2 = moderate change; 3 = severe change. Surface Dulling - Indicating that the specimen suffered from a loss of gloss, Color Change - Indicating that the specimen suffered discoloration or bleaching, or both, and Surface Attack - Indicating that the specimen suffered surface damage such as softening, warping, swelling, blistering, peeling, raised or rough area.

The End of Report

Page 6 of 6

This report is for the exclusive use of Intertek's Client and is provided pursuant to the agreement between Intertek and its Client. Intertek's responsibility and liability are limited to the terms and conditions of the agreement. Intertek assumes no liability to any party, other than to the Client in accordance with the agreement, for any loss, expense or damage occasioned by the use of this report. Only the Client is authorized to permit copying or distribution of this report and then only in its entirety. Any use of the Intertek name or one of its marks for the sale or advertisement of the tested material, product or service must first be approved in writing by Intertek. The observations and test results in this report are relevant only to the sample tested. This report by itself does not imply that the material, product, or service is or has ever been under an Intertek certification program.

Intertek Testing Services Ltd., Shanghai No.7 Building, No. 6958 Daye Road, Fengxian District, Shanghai

Tel: 021-61136116 Fax: 021-61189921 Website: <u>www.intertek.com</u>



**Test Report** No. SHAHG1527187401 Date: 06 Jan 2016 Page 1 of 3



The following sample(s) was/were submitted and identified on behalf of the clients as : JH-LVT, LUXURY VINYL TILE, FLOORING USED INDOOR

SGS Job No. : SHHG1512052469SD - SH

Country of Destination: NETHERLANDS

Style No. : JH-6005-1

Date of Sample Received : 31 Dec 2015

Testing Period: 31 Dec 2015 - 06 Jan 2016

Test Requested: Selected test(s) as requested by client.

Test Method: Please refer to next page(s).

Test Results: Please refer to next page(s).

Result Summary:

Test Requested	Conclusion
US California Proposition 65- Phthalate content	PASS

Signed for and on behalf of

SGS-CSTC Standards Technical Services (Shanghai) Co., Ltd.

Serena Wang

**Approved Signatory** 



This document is issued by the Company subject to its General Conditions of Service printed overleaf, available on request or accessible at <a href="http://www.sgs.com/en/Terms-and-Conditions.aspx">http://www.sgs.com/en/Terms-and-Conditions.aspx</a> and, for electronic format documents, subject to Terms and Conditions for Electronic Documents at <a href="http://www.sgs.com/en/Terms-and-Conditions/Terms-en-Document.aspx">http://www.sgs.com/en/Terms-en-Document.aspx</a>. Attention is drawn to the limitation of liability, indemnification and jurisdiction issues defined therein. Any holder of this document is advised that information contained hereon reflects the Company's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Company's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents. This document cannot be reproduced except in full, without prior written approval of the Company. Any unauthorized attention, forgery or falsification of the content or appearance of this document is unlawful and offenders may be prosecuted to the fullest extent of the law. Unless otherwise stated the results shown in this test report refer only to the sample(s) tested.

Attention: To check the authenticity of testing /inspection report & certificate, please contact us at telephone: (86-755) 8307 1443, or email: CN.Doccheck@sgs.com

3<sup>r6</sup>Bullding,No.889 Yishan Road Xuhui District,Shanghai China 200233 中国・上海・徐汇区宜山路889号3号楼 邮编: 200233 tE&E (86-21) 61402553 f E&E (86-21) 64953679 tHL (86-21) 61402594 f HL (86-21) 61156899

www.sgsgroup.com.cn e sgs.china@sgs.com





**Test Report** No. SHAHG1527187401 Date: 06 Jan 2016 Page 2 of 3

Test Results:

#### Test Part Description:

Specimen No. SGS Sample ID Description

SN1 SHA15-271874.001 Grey plastic board with black

#### Remarks:

(1) 1 mg/kg = 0.0001%

(2) MDL = Method Detection Limit

(3) ND = Not Detected ( < MDL)

(4) "-" = Not Regulated

#### US California Proposition 65- Phthalate content

Test Method: With reference to CPSC-CH-C1001-09.3. Analysis was performed by GC-MS.

Test Item(s)	CAS NO.	<u>Limit</u>	<u>Unit</u>	<u>MDL</u>	<u>001</u>
Dibutyl Phthalate (DBP)	84-74-2	1000	mg/kg	50	ND
Benzylbutyl Phthalate (BBP)	85-68-7	1000	mg/kg	50	ND
Bis-(2-ethylhexyl) Phthalate (DEHP)	117-81-7	1000	mg/kg	50	ND
Diisononyl Phthalate (DINP)	28553-12-0 /68515-48-0	1000	mg/kg	50	ND
Di-n-octyl Phthalate (DNOP)	117-84-0	1000	mg/kg	50	ND
Diisodecyl Phthalate (DIDP)	26761-40-0 /68515-49-1	1000	mg/kg	50	ND
Conclusion					PASS

### Notes:

- (1) The limit for phthalates is referenced to the requirement stated in County of Marin Court Case No.: CIV 091150, County of Solano Court Case No.: FCS-033234 and Public Law (Consumer Product Safety Improvement Act of 2008, CPSIA).
- (2) The reference limit applied in testing is based on particular prop 65 settlements that are most similar to the tested product in the opinion of the lab. The testing in this report does not reflect a user's actual exposure to the tested chemical.

A manufacturer or retailer that is not named in the referenced settlement is not bound by that settlement, and may choose to comply with Proposition 65 by clearly informing the consumer of potential exposure.



This document is issued by the Company subject to its General Conditions of Service printed overleaf, available on request or accessible at <a href="http://www.sgs.com/en/Terms-and-Conditions.aspx">http://www.sgs.com/en/Terms-and-Conditions.aspx</a> and, for electronic format documents, subject to Terms and Conditions for Electronic Documents at <a href="http://www.sgs.com/en/Terms-and-Conditions/Terms-e-Document.aspx">http://www.sgs.com/en/Terms-and-Conditions/Terms-e-Document.aspx</a>. Attention is drawn to the limitation of liability, indemnification and jurisdiction issues defined therein. Any holder of this document is advised that information contained hereon reflects the Company's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Company's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents. This document cannot be reproduced except in full, without prior written approval of the Company. Any unauthorized alteration, forgery or falsification of the content or appearance of this document is unlawful and offenders may be prosecuted to the fullest extent of the law. Unless otherwise stated the results shown in this test report refer only to the sample(s) tested.

Attention: To check the authenticity of testing /inspection report & certificate, please contact us at telephone: (86-755) 8307 1443, or email: CN\_Doccheck@ags.com" | CN\_Doccheck@ags.com | CN\_D

3<sup>rg</sup>Bulkling,No.889 Yishan Road Xuhui District,Shanghai China 200233 中国・上海・徐汇区宜山路889号3号楼 邮编: 200233 t E&E (86-21) 61402553 f E&E (86-21)64953679 t HL (86-21) 61402594 f HL (86-21)61156899

www.sgsgroup.com.cn e sgs.china@sgs.com





**Test Report** No. SHAHG1527187401 Date: 06 Jan 2016 Page 3 of 3

Sample photo:





SGS authenticate the photo on original report only

\*\*\* End of Report \*\*\*



This document is issued by the Company subject to its General Conditions of Service printed overleaf, available on request or accessible at http://www.sgs.com/en/Terms-and-Conditions.aspx and, for electronic format documents, subject to Terms and Conditions for Electronic Documents at http://www.sgs.com/en/Terms-and-Conditions/Terms-e-Document.aspx. Attention is drawn to the limitation of liability, indemnification and jurisdiction issues defined therein. Any holder of this document is advised that information contained hereon reflects the Company's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Company's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents. This document cannot be reproduced except in full, without prior written approval of the Company. Any unauthorized alteration, forgery or falsification of the content or appearance of this document is unlawful and offenders may be prosecuted to the fullest extent of the law. Unless otherwise stated the results shown in this test report refer only to the sample(s) tested.

Attention: To check the authenticity of testing /inspection report & certificate, please contact us at telephone: (86-755) 8307 1443, or email: CN.Doccheck@sgs.com